TBM NO.	DESCRIPTION	ELEV.
4	P-K In CMP Pole No.15	195.30

NOTES:

1. ELEVATIONS SHOWN ARE BASED ON A PLAN ENTITLED "GOFF STREET STORM WATER SEPARATION, PLAN & PROFILE, STATION 18+00 TO 22+50", DATED JULY 31, 1997, SHEET 2 OF 10, BY JKL LAND SURVEYING, MECHANIC FALLS. ELEVATION REFERENCE MARK IS P-K NAIL FOUND IN CMP POLE #11, ELEVATION=197.23'.
2. ALL CATCH BASINS TO BE REMOVED SHALL HAVE PIPE EXCAVATED BACK TO THE MAIN SEWER OR MANHOLE.
3. CONTRACTOR SHALL REMOVE AND REINSTALL BOTH EXISTING SIDEWALK AND EXISTING CURB AS NECESSARY TO INSTALL NEW STORMDRAIN. IF CURB IS GRANITE, MUST RESET GRANITE CURB. IF CURB IS BITUMINOUS, MUST REINSTALL BITUMINOUS CURB TO MATCH EXISTING. SIDEWALK SHALL BE REINSTALLED WHERE DISTURBED TO M.D.O.T. STANDARDS. PAVEMENT THICKNESS FOR SIDEWALKS SHALL MATCH EXISTING.

CHARLES STREET
GOSS STREET
HAMPSHIRE STREET
WESTERN PROMENADE
GOFF STREET
LINE NO. 1
LINE NO. 2
LINE NO. 3
LINE NO. 4
MATCH SHEET
EXISTING CATCH BASIN TO BE REMOVED
NEW TYPE A5-C CATCH BASIN #16 GRANITE CURB
NEW TYPE A5-C CATCH BASIN #5 STA. 22+37, 17' RIGHT, GRANITE CURB
NEW TYPE A5-C CATCH BASIN #8 STA. 24+01, 28' RIGHT, GRANITE CURB
NEW TYPE D5-C DRAIN MANHOLE #7 STA. 24+01, 10' RIGHT NO CURB
NEW TYPE A5-C CATCH BASIN #9 STA. 24+34, 24' RIGHT, GRANITE CURB
NEW TYPE A5-C CATCH BASIN #12 STA. 25+82, 47' RIGHT, GRANITE CURB
NEW TYPE A5-C CATCH BASIN #13A STA. 25+90, 80' RIGHT, GRANITE CURB
NEW TYPE A5-C CATCH BASIN #10 STA. 25+65, 17' LEFT, GRANITE CURB
NEW TYPE A5-C CATCH BASIN #11 STA. 25+74, 17' LEFT, GRANITE CURB
NEW TYPE A5-C CATCH BASIN #14 STA. 26+96, 19' LEFT, GRANITE CURB
NEW TYPE B5-C CATCH BASIN #15 STA. 27+91, 20' LEFT, NO CURB
NEW TYPE A5-C CATCH BASIN #16A STA. 28+44, 21' LEFT, GRANITE CURB
NEW TYPE A5-C6 CATCH BASIN #13 STA. 26+46, 47' RIGHT, GRANITE CURB
TEST PIT LOCATION
INSTALL 10 L.F. OF 8" DIA. OPTION 3 PIPE PLUG 8" UD HOLE INTO EXISTING SEWER MANHOLE @ STA. 28+50, 18' LT.
INSTALL 10 L.F. OF 18" DIA. OPTION 3 STUB
EXISTING CATCH BASINS TO BE REMOVED
INSTALL 15 L.F. OF 24" OPTION 3 PIPE, SLOPE = 0.02'/ft
CONTRACTOR SHALL PLUG EXISTING SEWER OVERFLOW PIPE
CAP EXISTING LINE
PROPOSED NEW ALIGNMENT
6/4/04 AS PER PHONE CONVERSATION TO STEVE RAMSEY APPROX. LOCATION OF CAST IRON SEWER SERVICE
8"x10" depression around C.B.

LEGEND:
- ANGLE POINT
- UTILITY POLE
- HYDRANT
- MANHOLE
- TREE
- GATE VALVE
- BUILDING
- CULVERT
- ASPHALT ROAD
- GRAVEL ROAD
- EXIST. WATER
- EXIST. SEWER
- GAS VALVE
- TBM
- CATCH BASIN
- TEST PIT
- TEST BORING
- EXIST. CONTOUR
- CHAIN-LINK FENCE
- UNDERGROUND TEL
- UNDERGROUND ELEC.
- STORM DRAIN
- FENCE
- PROPOSED CONTOUR

INSTALL 197 L.F. OF 12" DIA. TYPE C UD PIPE SLOPE = 0.01'/FT
INSTALL 35 L.F. OF 12" DIA. OPTION 3 PIPE SLOPE 0.015 '/ft
INSTALL 160 L.F. OF 24" DIA. TYPE C UD PIPE SLOPE = 0.003'/FT
INSTALL 14 L.F. OF 12" DIA. OPTION 3 PIPE SLOPE 0.0071 '/ft
INSTALL 32 L.F. OF 24" DIA. OPTION 3 PIPE SLOPE = 0.005'/FT
INSTALL 28 L.F. OF 12" DIA. OPTION 3 PIPE SLOPE = 0.007'/FT
INSTALL 32 L.F. OF 12" DIA. OPTION 3 PIPE SLOPE = 0.007'/FT
INSTALL 136 L.F. OF 24" DIA. TYPE C UD PIPE SLOPE = 0.005'/FT
INSTALL 74 L.F. OF 24" DIA. OPTION 3 PIPE SLOPE = 0.007'/FT
INSTALL 58 L.F. OF 12" DIA. OPTION 3 PIPE SLOPE 0.025 '/ft
INSTALL 78 L.F. OF 18" DIA. OPTION 3 PIPE SLOPE 0.0228 '/ft
INSTALL 91 L.F. OF 18" DIA. TYPE C UD PIPE SLOPE = 0.025'/FT
INSTALL 66 L.F. OF 18" DIA. OPTION 3 PIPE SLOPE = 0.0682'/FT
EXISTING SEWER INV. 15" = 184.44 +-
EXIST. SEWER INV. 15" = 181.69 +-
EXIST. SEWER (ABANDONED) INV. = 197.60 +-

No.	Revisions	Date	App'd.
2	REVISION NUMBER 2	7/6/99	BAS
1	REVISION NUMBER 1	6/30/99	BAS

UPPER GOFF STREET AREA
STORM WATER SEPARATION
CITY OF AUBURN — AUBURN, MAINE

GOFF STREET
PLAN & PROFILE
Sta. 21+00 To Sta. 28+70

© AEHodsdon CONSULTING ENGINEERS
10 Common St. Waterville, Me. 04901 (207) 873-5164

STATE OF MAINE — BRIAN A. SIMPSON, III — 2936 — REGISTERED PROFESSIONAL ENGINEER

Drawn By:	JER	Scale:	1"=20'-0" Horz. 1"=5'-0" Vert.
Checked By:	BAS	Date:	6/21/1999
Approved By:	AEH	Date:	6/21/1999
File No.		Project No.	61-98

Sheet No. 2 of 11

TBM NO.	DESCRIPTION	ELEV.

NOTES:

1. ELEVATIONS SHOWN ARE BASED ON A PLAN ENTITLED "GOFF STREET STORM WATER SEPARATION, PLAN & PROFILE, STATION 16+00 TO 22+50", DATED JULY 31, 1997, SHEET 2 OF 10, BY JKL LAND SURVEYING, MECHANIC FALLS. ELEVATION REFERENCE MARK IS P-K NAIL FOUND IN CMP POLE #11, ELEVATION=197.23'.
2. ALL CATCH BASINS TO BE REMOVED SHALL HAVE PIPE EXCAVATED BACK TO THE MAIN SEWER OR MANHOLE.
3. CONTRACTOR SHALL REMOVE AND REINSTALL BOTH EXISTING SIDEWALK AND EXISTING CURB AS NECESSARY TO INSTALL NEW STORMDRAIN. IF CURB IS GRANITE, MUST RESET GRANITE CURB. IF CURB IS BITUMINOUS, MUST REINSTALL BITUMINOUS CURB TO MATCH EXISTING. SIDEWALK SHALL BE REINSTALLED WHERE DISTURBED TO M.D.O.T. STANDARDS. PAVEMENT THICKNESS FOR SIDEWALKS SHALL MATCH EXISTING.

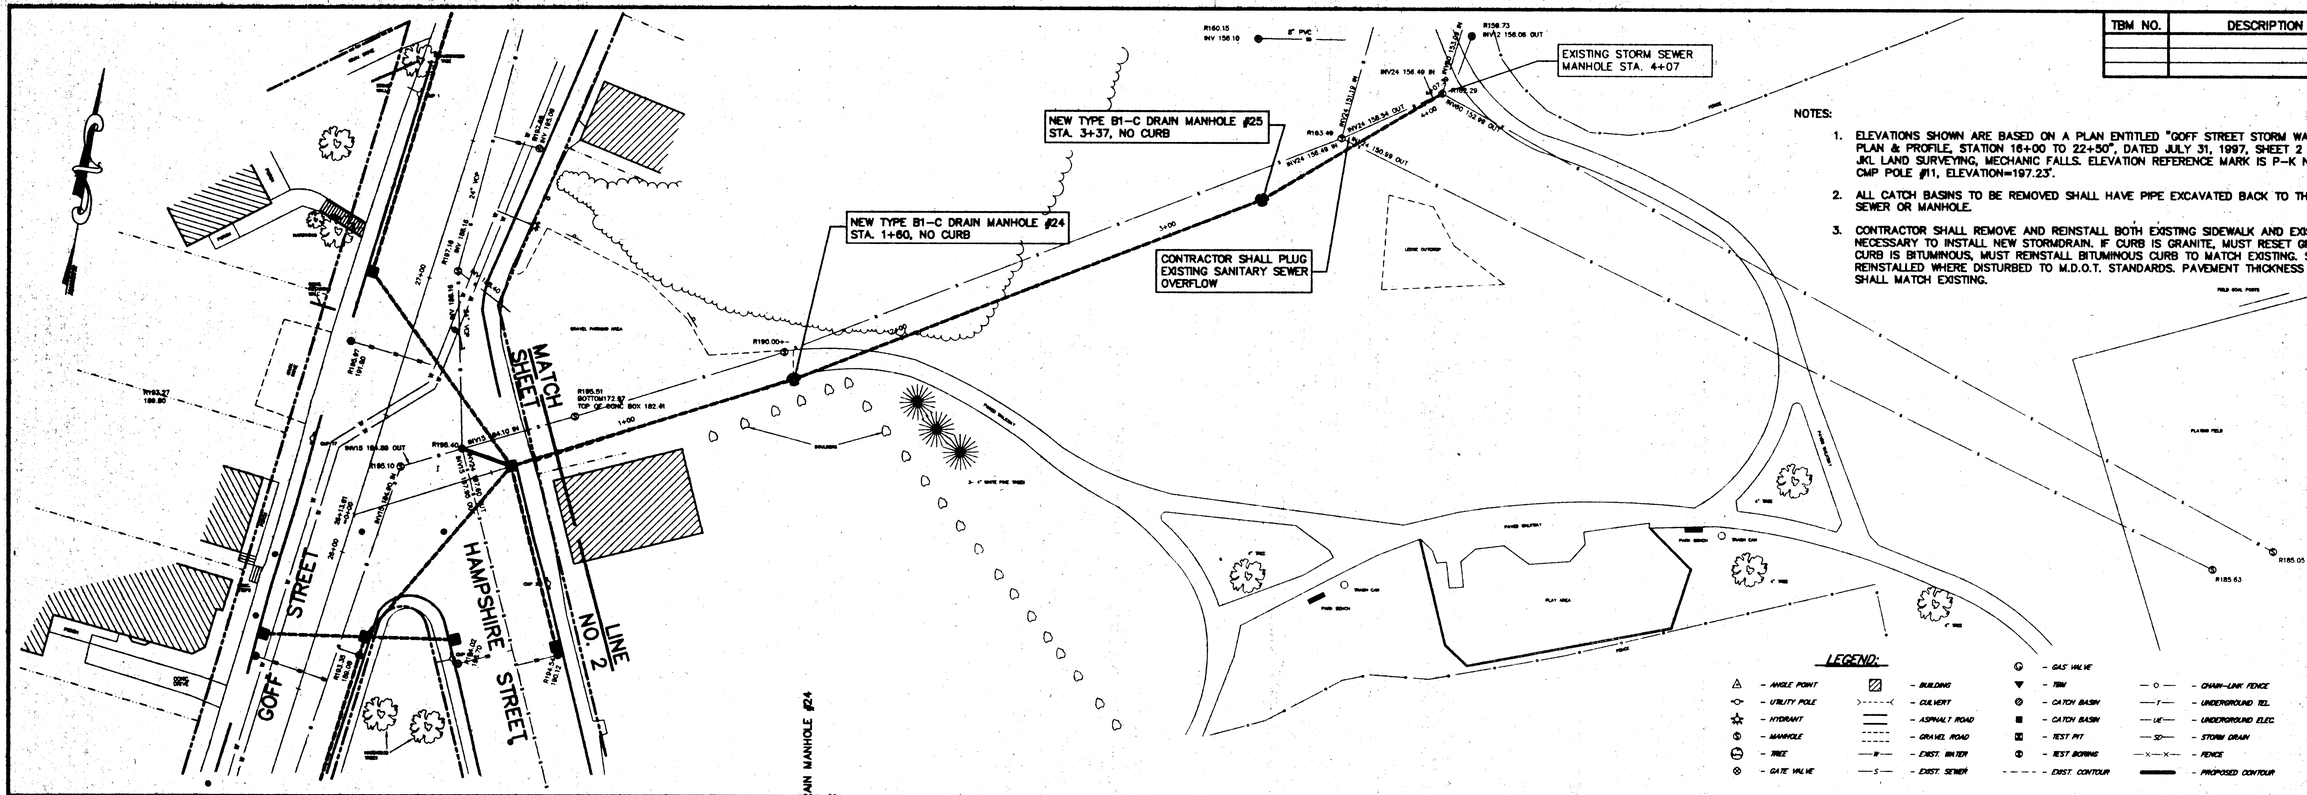

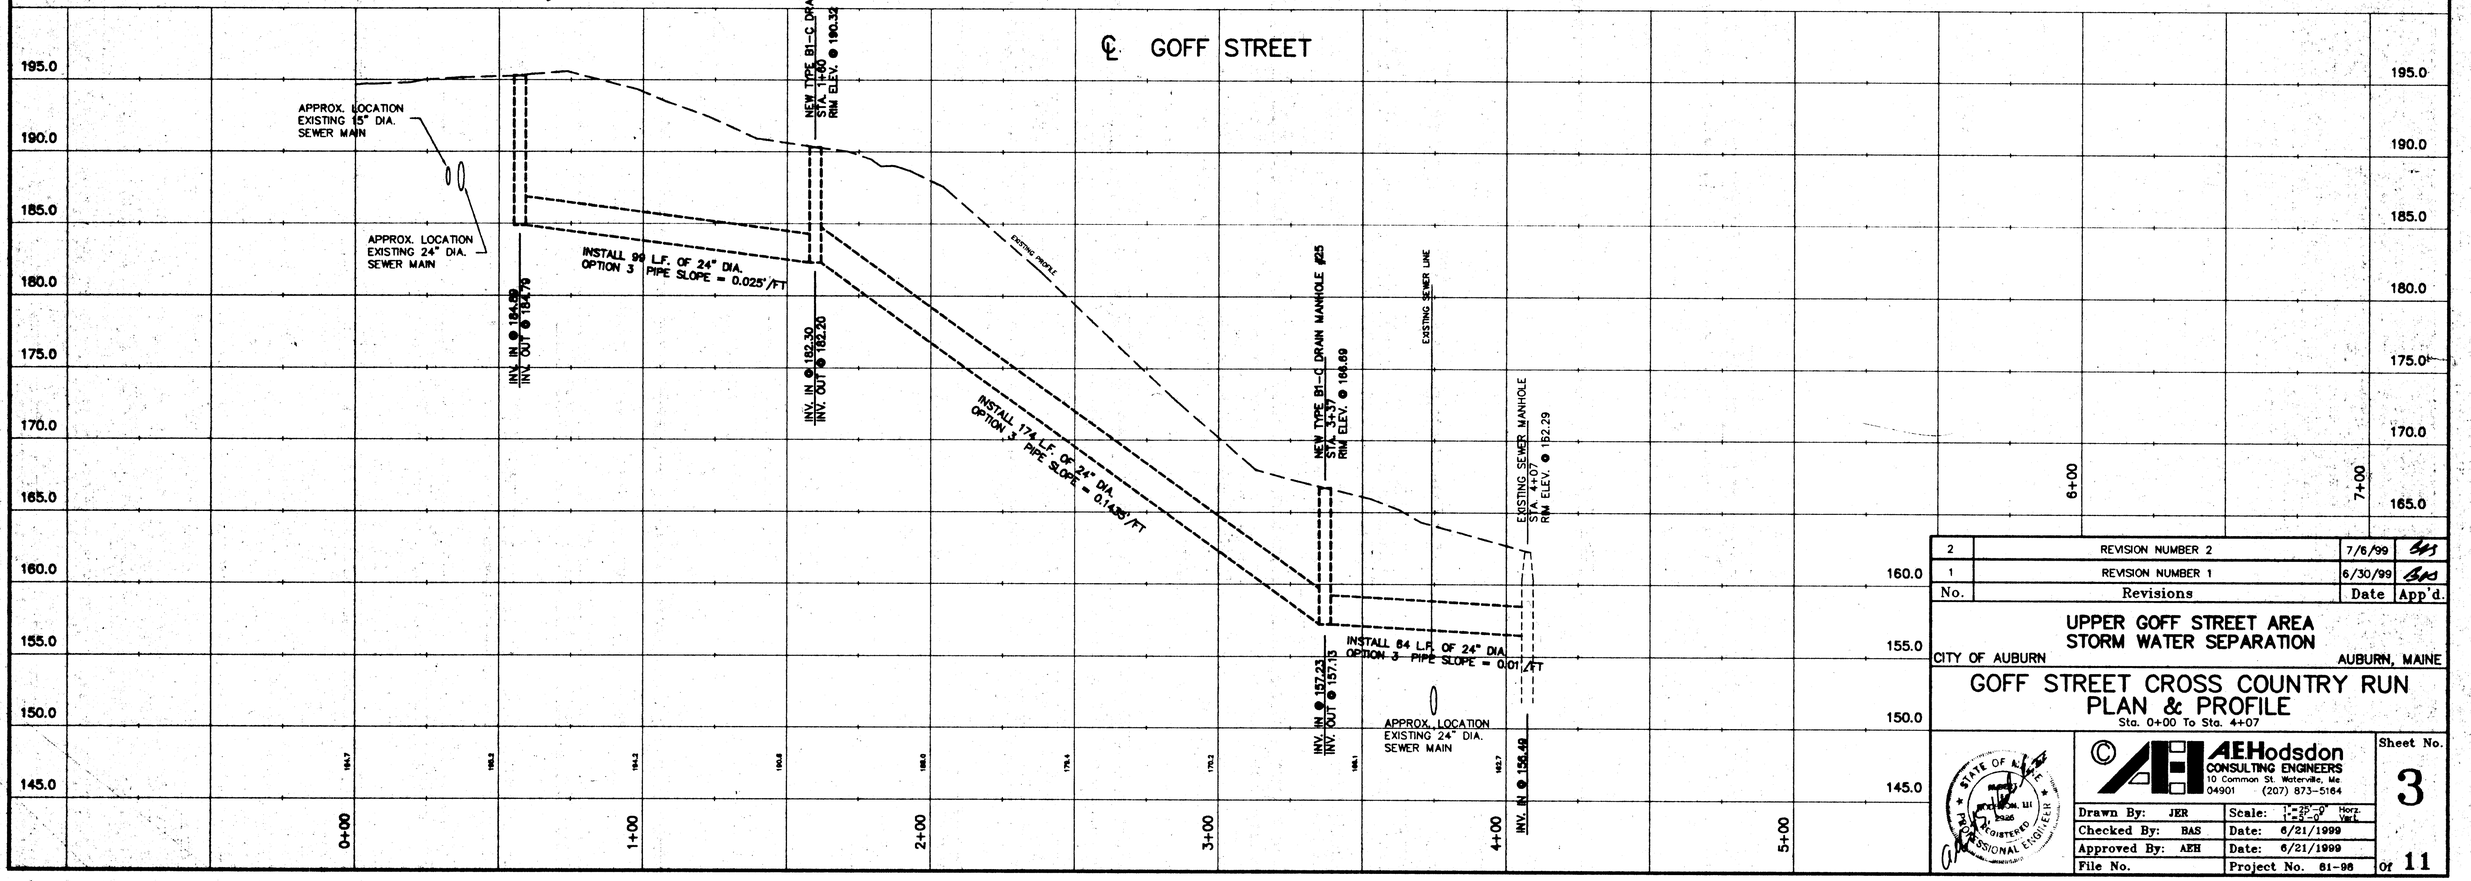

No.	Revisions	Date	App'd.
2	REVISION NUMBER 2	7/6/99	BAS
1	REVISION NUMBER 1	6/30/99	BAS

UPPER GOFF STREET AREA
STORM WATER SEPARATION

CITY OF AUBURN — AUBURN, MAINE

GOFF STREET CROSS COUNTRY RUN PLAN & PROFILE

Sta. 0+00 To Sta. 4+07

© AEHodsdon CONSULTING ENGINEERS
10 Common St. Waterville, Me. 04901 (207) 873-5164

Drawn By: JER	Scale: 1"=20'-0" Horz. 1"=5'-0" Vert.	Sheet No.	3
Checked By: BAS	Date: 6/21/1999		
Approved By: AEH	Date: 6/21/1999		
File No.	Project No. 61-98	Of	11