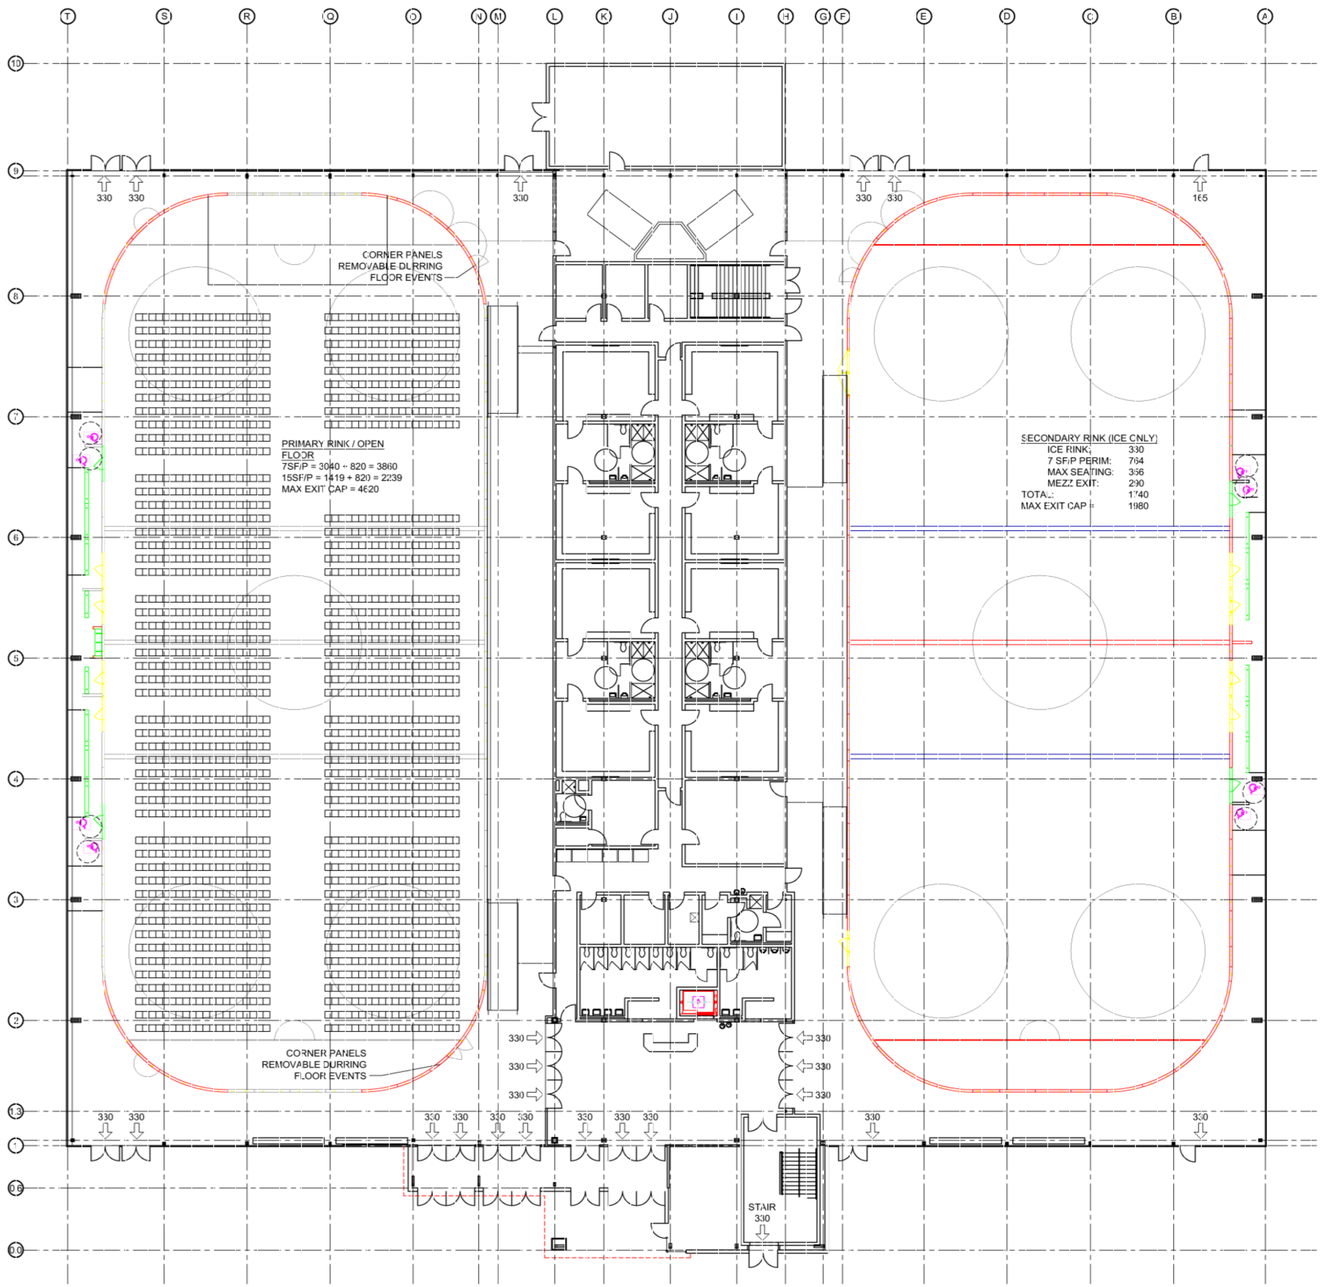

2009 IBC: CODE DATA		2009 NFPA: CODE DATA	
USE GROUP CLASSIFICATION	ASSEMBLY A-4	OCCUPANT LOAD - FLOOR AREA [TOTAL FLOOR SPECIFIC BUILDING AREA LESS STORAGE AREAS]	
TYPE OF CONSTRUCTION	II B (1H-PROTECTED NON-COMBUSTIBLE)		
FLOOR AREA	71,853 SF	OCCUPANT LOAD - 4080	VARIES, SEE PLANS
		USE GROUP CLASSIFICATION	ASSEMBLY
TABLE 503 BUILDING AREA LIMITATION-SF	9,500 SF	TYPE OF CONSTRUCTION	PROTECTED TYPE II (000)
506.2 STREET FRONTAGE INCREASE = (25%)	N/A	ACTUAL BUILDING AREA	71,853 SF TOTAL
506.3 AUTOMATIC SPRINKLER SYSTEM INCREASE (200%)	N/A	BUILDING HEIGHT	ONE STORY W/ MEZZANINE
ALLOWABLE BUILDING FLOOR AREA-SF	UNLIMITED PER 506.3	FIRE SUPRESSION	SUPERVISED FIRE SUPPRESSION PROVIDED
BUILDING HEIGHT	ONE STORY W/ MEZZANINE	FIREWALL	N/A
FIRE SUPRESSION	FULLY SUPERVISED FIRE SUPPRESSION	STAIR ENCLOSURE:	1 HR
FIRE WALL @ 1-2 EXISTING AND 1-2 NEW SEPARATION	N/A	SHAFTS	1 HR
STAIR ENCLOSURES	1 HR	ACCESS CORRIDORS	0 HR
SHAFTS	1 HR	INTERIOR LOAD BEARING WALLS	0 HR
EXIT ACCESS CORRIDORS	0 HR	STRUCTURAL MEMBER SUPPORTING FLOORS AND ROOF	0 HR
INTERIOR LOAD BEARING WALLS	0 HR	FLOOR CONSTRUCTION	0 HR
STRUCTURAL MEMBER SUPPORTING WALLS	0 HR	ROOF CONSTRUCTION	0 HR
FLOOR CONSTRUCTION	0 HR	FIRE EXTINGUISHERS	LOCATIONS TO BE VERIFIED IN FIELD BY FIRE CHIEF PRIOR TO INSTALLATION
ROOF CONSTRUCTION	0 HR	ARRANGEMENT OF MEANS OF EGRESS	
FIRE EXTINGUISHERS	LOCATIONS TO BE VERIFIED IN FIELD BY FIRE CHIEF PRIOR TO INSTALLATION	DEAD END CORRIDORS	NOT TO EXCEED 20 FT
FLAME SPREAD RATINGS:		COMMON PATH OF TRAVEL	NOT TO EXCEED 20 FT
REQUIRED VERTICAL EXITS	CLASS A OR CLASS B	CORRIDOR WIDTH	44 INCHES MIN
CORRIDORS PROVIDING EXIT ACCESS	CLASS A OR CLASS B	FLAME SPREAD RATINGS:	
ROOMS OR ENCLOSED SPACES	CLASS A OR CLASS B	INTERIOR FINISH REQUIREMENTS	
INTERIOR FLOOR FINISH REQUIREMENTS	CLASS A OR CLASS B	REQUIRED VERTICAL EXITS	CLASS A
CORRIDORS PROVIDING EXIT ACCESS	CLASS A OR CLASS B	CORRIDORS PROVIDING EXIT ACCESS	CLASS A OR CLASS B
ROOMS OR ENCLOSED SPACES	CLASS C	ROOMS OR ENCLOSED SPACES	CLASS A OR CLASS B
		INTERIOR FLOOR FINISH REQUIREMENTS	
GENERAL NOTES:	1. ALL PENETRATIONS OF FIRE RATED WALLS AND FLOORS SHALL BE SEALED WITH PROPER APPROVED MATERIALS AND FIRE DAMPERS 2. ALL WORK SHALL CONFORM TO LOCAL AND STATE CODES, ORDINANCES AND REQUIREMENTS, ACCESSIBILITY PER A.D.A.A.	REQUIRED VERTICAL EXITS	CLASS I OR CLASS II
		CORRIDORS PROVIDING EXIT ACCESS	CLASS I OR CLASS II
		ROOMS OR ENCLOSED SPACES	CLASS I OR CLASS II
		GENERAL NOTES:	1. ALL PENETRATIONS OF FIRE RATED WALLS AND FLOORS SHALL BE SEALED WITH PROPER APPROVED MATERIALS AND FIRE DAMPERS REQUIRED. 2. ALL WORK SHALL CONFORM TO LOCAL AND STATE CODES, ORDINANCES AND REQUIREMENTS, ACCESSIBILITY PER A.D.A.A.

USE SCENARIOS

1. HOCKEY / HOCKEY

PRIMARY ICE RINK:	330
PRIMARY RINK PERIM:	689
PRIMARY SEATING:	820
MEZZANINE:	477
SECONDARY SEATING:	356
SECONDARY ICE RINK:	330
SECONDARY RINK PERIM:	764
TOTAL:	3766

2. TRADE SHOW / HOCKEY

PRIMARY FLOOR:(15 SF/P)	1419
PRIMARY SEATING:(CLOSED)	0
MEZZANINE:	477
SECONDARY SEATING:	356
SECONDARY RINK:	330
SECONDARY RINK PERIM:	689
TOTAL:	3371

3. PERFORMANCE / CLOSED

PRIMARY FLOOR:(7 SF/P)	3040
SEATING:	820
MEZZANINE:	477
SECONDARY SEATING:(CLOSED)	0
SECONDARY RINK:(CLOSED)	0
SECONDARY RINK PERIM:(CLOSED)	0
TOTAL	4337

COPYRIGHT 2013
REUSE OR REPRODUCTION OF THE CONTENTS OF THIS DOCUMENT IS NOT PERMITTED WITHOUT WRITTEN PERMISSION OF FORESIDE ARCHITECTS

GENERAL NOTES:

REVISIONS:

FORESIDE ARCHITECTS LLC
5 FUNDY ROAD
FALMOUTH, ME 04105
Phone: 207-781-3344
Fax: 207-699-5564
Online @ foresidearchitects.com

Project Status:
OWNER SUBMISSION

Project Number:
FAC0912

PRELIMINARY PLANS
Not for Construction

Auburn Ice Arena
Turner Street
Auburn, Maine

Drawing Name:
First Floor Code Plan

Scale:
1/16"=1'-0"

Date:
03/14/13

SHEET
A0.1