

ADDENDUM NO. 1

TO

CITY OF AUBURN, MAINE

111 Pleasant St. Lead Abatement Bid #2025-010

DATE: 9/27/2024

*This addendum amends and /or supplements the bid documents as indicated below. Only these items alter the bid documents. Any verbal discussions or responses are hereby declared null and void. **Please acknowledge this addendum on the Bid Proposal Form.***

Please see Page 2 for the start of Addendum



City of Auburn, Maine

60 Court Street | Auburn, Maine 04210

www.auburnmaine.gov | 207.333.6601

Pre-Bid Conference Notes for Addenda

Bid #:	2025-010 Lead Abatement 111 Pleasant St.
Date:	9/24/2024

Questions/Notes for Addenda

Apartment #2 & RCA (Rear Common Area)

Porch #1:

- Windows at location A1, A1, D1-D6: Work was added to make this 2nd floor area safer with the addition of plexiglass enclosure of glass and installation of guard rail around the area.

Porch #1	Window Jamb & Trough	A1, A2, D1-D4	STB – Paint <i>(6 locations)</i>
	Window Case & Sill	B1	SPP – Encapsulate: Case STB – Paint: Sill
	Window Sash	D3-D6	Remove (Red Inner) <i>(3 locations)</i>
	Windows	A1, A2, D1-D6	Enclose with Plexi Glass & Install Guard Rail to Code

RCA (Rear Common Area):

- Floor at location 1st Floor: Abatement method changed from Enclosure to STB-Paint.

RCA	Walls & Ceiling	1st Floor A1/D2 Entry	Enclosure
	Wall Boards	C1 – C & D (Gray Boards)	SPP - Encapsulate
	Floor	1st Floor Entry	STB - Paint
	Floor	2nd Floor	Enclosure
	Window Sash	D1	Remove & Enclose
	Door, Casing, Jamb, & Threshold	D2	Remove & Replace: Door, Jamb, & Threshold (FD) SPP – Encapsulate: Casing

Lead Design Specifications



Location:

111 Pleasant Street, Apt. 1
Auburn, Maine 04210

Owner Information:

Name: Ting Ting Lin
Address: 111 Pleasant Street
Auburn, ME 04210

Design date:

07-08-2024 REVISED: 09-24-2024

Prepared by:

Stephanie L Martin, LD-0345 Expires 01/03/2025
Clarity Property Services, LLC
Email: leadinspections@outlook.com

Contractor Information:

Name: _____

Address: _____

Phone Number: _____

After careful review of the following, the applicant(s) and contractor, understand and accept the work described herein. Only the work described herein will be performed. ANY and ALL changes to these design specifications must be by written change order and agreed to by all parties following program requirements. **All recommendations are valid for one (1) year and can only be amended or changed by performing a new risk assessment.**

X _____
Contractor **Date**

X _____
Owner **Date**

X _____
Owner **Date**

CONTRACT PRICE: _____

REHABILITATION STANDARDS AND SPECIFICATIONS

SECTION 1 –

GENERAL REQUIREMENT FOR ALL PROJECT SPECIFICATIONS

1. All work performed shall conform to the General Standards herein, DEP Lead Management Regulations (Chapter 424), HUD requirements for Notification, Evaluation, and “Reduction of Lead-Based Paint Hazards in Federally Owned Residential Property and Housing receiving Federal assistance” (24 CFR Part 35), EPA Renovation, Repair and Painting Rule, manufactures recommendations, and all applicable Local and State building codes, laws and regulations. **If no local building code exists, the MUBEC will apply.**
2. Scrape inspections are required for removal of paint from components (abatement or interim control). Scrape inspections are required for both interior and exterior work prior to the priming and or painting process. If a scrape inspection has not been performed, the Contractor will be required to remove any paint to ensure compliance with this section.
3. Any and all Maine DEP project variances must also be approved in writing by the Lead Designer and **The Auburn Lead Program** prior to implementation. **NOTE: Monetary change orders may be required by The City of Auburn.**
4. All measurements are approximate and must be verified by the Contractor. No claim for additional funds due to discrepancies in measurements or quantities shall not be honored.
5. All Materials having color or pattern shall be selected by the owner from standard color/style chart. All colors, styles, and types of materials will be listed in the job specifications prior to contract signing.
6. All installed windows and exterior doors will be Energy Star rated for the Northeast. All windows will have a U-Value of .27 or less. Windows will have full screens. Egress casement windows will have a factory installed horizontal mullion to give the appearance of a double hung window. **NOTE: Single hung windows will require half screens.**
7. All exterior doors installed will be keyed alike (per unit), and include adjustable thresholds and half glass unless otherwise noted in design specifications. Exterior doors will meet Energy Star requirements for the Northeast.
8. Building permits, electrical permits, plumbing permits and other permits required by local or State authorities shall be obtained by the contractor and the costs shall be incorporated into the proposal amount submitted by contractor. Contractor must obtain permits prior to commencement of work and must provide copies of permits to the Owner and **The City of Auburn** for documentation. Failure to obtain required permits will result in nonpayment of work until the necessary permits are obtained.
9. Workmanship and materials not covered by manufacturer’s warranty shall be warranted by the Contractors for a period of at least one year from date of final payment to the contractor. All manufacturer warranties shall be delivered by the Contractor, to the homeowner along with the final billing. Manufacturer’s installation instructions, as required by the 2009 ICC Code shall be available on the job site at the time of inspection.
10. Product information/labeling showing compliance, where required, with Energy Star Ratings shall be provided to the home owner and **The City of Auburn** prior to installation.
11. All Interim Control work must be performed in accordance with both EPA RRP and HUD Lead-Based Paint regulations as described in 24 CFR Part 35 et al, with the exception that certain contractors such as electrical, plumbing, roofing, weatherization and heating specialists may be exempt from using HUD lead safe practices so long as they do not disturb any more than two square feet of painted surfaces per room or a total of 20 square feet of painted surfaces on the exterior. Contractors performing work in accordance with HUD Lead-Based Paint regulations as described in 24 CFR Part 35 et al must have attended an EPA RRP course taught by a Maine DEP certified training provider. Lead safe practices must be employed in all work that disturbs painted surfaces. After completion of all work, contractor must clean the work area(s) to meet Maine DEP Chapter 424 Lead Dust / Soil clearance standards as follows;

- Hard floors and Carpeted floors = 10 micrograms (ug) per square foot (ft²)
- Interior Window Sills = 100 micrograms (ug) per square foot (ft²)
- Window Troughs = 100 ug/ micrograms (ug) per square foot (ft²)
- Exterior Porch = 40 micrograms (ug) per square foot (ft²)
- Other nonporous surfaces = 10 micrograms (ug) per square foot (ft²)
- Five (5) foot radius outside of contained area(s) = 10 micrograms (ug) per square foot (ft²)
- Non-play Area Soil = 900 parts per million (ppm)
- Play Area Soil = 100 parts per million (ppm)

If dust wipe and/or soil samples do not pass the above standards, contractor must return to the job site, at his own expense, and clean until these standards are met. Final payment will be withheld until clearance standards are achieved. Costs incurred for an additional site visit and dust swipe sampling costs will be taken from monies due to the contractor. In homes where there are children under 6 years of age the Owners must, at their own expense, temporarily relocate these children from work areas where paint will be disturbed until the work has been completed and the dust wipe clearance standards shown above have been achieved.

12. The contractor must inspect the property and attend a pre-bid walkthrough. Submission of a bid is presumptive evidence that the bidder has thoroughly examined the site during a pre-bid walk through and is conversant with the requirements of the local jurisdiction.
13. All materials used in conjunction with this work write-up are to be new, of first quality and without defects – unless stated otherwise or pre-approved by owner and Design Consultant in writing.
14. Contractors shall not perform any work, substitute any specified materials, colors, patterns, quantities, or change specified material qualities or quantities not listed in the job specifications without a written change order pre-approved by **The City of Auburn**, owner and Lead Design Consultant.
15. All materials shall be installed in full accordance with the manufactures specifications and industry standards for working conditions, surface preparation, methods, testing, and protection.
16. All repaired or newly installed exterior non-pressure treated wood must be sealed, stained or otherwise protected from the elements following industry standards.
17. Walls and attached components shall be identified with the letters A, B, C, D etc. Wall A is always the wall that is closest to the address elevation or “street side” of the house. Moving clockwise, the walls are then B, C, D, etc.
18. Down payment or deposits to contractors are not authorized. No work/materials will be paid for in advance.
19. Detailed invoices submitted to the **City of Auburn** shall accompany each payment request.
20. The use of the “Booth” or “Mini-Containment” system(s) will be determined by the Lead Design Consultant. Determination shall be in writing.
21. Any and all changes in the Lead Design agreed to during the Pre-bid Walkthrough will be made in writing in the form of a bid amendment. This form will become part of the contractor’s bid proposal and will be submitted with contractors bid.
22. **Placement of the decontamination unit shall be determined and established via writing as an addendum to the design plan specifications prior to the commencement of any lead abatement activities.**

SECTION 2 - DEFINITIONS

- 1 Abatement. “Abatement” means any measure or set of measures designed to permanently eliminate lead hazards. For the purpose of this definition, “permanently means for at least 20 years.
- 2 Impact Surface. “Impact surface” means a surface that is subject to damage by repeated sudden force, such as certain parts of door frames.

- 3 Interim control. "Interim control means a set of non-abatement measures designed to temporarily reduce human exposure or likely exposure to lead hazards, including specialized cleaning, repairs, maintenance, painting, temporary containment, ongoing monitoring of potential lead hazards and the establishment and operation of management and resident education programs. NOTE: When interim control measures (covering a surface with a coating or other treatment) are used, friction points or friction surfaces must be treated so that paint is not subject to abrasion. Examples of acceptable treatments include re-hanging and or planning doors so that the door does not rub against the door frame, removing paint from the friction/impact part of a door jamb (frame) and covering of bare soils.
- 4 Install. "Install" means to purchase, set up, test, and warrant a new component. "Replace" means to remove and dispose of original material, purchase new material, deliver, install, test, and warrant.
- 5 Paint. "Paint means any substance applied to a surface as a coating, including, but not limited to household paints, varnishes, and stains.
- 6 Repair. "Repair" means to return a building component to like new condition through replacement, adjustment, and recoating of parts.
- 7 Reinstall. "Reinstall means to remove, clean, store, and install a component.
- 8 Substrate. "Substrate" means the material underneath the paint such as brick, concrete, drywall, metal, plaster or wood.
- 9 Work Area. "Work area" means an interior or exterior area where lead abatement or interim control activities are to take place. There may be more than one work area in a residential dwelling or child care facility.
- 10 Window & Door Units. Window/door components are defined as follows:
 - a. Window sash (includes mullions)
 - b. Window casing (includes header and apron)
 - c. Window sill
 - d. Window jamb (includes parting bead and stops)
 - e. Window well (also called trough)
 - f. Door (includes stiles, panels and edge)
 - g. Door jamb (includes frame and stops)
 - h. Door casing (includes header)
 - i. Door threshold

SECTION 3 –SCOPE OF WORK

The scope of work shall consist of complete paint removal, encapsulation, enclosure, and/or whole component removal of lead-based paint hazards as identified in the lead based-paint inspection report.

1. **Owner Responsibilities:**

- A. Owner shall remove all personal belongings from the house/work area.
- B. Owner shall shut off gas to the stove, (if applicable).
- C. Owner shall provide keys to the Contractor for access to the home.
- D. Owner shall pre-determine colors and flooring selections in writing. This shall be performed prior to the start date.
- E. Owner shall supply electricity, water and heat to the abatement contractor for the duration of the project.
- F. Owner shall remove and keep clear, all debris from the exterior at least 10 feet from the building perimeter if exterior work is performed.

2. Contractor Responsibilities:

- A. Contractor shall confirm that all furniture and personal belongings have to be removed from the house/work area prior to the start of the project.
- B. Contractor shall coordinate access to the home for any visual inspections and clearance sample testing to be performed.
- C. Contractor shall be responsible for completing all work specified in the Design Plan including any and all revisions made to the design for the purpose of the project within contract dates specified. **This specifically includes the placement of the decontamination unit.**
- D. Contractor shall perform an ASTM approved tape method before applying any encapsulating paint to a building component to ensure proper adhesion to the substrate.
- E. Contractor shall store debris in a secure area until final disposal. Dispose of in accordance with the Mine Department of Environmental Protection’s Lead Management Regulations.
- F. Contractor shall be financially responsible for all associated sampling costs such as administrator labor, travel, postage, and laboratory analysis of the dust samples if interim or final clearance samples fail.
- G. Contractor shall repair or replace any building components damaged during the project to match existing building components.
- H. All product warranty information must be given to the **City of Auburn** and the home owner prior to final payment of project. Product labels (stickers) showing Energy Star Compliance will remain in place until inspected and approved by Lead Design Consultant.
- I. A written notification plan will be developed by the Contractor and provided to the owner/tenant, the Administrator and the **City of Auburn**.
- J. Contractor shall provide a final abatement report to the **City of Auburn**, Administrator, and the homeowner within 30 days after project completion in accordance with DEP Chapter 424, Section 6.G.
- K. The use of a “Booth” or “Mini-Containment” system will be determined by the Lead Design Consultant and shall be in writing.

SECTION 4 – NOTIFICATIONS

1. Notification:

The abatement contractor shall notify the Maine Department of Environmental Protection, the Administrator and the **City of Auburn** at least five (5) working days prior to the start of any lead abatement activity, including set-up or on-site preparation activities. Delivery of notice by U.S. Postal Service, commercial delivery service, hand delivery, facsimile or email are acceptable methods. The **City of Auburn** also requires notification of Interim Control /LSR work performed on site.

***NOTE:** A weekly updated schedule for each lead abatement project by dwelling unit, if applicable, shall be faxed/emailed each Monday morning to **ALL** above listed parties until the project is complete. In the event of a scheduled work day/hours are changed after the weekly notification, the contractor must notify the DEP, Administrator and **The City of Auburn** by email or phone no later than 8 A.M on the day of the scheduled change.*

2. Tenant Notification:


The abatement contractor shall notify the tenants of the pending abatement activity. This notification (Occupant Protection Plan) shall include the scheduled dates for abatement, work hours, identification of work areas, and information on any alternative entrance or exit to be used during the course of the abatement activities. This notification shall be in writing and delivered at least five (5) days prior to the start of the project.

APT. 1 & FCA *NO BOOTHS*

Room # And Name	Building Component	Location	Abatement Method	Labor	Materials	Total
Bathroom #1	Door Jamb	A1, A2	STB – Paint <i>(2 locations)</i>			
Entry #2	Baseboard	All	SPP - Encapsulate			
	Door Casing	D3	SPP – Encapsulate			
	Door Jamb & Casing	A1	STB - Paint: Jamb SPP – Encapsulate: Casing			
	Door & Jamb	D1, D2	Remove & Replace: <i>Door (slab)</i> STB – Paint: Jamb <i>(2 locations)</i>			
Bedroom #3	Window Stop	B1, B3	SPP - Encapsulate <i>(2 locations)</i>			
Living Room #4	Door Jamb & Casing	C1	STB - Paint: Jamb SPP – Encapsulate: Casing			
	Door Casing	D1	SPP - Encapsulate			
	Window Sill	A1-A3	STB – Paint <i>(3 locations)</i>			
	Window Case & Sill	B1	SPP – Encapsulate: Case STB – Paint: Sill			
	Baseboard	C, D	SPP - Encapsulate			
Kitchen #5	Window Stop	A1, D1	SPP – Encapsulate <i>(2 locations)</i>			
	Door Casing	B1, C1	SPP – Encapsulate <i>(2 locations)</i>			
FCA Entry	Transom Window Sash	A1	SPP - Encapsulate			
	Window Case & Sill	B1	SPP – Encapsulate: Case STB – Paint: Sill			
FCA	Baseboard	All	SPP - Encapsulate			
	Door Casing	B1	SPP - Encapsulate			
	Door, Jamb, & Casing	A1, C1	Remove & Replace: <i>Door/Jamb (FD)</i> SPP – Encapsulate: Casing <i>(2 locations)</i>			


***See Appendix A to find procedures for recommended abatement methods.**

Interior Property Drawing – First Floor 111 Pleasant Street, Apt. 1, Auburn, ME

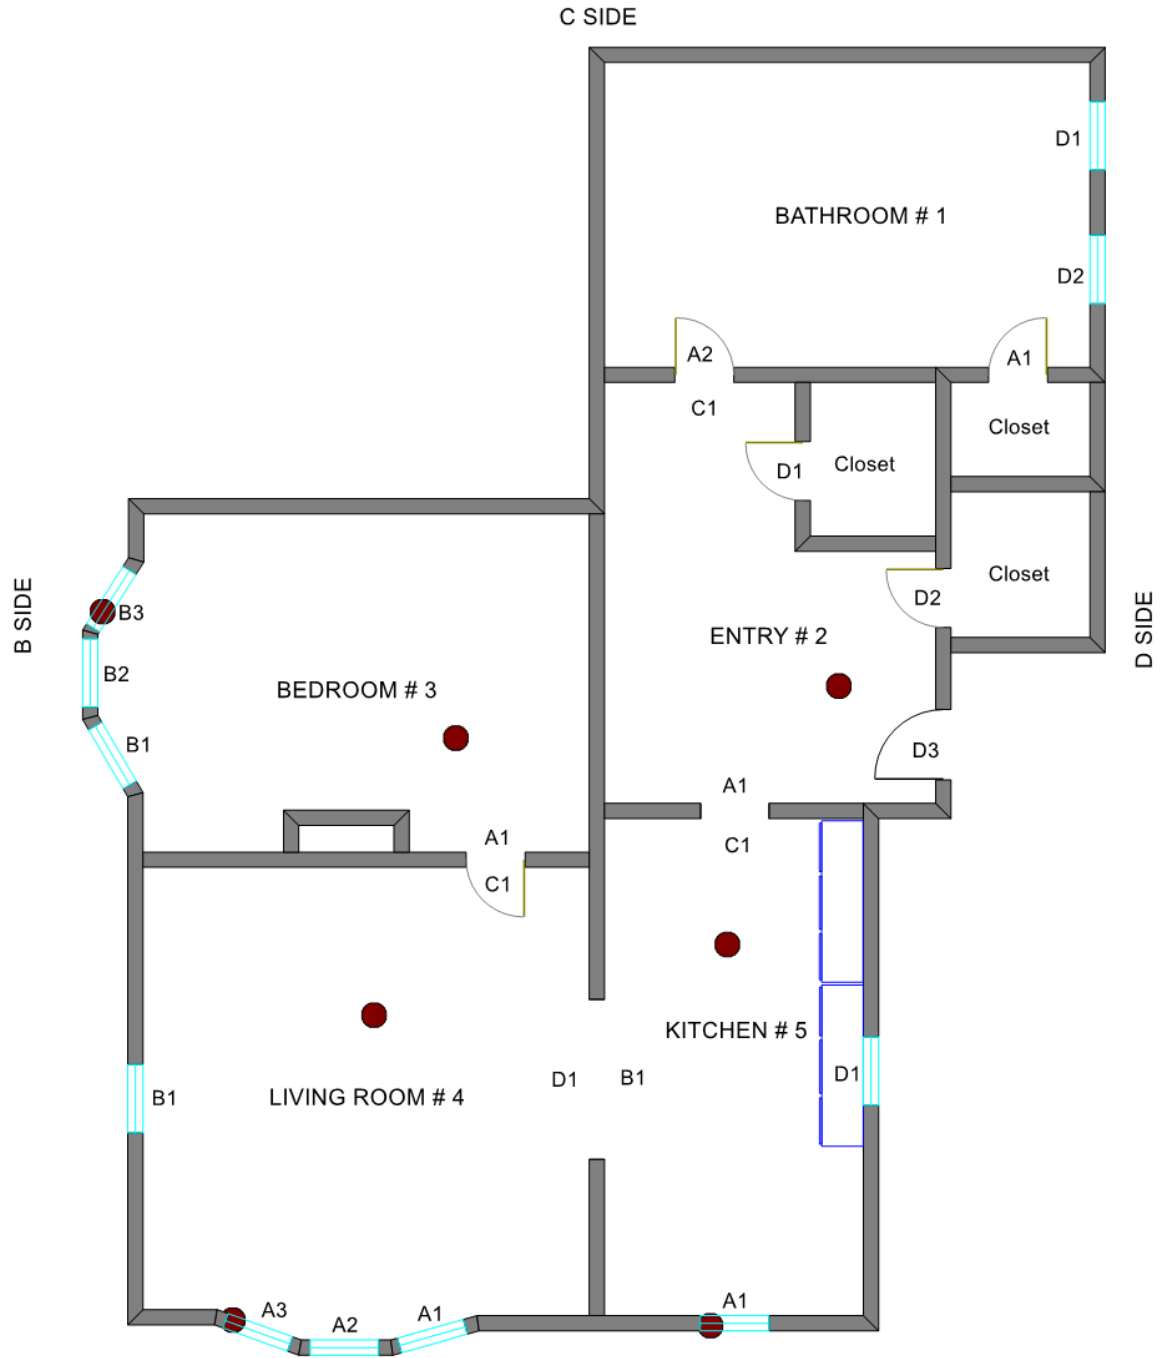

A SIDE / PLEASANT STREET
APT. 1 / INTERIOR LAYOUT / FIRST FLOOR
NOT DRAWN TO SCALE
● = Dust Sample Location

***Interior Property Drawing – Front Common Area (FCA)
111 Pleasant Street, Auburn, ME***

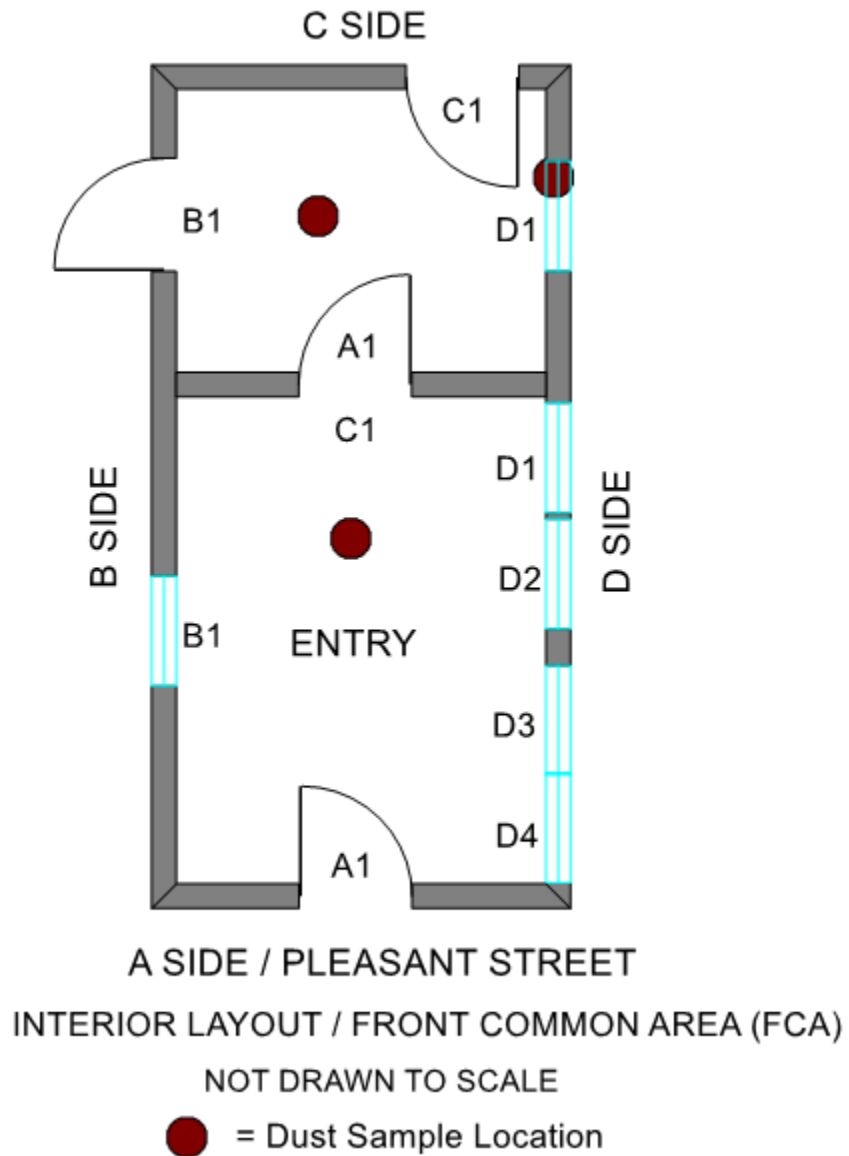

Lead Design Specifications



Location:

111 Pleasant Street, Apt. 2
Auburn, Maine 04210

Owner Information:

Name: Ting Ting Lin
Address: 111 Pleasant Street
Auburn, ME 04210

Design date:

07-08-2024 REVISED: 09-24-2024

Prepared by:

Stephanie L Martin, LD-0345 Expires 01/03/2025
Clarity Property Services, LLC
Email: leadinspections@outlook.com

Contractor Information:

Name: _____

Address: _____

Phone Number: _____

After careful review of the following, the applicant(s) and contractor, understand and accept the work described herein. Only the work described herein will be performed. ANY and ALL changes to these design specifications must be by written change order and agreed to by all parties following program requirements. **All recommendations are valid for one (1) year and can only be amended or changed by performing a new risk assessment.**

X _____
Contractor **Date**

X _____
Owner **Date**

X _____
Owner **Date**

CONTRACT PRICE: _____


APT. 2 & RCA & Exterior *NO BOOTHS*

Room # And Name	Building Component	Location	Abatement Method	Labor	Materials	Total
Porch #1	Window Jamb & Trough	A1, A2, D1-D4	STB – Paint <i>(6 locations)</i>			
	Window Case & Sill	B1	SPP – Encapsulate: Case STB – Paint: Sill			
	Window Sash	D3-D6	Remove (Red Inner) <i>(3 locations)</i>			
	Windows	A1, A2, D1-D6	Enclose with Plexi Glass & Install Guard Rail to Code			
	Threshold	B2	STB - Paint			
Bedroom #2	Baseboard	B, C, D	SPP - Encapsulate			
	Door, Jamb, Inner Casing, & Closet Baseboards	C1	Remove & Replace: Door (<i>slab</i>) STB – Paint: Jamb SPP – Encapsulate: Inner Casing & Baseboards			
Living Room #4	Built-In Door & Shelves	A	STB – Paint F/I areas & SPP - Encapsulate			
	Door Jamb	A2, C2	STB – Paint <i>(2 locations)</i>			
	Door Casing	A3	SPP - Encapsulate			
	Door, Jamb, Inner Casing, & Closet Bench	D3	Remove & Replace: Door (<i>slab</i>) STB – Paint: Jamb SPP – Encapsulate: Inner Casing & Bench			
	Door & Jamb	D5	Remove & Replace: Door (<i>slab</i>) STB – Paint: Jamb			
	Door Jamb & Closet Baseboards	D1	STB – Paint: Jamb SPP – Encapsulate: Baseboards			
	Window Sill	D4	STB - Paint			
Bathroom #5	Door Jamb	A2	STB - Paint			
	Door Casing, Jamb, Closet Baseboards & Shelves (Left & Right)	A1	SPP – Encapsulate: Casing & Baseboards STB – Paint: Jamb Remove & Replace: Shelves			

Kitchen #6	Door Jamb	D1	STB - Paint			
Bedroom #7	Closet Baseboard	C1 – All	SPP - Encapsulate			
	Door Casing & Jamb	D1	SPP – Encapsulate: Casing STB – Paint: Jamb			
Hallway #8	Door Jamb	B1	STB - Paint			
RCA	Walls & Ceiling	1st Floor A1/D2 Entry	Enclosure			
	Wall Boards	C1 – C & D (Gray Boards)	SPP - Encapsulate			
	Floor	1st Floor Entry	STB - Paint			
	Floor	2nd Floor	Enclosure			
	Window Sash	D1	Remove & Enclose			
	Door, Casing, Jamb, & Threshold	D2	Remove & Replace: Door, Jamb, & Threshold (FD) SPP – Encapsulate: Casing			
Exterior	Window Sash	D7, D17	SPP – Encapsulate <i>(2 locations)</i>			

***See Appendix A to find procedures for recommended abatement methods.**


Interior Property Drawing – Second Floor 111 Pleasant Street, Apt. 2, Auburn, ME

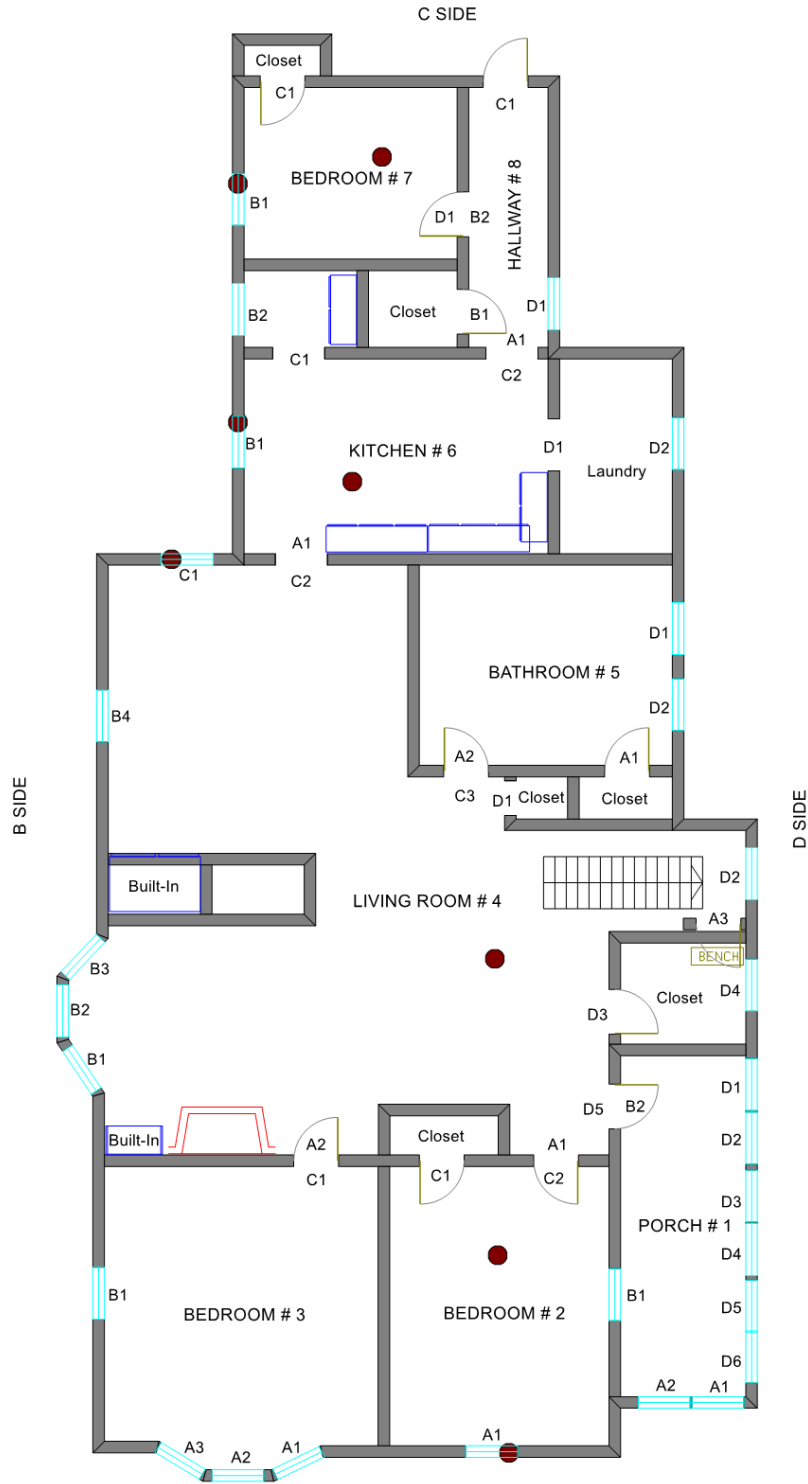

A SIDE / PLEASANT STREET
APT. 2 / INTERIOR LAYOUT / SECOND FLOOR

NOT DRAWN TO SCALE
● = Dust Sample Location


***Interior Property Drawing – Rear Common Area (RCA)
111 Pleasant Street, Auburn, ME***

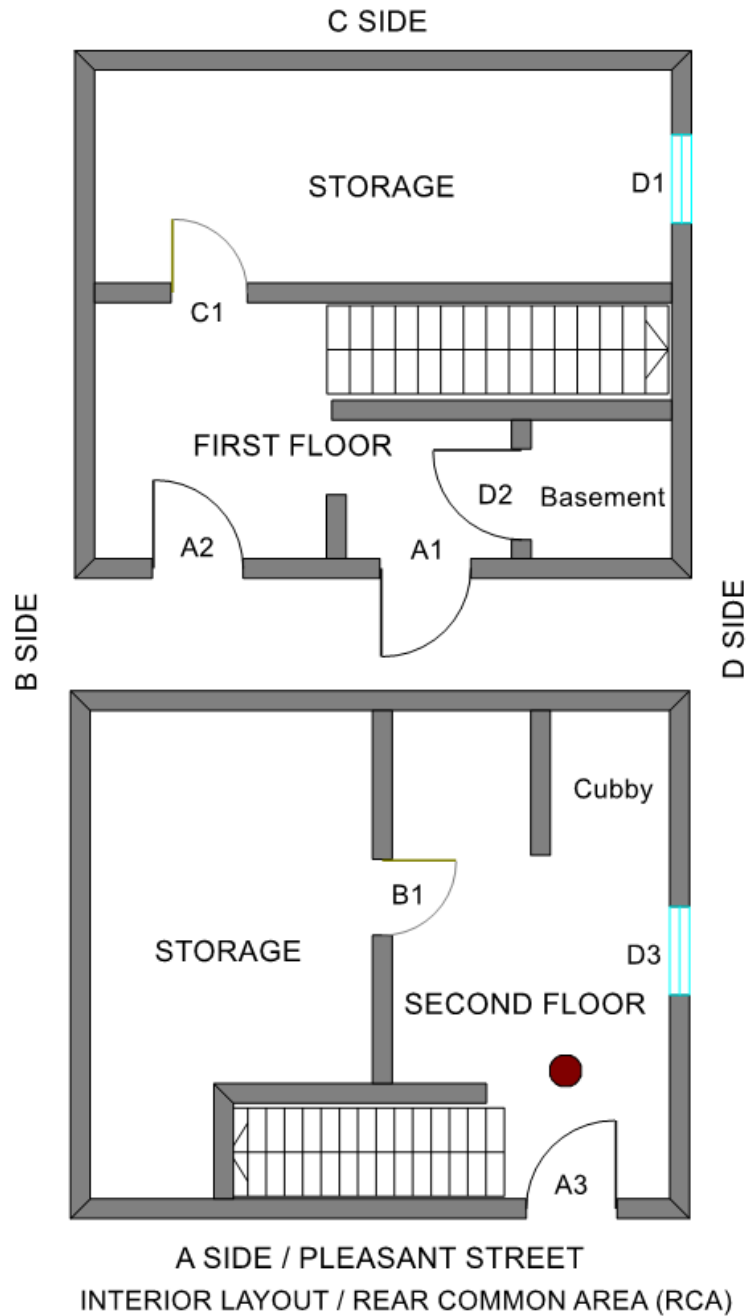

NOT DRAWN TO SCALE

● = Dust Sample Location

Exterior Property Drawing – 111 Pleasant Street, Auburn, ME

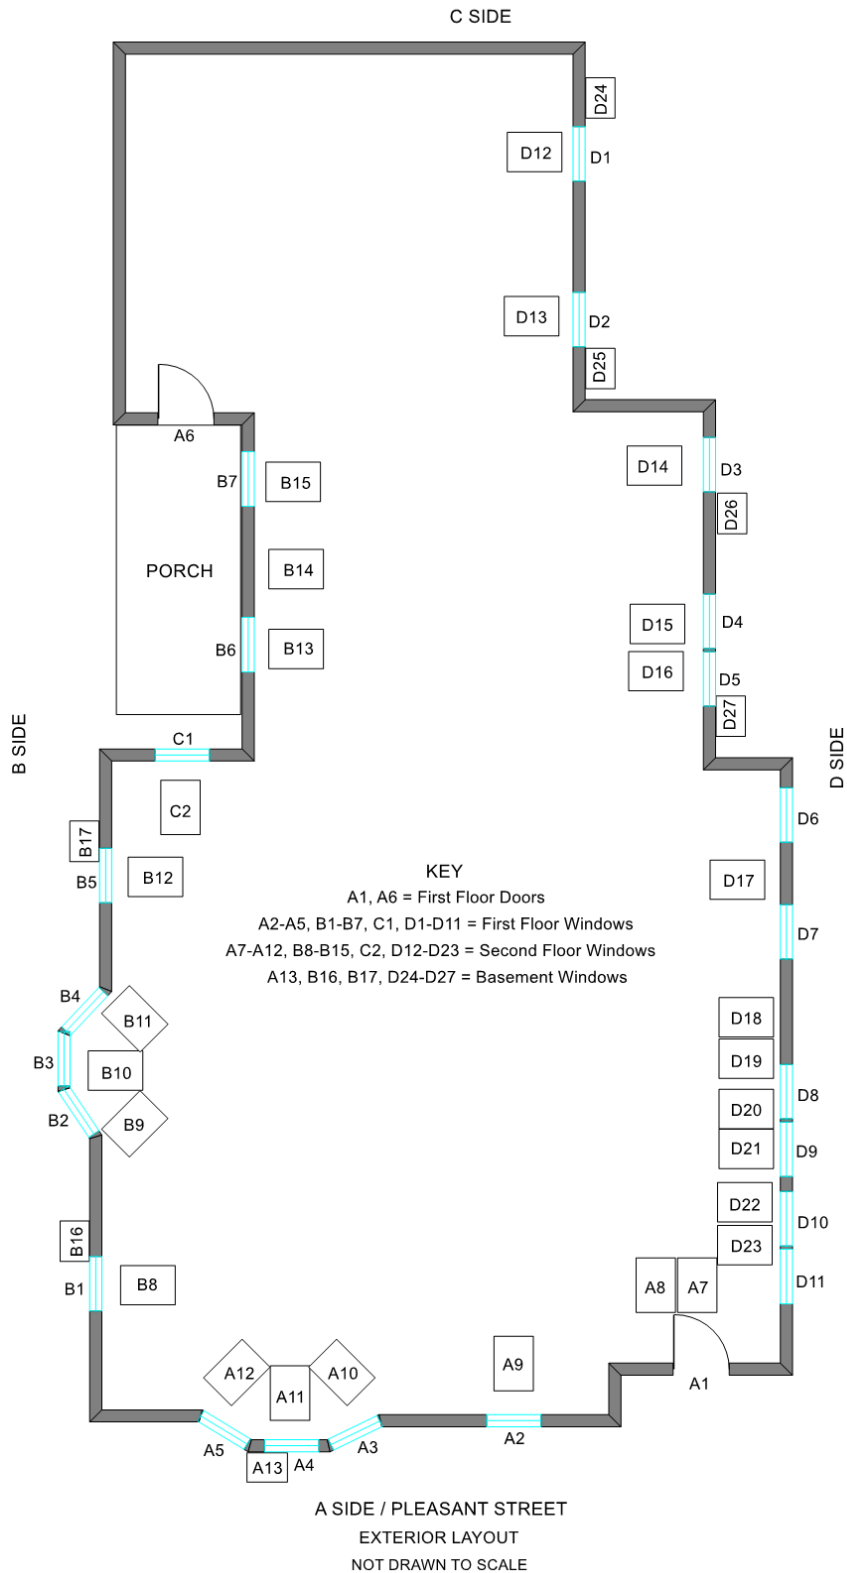

Lead Design Specifications



Location:

111 Pleasant Street, Apt. 3
Auburn, Maine 04210

Owner Information:

Name: Ting Ting Lin
Address: 111 Pleasant Street
Auburn, ME 04210

Design date:

07-08-2024 REVISED: 09-24-2024

Prepared by:

Stephanie L Martin, LD-0345 Expires 01/03/2025
Clarity Property Services, LLC
Email: leadinspections@outlook.com

Contractor Information:

Name: _____

Address: _____

Phone Number: _____

After careful review of the following, the applicant(s) and contractor, understand and accept the work described herein. Only the work described herein will be performed. ANY and ALL changes to these design specifications must be by written change order and agreed to by all parties following program requirements. **All recommendations are valid for one (1) year and can only be amended or changed by performing a new risk assessment.**

X _____
Contractor **Date**

X _____
Owner **Date**

X _____
Owner **Date**


CONTRACT PRICE: _____

APT. 3

Room # And Name	Building Component	Location	Abatement Method	Labor	Materials	Total
Storage #3	Door Casing	C1	SPP - Encapsulate			
	Window Trough (Dust)	All	IC - Clean			
Kitchen #4	Door Jamb	C2	STB - Paint			

***See Appendix A to find procedures for recommended abatement methods.**

Interior Property Drawing – First Floor 111 Pleasant Street, Apt. 3, Auburn, ME

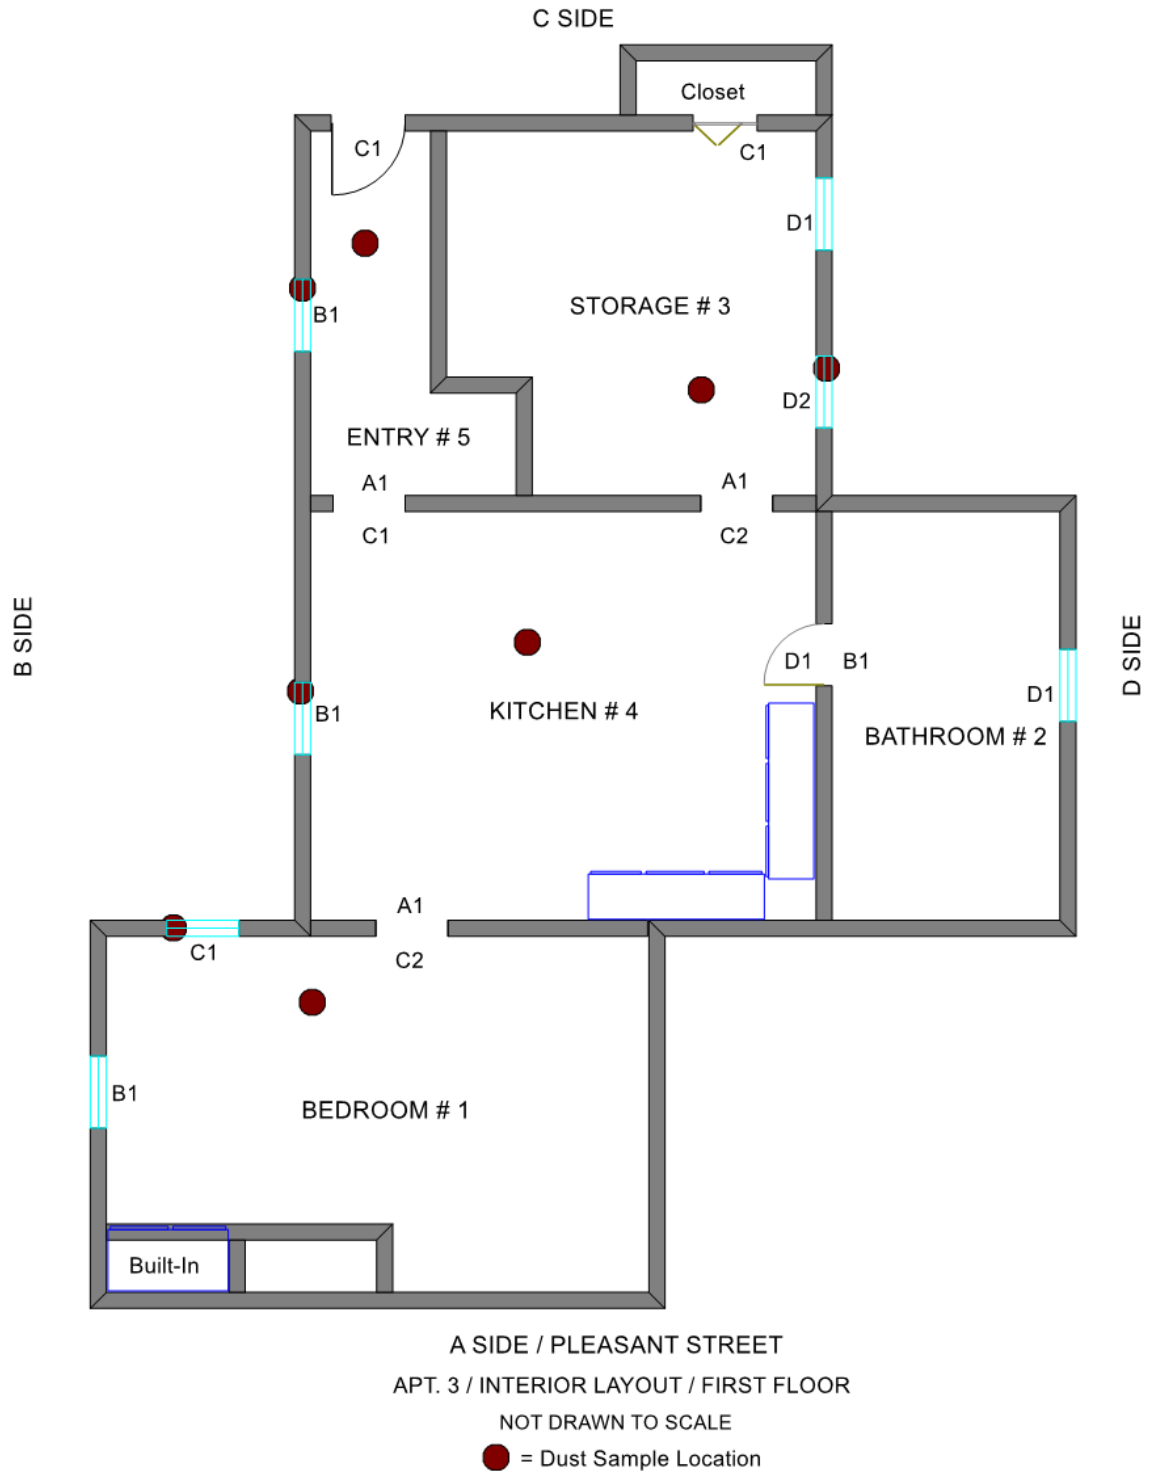

Appendix A: Abatement Methods

Window Components:

- **Remove and Enclose:** Remove and dispose existing window, including storm window. Prepare surface by removing obstructions and repair damage for attaching the new enclosure. Sheetrock Mud/Tape (minimum 3/8" thickness) shall be installed with mechanical fasteners to cover the Lead Paint Hazard. Seams shall be mud and taped three (3) coats. Install Lead Free baseboard and trim as needed to complete. Primed and painted two (2) finish coats.
- **Encapsulation (SPP):** *Remove All "Loose and Flaking" paint, (including All Edges)* using safe paint removal methods. *Repair damaged sections if necessary* and feather smooth any rough paint edges. **All Component IMPACT SURFACES MUST BE SCRAPED TO BARE WOOD** at the impact location and a minimum of 2" from the impact edges. Feather smooth the paint transition. HEPA clean and wet wash the component. **A Paint Scrape Inspection** by the Program Construction Manager is required. Prime entire surface and Paint 2 coats finish. Paint shall contain LBC (Lead Barrier Compound) and meet Maine DEP standards for encapsulation. Color to match existing, *or* be agreed upon by owner and noted on the design. Provide the owner with remaining encapsulant paint (1/2-gallon min.) at the end of the project.
- **Paint Removal (STB):** *Remove Paint to bare substrate* on **ALL SIDES** of the component, using lead safe paint removal methods. *Repair damaged sections if necessary.* HEPA clean and wet wash the component. **A Paint Scrape Inspection** by the Program Construction Manager is required. Prime entire surface and Paint 2 coats finish. Color to match existing, *or* be agreed upon by owner and noted on the design. Provide the property owner with remaining paint (minimum 1/2 gallon) at the end of the project. Subject to ME DEP Paint Removal Guidelines (Chapter 424 Section 6.C.2). **Paint Scrape Inspections** to verify coating removal and surface preparation before applying the prime and paint/ encapsulation layers **are required for these methods**, documented with photo(s).

Door Components:

- **Encapsulation (SPP):** *Remove All "Loose and Flaking" paint, (including All Edges)* using lead safe paint removal methods. *Repair damaged sections if necessary* and feather smooth any rough paint edges. **All Component IMPACT SURFACES MUST BE SCRAPED TO BARE WOOD**, at the impact location and a minimum of 2" from the impact edges. Feather smooth the paint transition. HEPA clean and wet wash the component. A Paint Scrape Inspection by the Program Construction Manager is required. Prime entire surface and Paint 2 coats finish. Paint shall contain LBC (Lead Barrier Compound) and meet Maine DEP standards for encapsulation. Color to match existing, *or* be agreed upon by owner and noted on the design. Provide the owner with remaining encapsulant paint (1/2-gallon min.) at the end of the project.
- **Remove and Replace (Interior):** Remove and dispose existing door (including hardware, door jamb, and possibly casing) Door & Jamb: Install a new 6 panel solid pine door, approved equal pre-hung door, or door with custom jamb. Installation to include proper passageway or privacy lock/latch set and standard 3 hinge configuration. Install door following standard

practice. Install non-lead door casing to match existing. New trim components to be caulked, primed and painted to match existing, *or* color agreed upon by owner. *No jamb or trim components shall be left unfinished.* Subject to ME DEP Component Removal Method (Chapter 424 Section 6.C.5)

- **Door Slab:** Install a new 6 panel solid pine door slab or an approved equal. Installation to include proper passageway or privacy lock/latch set and standard 3 hinge configuration. Install door following standard practice. *Install* non-lead door casing to match existing. New trim components to be caulked, primed and painted to match existing, *or* color agreed upon by owner in writing. *No jamb or trim components shall be left unfinished.* Subject to Maine DEP Component Removal Method (Chapter 424 Section 6.C.5).
- **Remove and Replace (Exterior and Unit Entry):** Remove and dispose existing door (including hardware, door jamb, and possibly casing). Newly installed unit entry locksets/dead bolts will be keyed alike in each separate unit. *(Special locksets may be required by the owner at their own expense).* Existing door closer(s) *will not be disposed of unless identified as a Lead Hazard.* Door closers to be addressed by a method agreed to by the owner in the design specifications.
 - **Fire-Rated Doors (Common Areas):** Unit Entry doors or Storage Entry doors require a 20-minute fire rated door at minimum or a 90-minute fire rated door. (Other fire door options may be allowed for custom door configurations.) Door must have factory labeled fire rating. Installation to include ANSI Grade 2 lockset or better. *Fire-Rated doors require closers or self-closing hinges. Doors into a private unit require lockset with deadbolt properly installed. (Configuration to match existing if owner chooses to re-use existing locksets).* Install per manufacturer instructions, including caulking. Insulate door cavity using spray foam insulation. (MUBEC requires gaps are sealed). Install non-lead door casing to match existing. New trim components to be caulked, primed and painted to match existing, *or* color agreed upon by owner in writing. *No trim components shall be left unfinished.* Subject to Maine DEP Component Removal Method (Chapter 424 Section 6.C.5).
- **Paint Removal (STB):** *Remove Paint to bare substrate* on **ALL SIDES** of the component, using lead safe paint removal methods. *Repair damaged sections if necessary.* HEPA clean and wet wash the component. A Paint Scrape Inspection by the Program Construction Manager is required. Prime entire surface and Paint two (2) coats finish. Color to match existing, **or** be agreed upon by owner in writing and noted on the design. Provide the property owner with remaining paint (minimum 1/2 gallon) at the end of the project. Subject to Maine DEP Paint Removal Guidelines (Chapter 424 Section 6.C.2)

Floors:

- **Enclosure:** Prepare surface by removing any obstructions and repair damage for attaching the new enclosure. New Floor shall be installed starting with 1/4" Luan underlayment or approved equal and floor leveler to fill all seams and fastener holes to prevent dust migration and prepare the surface. Floating floor panels or **VCT** Tiles to be installed per manufacturers' recommendations for finished floor. Materials and colors to be agreed upon by owner in writing and noted on the design specifications. Subject to Maine DEP Enclosure Method (Chapter 424 Section 6.C.4)

Walls & Ceiling:

- **Enclosure:** Prepare surface by removing obstructions and repair damage for attaching the new enclosure. Sheetrock Mud/Tape (minimum 3/8" thickness) shall be installed with mechanical fasteners to cover the Lead Paint Hazard. Seams shall be mud and taped three (3) coats. Install Lead Free baseboard and trim as needed to complete. Primed and painted two (2) finish coats. Materials and colors to be agreed upon by owner in writing and noted on the design specifications. **Electrical Fixtures** in good condition shall be loosened (as necessary) and re-secured through the enclosure material installed. **Fixture replacement shall be the owner's responsibility.** Subject to Maine DEP Enclosure Method (Chapter 424 Section 6.C.4)

Miscellaneous Components:

- **Remove and Replace:** Remove and dispose existing components. (Trim, Stair Treads, Thresholds, Shelving, etc.) Install new components to matching existing style using clear pine or equivalent material. Caulk gaps and fill fastener holes. **To be finished with two (2) coats stain or primed and painted two (2) finish coats.** Subject to Maine DEP Component Removal Method (Chapter 424 Section 6.C.5)

Baseboards:

- **Encapsulation (SPP):** *Remove All "Loose and Flaking" paint, (including All Edges)* using lead safe paint removal methods. *Repair damaged sections if necessary* and feather smooth any rough paint edges. **All Component IMPACT SURFACES MUST BE SCRAPED TO BARE WOOD** at the impact location and a minimum of 2" from the impact edges. Feather smooth the paint transition. HEPA clean and wet wash the component. **A Paint Scrape Inspection** by the Program Construction Manager is required. Prime entire surface and Paint two (2) coats finish. Paint shall contain LBC (Lead Barrier Compound) and meet Maine DEP standards for encapsulation. Color to match existing, *or* be agreed upon by owner in writing and noted on the design specifications. Provide the owner with remaining encapsulant paint (1/2-gallon min.) at the end of the project.

Interior Dust Hazards:

- **INTERIM CONTROL (Clean):** Clean all surfaces identified as having lead dust hazards: **Movable items shall be removed from the work area** to prevent contamination. (Non-moveable furniture or components to be pre-cleaned, then removed from work area; or pre-cleaned, left in place and covered with a single layer of 6-mil poly). HEPA Vacuum, Wet Wash, and HEPA vacuum the area.

COST PROPOSAL

BID #2025-010 Lead Abatement 111 Pleasant St.

Scope	Labor	Materials	Total
Apt. 1 & FCA			
Apt. 2, RCA & Exterior			
Apt. 3			
GRAND TOTAL			

Written amount: _____

Company Name: _____

Signature: _____

Printed name: _____

Date: _____



City of Auburn, Maine
 60 Court Street | Auburn, Maine 04210 www.auburnmaine.gov | 207.333.6601

Pre-Bid Conference Sign-In Sheet

Bid #:		2025-010 Lead Abatement 111 Pleasant St.		
Date:		9/23/2024		
Company	Representative Name	Contact Phone	Contact Email	
NRH Management	Rich Leyland	207 402 5237		
Ray Corp	RC			
Kennel Apartments	Mike Zuck	751-7877		
Clarity	Abdullah Zabin	207-280-4409		
Southern Maine MRA Cons Services	Abdullah Zabin	207-409-7045		