

60 Court Street | Auburn, Maine 04210 www.auburnmaine.gov | 207.333.6601

PLANNING BOARD AGENDA February 11th, 2025 – 6:00 p.m. City Council Chambers, 60 Court Street

1. ROLL CALL:

- **2. MINUTES:** Review the January 14th 2024 meeting minutes. All meetings are available live and after airing on YouTube https://www.youtube.com/c/CityofAuburnMaine
- 3. Stetson Road Multifamily: The Planning Board will reopen this project, previously tabled on January 14, 2025, and postpone for further review and action at the March 11, 2025, Planning Board meeting. The application, submitted by DiPrete Engineering on behalf of A.R. Building Company, proposes 56 residential buildings (180 units: 22 duplexes and 34 quadplexes) on Stetson Road, Tax Map 291-011, within the General Business (GB) District. No public hearing or site plan review will take place at this time.
- **4. Danville Corner Housing Development:** The Planning Board will reopen this project, previously tabled on January 14, 2025, and postpone for further review and action at the March 11, 2025, Planning Board meeting. The application, submitted by Terradyn Consultants LLC on behalf of Timothy Millet, proposes 44 single-family homes on property owned by Spurwink Services Incorporated, located on Danville Corner Road, Tax Map 122-004, within the General Business (GB) District. No public hearing or site plan review will take place at this time.
- 5. BWC Gulf Island Pond, LLC Auburn Solar Project: The Planning Board will open this project, and postpone for further review and action at the March 11, 2025, Planning Board meeting. The application, submitted by Sean Murphy of Flycatcher LLC on behalf of BWC Gulf Island Pond, LLC (a subsidiary of BlueWave Energy), proposes a 1.41 MW DC ground-mounted solar array on approximately 10.12 acres at 224 East Waterman Road, Tax Map 393-010, within the Agriculture and Resource Protection Zoning District. No public hearing or site plan review will take place at this time.
- **6. Soper Mill Brook, LLC Penley Corner Solar Project** The Planning Board will open this project, and postpone for further review and action at the March 11, 2025, Planning Board meeting. The application, submitted by Sean Murphy of Flycatcher LLC on behalf of Soper Mill Brook, LLC (a subsidiary of BlueWave Energy), proposes a 1 MW DC ground-mounted solar array on approximately 10.91 acres on Penley Corner Road, Tax Map 137-026, within the Agriculture and Resource Protection Zoning District. No public hearing or site plan review will take place at this time.
- 7. PUBLIC HEARING/SITE PLAN REVIEW: Engine II: The Planning Board will host a public hearing and act on a site plan review application submitted by HaleyWard on behalf of the City of Auburn proposing a redevelopment of the Auburn Fire Department Engine II public safety project the subject property is located at 180 South Main Street, Tax Map Lot 211-289 and within the T-4.2B Traditional Neighborhood Development District
- **8. WORKSHOP:** The Planning Board will host a workshop to discuss the new Director of Planning.

9. CHAIR AND VICE CHAIR ELECTION

10. PUBLIC COMMENT:

11. MISCELLANEOUS:

- a. Upcoming Agenda Items
- b. Comp plan Consultant Update

12. ADJOURNMENT

Auburn Planning Board meetings can be viewed live on the City of Auburn YouTube channel (https://www.youtube.com/c/CityofAuburnMaine), and on Great Falls Television (Spectrum Cable Channel 11).

Following live broadcasts, Planning Board meetings are rebroadcast at 7:00AM, noon, and 7:00PM on Tuesdays on GFTV and are available anytime on our YouTube channel.



Eric Cousens, Director

60 Court Street | Auburn, Maine 04210 www.auburnmaine.gov | 207.333.6601

PLANNING BOARD Meeting Minutes - Draft January 14th, 2025 – 6:00 p.m. City Council Chambers, 60 Court Street

- 1. ROLL CALL: Dave Trask, Paul Jacques, Stacey LeBlanc, Bob Hayes, Darren Finnegan, Tim DeRoche, Maureen Hopkins (elevated to full member). Absent: Riley Bergeron and Ed Bearor
- **2. MINUTES:** Review the December 10th 2024 meeting minutes. All meetings are available live and after airing on YouTube https://www.youtube.com/c/CityofAuburnMaine

Motion to Approve: Tim DeRoche Second: Dave Trask Vote: 7-0 Motion Carries

3. PUBLIC HEARING/ SITE PLAN REVIEW: Penley Corner Residences: The Planning Board will host a Public Hearing and act on a site plan application submitted by TERRADYN CONSULTANTS LLC on behalf of the owners Vallieres Real Estate Investment, LLC proposing construction of two residential duplex buildings, the subject property is located at 1165 Riverside Drive, Tax Map Lot 163-001-001, and within the Rural Residential District and Agriculture and Resource Protection District.

Staff Report by Natalie Thomsen and John Blais. With the updates to ordinances related to LD 2003, this project now meets density standards.

Jim Corbin, representing the applicant from Teradyne Consultants, speaks about the project and points out that they have designed open space as part of this development.

Motion to Open Public Comment: Tim DeRoche Second: Dave Trask Vote: 7-0

No Public Comment

Motion to Close Public Comment: Tim DeRoche Second: Dave Trask Vote: 7-0

Motion to approve: Tim DeRoche

"I make a motion that the proposal meets the requirements of Sections 60-1359 and approve the Subdivision to construct two residential duplex buildings on each of his two existing lots on Riverside Drive, near Penley Corner, for a total of eight units, septic, and wells 1165 Riverside Drive, also City Assessor's Parcel I.D. 163-001-001. The proposed project should be considered pursuant to Chapter 60, Article IV Subdivision, Article XVI and Article IV, Division 4 – Low Density Rural Residence District.

- No development activity until any bonding or inspection fees is determined by the Auburn Engineering Department.
- Blasting permit in advance of blasting from the City of Auburn, Planning, Permitting and Code Department. "

Second: Dave Trask Vote: 7-0 Motion Carries

4. PUBLIC HEARING/ SITE PLAN REVIEW: Cooper Paving Sign: The Planning Board will host a Public Hearing and act on a site plan application submitted by Stoneybrook Land Use Inc. On behalf of Cooper Paving LLC to install a new sign at their site, the subject property is located at 2767 Turner Road, Tax Map Lot 367-032, and within the Low Density Country Residential (LDCR) District, the Agriculture and Resource Protection (AG) District, and the Lake Auburn Watershed.

Staff Report by John Blais. Cooper paving is asking for a waiver for their sign because the requested sign is larger than the zoning allows.

Mike Gotto, representing the applicant, speaks about the request and that DOT has told them the sign needs to be moved back outside of the ROW and moved onto the property which they are able and willing to do.

Motion to Open Public Comment: Dave Trask Second: Tim DeRoche Vote: 7-0

<u>Debra Desjardins, 2768 Turner Rd</u> – Speaks in support of this request and speaks highly of Cooper Paving as a neighbor.

Motion to Close Public Comment: Dave Trask Second: Bob Hayes Vote: 7-0

Motion to Approve waiver: Dave Trask.

"I make a motion to allow Cooper Paving LLC a waiver from Chapter 60, Sec. 60-637 (2)(a) General Provisions Regulations, pursuant to Chapter 60, Sec. 60-638 (b)(5) as well as a waiver from the following information under Chapter 60, Sec. 60-1301: 4, 5, 6, 7, 8, 9, 10, 12, 13, 14, 15, 16, 17, 19, 21, 22, 23, and 24. The request is pursuant to Chapter 60, Sec. 60-1302."

Second: Bob Hayes **Vote**: 7-0 **Motion Carries**

Motion to Approve with considerations and conditions: Dave Trask

"I make a motion to allow the proposed sign as it meets the four conditions of Chapter 60-1277 Site Plan review of the Auburn Code of Ordinances as per section 3 of this report, with the following conditions:

• No development activity until any bonding or inspection fees is determined by the Auburn Engineering Department.

- Prior to the issuance of a sign permit, the applicant must obtain approval from the Department of Transportation.
- Any additional signage added to the signpost must come back to the Planning Board for review and approval.
- Blasting permit in advance of blasting from the City of Auburn, Planning, Permitting and Code Department."

Second: Tim DeRoche **Vote:** 7-0 **Motion Carries**

0:19:30

5. PUBLIC HEARING/ SITE PLAN REVIEW: Stetson Road Multifamily: The Planning Board will host a Public Hearing and act on a site plan application and SLODA delegated review (Over three acres) submitted by DiPrete Engineering on behalf of the owners A.R. Building Company, to build 56 Residential buildings: 22 duplexes and 34 quadplexes, the subject property is located on Stetson Rd, Tax Map 291-011, and within the GB - General Business District.

Staff Report by Natalie Thomsen. The applicant is requesting a waiver on the separation between buildings. There are still some revisions and information needed from the applicant regarding traffic reports and sidewalks, so staff is recommending this item gets tabled until the next meeting so these details can be flushed out.

Brandon Carr with DiPrete Engineering, speaks on behalf of the applicant and provides a presentation. Board, applicant and staff discuss issues with the plan including traffic, sidewalks and setbacks.

Motion to Open Public Comment: Dave Trask Second: Tim DeRoche Vote: 7-0

Motion Carries

No Public Comment

Motion to Close Public Comment: Dave Trask Second: Tim DeRoche Vote: 7-0

Motion Carries

Motion to table this item to a date certain of February 11th, 2025: Dave Trask

Second: Bob Hayes **Vote:** 7-0 **Motion Carries**

0:55:44

6. PUBLIC HEARING/ SITE PLAN REVIEW: Danville Corner Housing Development: The Planning Board will host a Public Hearing and act on a site plan application and Stormwater

delegated review (less than three but over one acre) submitted by Terradyn Consultants LLC on behalf of Timothy Millet to build 44 single family homes, the subject property is owned by Spurwink Services Incorporated, and located on Danville Corner Rd, Tax Map 122-004 and within the GB - General Business District.

Staff Report by Natalie Thomsen.

Craig Sweet from Terradyn Consultants was present to answer questions and discuss the site plan. Applicant, staff and board discussed density standards and setbacks for this plan.

Motion to Open Public Comment: Dave Trask Second: Bob Hayes Vote: 7-0

<u>Susan Lindquist – 473 Old Danville Rd – Enjoys</u> the rural nature of the area and expressed concern over the density of this development as well as traffic at the intersection of Old Danville Rd and Washington Street.

<u>Dan Morino – 41 Presidential Way</u> - Voiced concerns for traffic at the intersection of Old Danville Rd and Washington Street.

<u>Spencer Dunn – 530 Court Street -</u> Speaks in support of this development as it falls in line with the zoning and the most recent Comprehensive Plan Update.

Motion to Close Public Comment: Dave Trask Second: Darren Finnegan Vote: 7-0
Motion Carries

Board discusses site plan and the density standards. Multi-family density standards allow for greater unit numbers and single-family standards call for fewer units than this site plan includes.

Motion to table this agenda item to a date certain of February 11th: Dave Trask Second: Bob Hayes Vote: 7-0 Motion Carries

1:42:44

7. CHAIR AND VICE CHAIR ELECTION

Dave Trask nominates Stacey LeBlanc for Chair.

Seconded: Paul Jacques **Vote:** 5-0-2 (Bob Hayes and Stacey LeBlanc abstain)

Tim DeRoche nominates Paul Jacques for Vice Chair.

Seconded: Bob Hayes **Vote**: 6-0-1 (Paul Jacques abstains)

8. PUBLIC COMMENT: No Public Comment

9. MISCELLANEOUS:

- a. Upcoming Agenda Items
 - i. BWC Gulf Island Pond, LLC Auburn Solar Project East Waterman Rd
 - ii. Stetson Road Multifamily tabled this meeting
 - iii. Danville Corner Housing Development -tabled this meeting
 - iv. Engine II
- b. Joint Meeting January 21, 2025 AG zone with advice from our Legal Counsel on Bonafide Farms

1:47:00

10. ADJOURNMENT

Auburn Planning Board meetings can be viewed live on the City of Auburn YouTube channel (https://www.youtube.com/c/CityofAuburnMaine), and on Great Falls Television (Spectrum Cable Channel 11).

Following live broadcasts, Planning Board meetings are rebroadcast at 7:00AM, noon, and 7:00PM on Tuesdays on GFTV and are available anytime on our YouTube channel.



City of Auburn, Maine

Office of Planning & Permitting

www.auburnmaine.gov | 60 Court Street Auburn, Maine 04210 207.333.6601

TO: Auburn Planning Board

FROM: Natalie Thomsen, Planning Coordinator

DATE: February 11, 2025

RE: Continuance Request for Stetson Road Multifamily Project

PROJECT STATUS UPDATE:

The Stetson Road Multifamily project, proposed by DiPrete Engineering on behalf of A.R. Building Company, was initially tabled at the January 25, 2025, Planning Board meeting to allow the applicant to provide additional information to staff. The applicant has since submitted a formal request to further table the project to the March 11, 2025, meeting.

Brandon Carr, P.E., Principal at DiPrete Engineering, submitted this request via email on January 24, 2025, stating their intent to continue the February 11 hearing to the March meeting.

Given the applicant's request and the need for additional information, staff recommends the Planning Board reopen the project and **postpone** the hearing to a date certain—March 11, 2025—rather than **tabling** it again.

Under **Robert's Rules of Order**, "tabling" a motion is used to set aside a matter **temporarily** without specifying a time for its reconsideration. It is typically used to address urgent business that requires immediate attention before the original motion can be revisited. If a motion is tabled and not taken from the table within a specific timeframe, it expires.

"Postponing to a date certain," however, **defers** discussion and action on an item until a specified future meeting, ensuring it remains on the agenda without requiring additional action to bring it back. Since the intent is to continue reviewing the Stetson Road Multifamily project at the next available meeting, postponement is the appropriate procedural step.

PLANNING BOARD ACTIONS:

To proceed, the Planning Board must take the following actions at the February 11, 2025, meeting:

1. Motion to Reopen the Application

- a. Suggested Motion:
 - i. I move to reopen the Stetson Road Multifamily project application for discussion.

2. Motion to Postpone the Application to March 11, 2025

- a. Suggested Motion:
 - i. I move to postpone the Stetson Road Multifamily project to the Planning Board meeting on March 11, 2025, per the applicant's request.



60 Court Street | Auburn, Maine 04210 www.auburnmaine.gov | 207.333.6601

TO: Auburn Planning Board

FROM: Natalie Thomsen, Planning Coordinator

DATE: February 11, 2025

RE: Postponement of Danville Corner Road Development Review

PROJECT STATUS UPDATE:

The proposed development on Danville Corner Road seeks to construct 44 single-family homes on a 7.2-acre lot. Under **Sec. 60-307 - Dimensional Regulations**, there is conflicting interpretation regarding the applicable density calculations. The developer intends to retain land ownership while selling homes separately, creating multiple ways to interpret the ordinance's density provisions.

The ordinance specifies a maximum density of 4 units per acre for one-family dwellings, 6 units per acre for two-family dwellings, and 17 units per acre for multifamily dwellings. However, the language does not explicitly address how to classify developments where multiple housing types may be present, leading to several possible interpretations.

One interpretation applies a strict per-acre density calculation, which would limit the project to 28 units based on the one-family dwelling standard. Another interpretation suggests that the presence of a multifamily unit could trigger the 17 units per acre density standard across the entire site, allowing up to 122 units. A third possibility is a hybrid approach where only the first acre containing a multifamily unit qualifies for the higher density, resulting in an allowance of 42 units. Additionally, the definition of multifamily housing under state versus city regulations could further influence the allowable unit count.

Given these uncertainties, staff is awaiting further legal review to clarify the appropriate density standard for this project. To ensure a well-supported decision, staff recommends postponing this item to the March 11 meeting to allow sufficient time for legal input.

Suggested Motions:

Motion to Reopen the Project:

I move to reopen the review of the Danville Corner Road development."

Motion to Postpone:

"I move to postpone the review of the Danville Corner Road development to the March 11 Planning Board meeting to allow for legal review of density calculations."



60 Court Street | Auburn, Maine 04210 www.auburnmaine.gov | 207.333.6601

TO: Auburn Planning Board

FROM: Natalie Thomsen, Planning Coordinator

DATE: February 11, 2025

RE: Postponement of BWC Gulf – Soper Mill Brook Solar Review

PROJECT STATUS UPDATE:

The Auburn Solar Project, proposed by Sean Murphy of Flycatcher LLC on behalf of BWC Gulf Island Pond, LLC (a subsidiary of BlueWave Energy), is a 1.41 MW DC ground-mounted solar array planned for approximately 10.12 acres at 224 East Waterman Road, within the Agriculture and Resource Protection Zoning District (Tax Map Lot 393-010). The project is currently being postponed at the recommendation of staff to allow the applicant to provide a more complete application that adequately addresses outstanding conditions. These conditions include financial surety, waste disposal and site stabilization plans, topsoil maintenance, an operations and maintenance plan prioritizing agricultural couse, and emergency response mechanisms. The applicant has agreed to the postponement following discussions, ensuring that when the application returns for review, it will be more comprehensive and ready for consideration by the Planning Board.

Staff is recommending that the Planning Board postpone its review, and the applicant has agreed to this postponement after discussions. This postponement allows for a more streamlined review process once the application returns to the Board.

Suggested Motion: "I move to accept the staff recommendation to postpone the review of the Site Plan Application for the Auburn Solar Project to a future Planning Board meeting at which the applicant will provide a more complete submission for review."



60 Court Street | Auburn, Maine 04210 www.auburnmaine.gov | 207.333.6601

TO: Auburn Planning Board

FROM: Natalie Thomsen, Planning Coordinator

DATE: February 11, 2025

RE: Postponement of the Soper Mill Brook Solar Review

PROJECT STATUS UPDATE:

The Penley Corner Solar Project, proposed by Sean Murphy of Flycatcher LLC on behalf of Soper Mill Brook, LLC (a subsidiary of BlueWave Energy), is a 1 MW DC ground-mounted solar array planned for approximately 10.91 acres at 371 Penley Corner Road, within the Agriculture and Resource Protection Zoning District (Tax Map Lot 137-026). The project is currently being postponed at the recommendation of staff to allow the applicant to provide a more complete application that adequately addresses outstanding conditions. These conditions include financial surety, waste disposal and site stabilization plans, topsoil maintenance, an operations and maintenance plan prioritizing agricultural co-use, and emergency response mechanisms. The applicant has agreed to the postponement following discussions, ensuring that when the application returns for review, it will be more comprehensive and ready for consideration by the Planning Board.

Staff is recommending that the Planning Board postpone its review, and the applicant has agreed to this postponement after discussions. This postponement allows for a more streamlined review process once the application returns to the Board.

Suggested Motion: "I move to postpone the review of the Site Plan Application for the Penley Corner Solar Project to the March 11, 2025 Planning Board meeting at which the applicant will provide a more complete submission for review."



City of Auburn, Maine Office of Planning & Permitting www.auburnmaine.gov | 60 Court Street


Auburn, Maine 04210 207.333.6601

To: Auburn Planning Board

From: Natalie Thomsen, Planning Coordinator

Re: Engine II: The Planning Board will host a public hearing and act on a site plan review application submitted by Woodard & Curran on behalf of the City of Auburn proposing a redevelopment of the Auburn Fire Department Engine II public safety project the subject property is located at 180 South Main Street, Tax Map Lot 211-289 and within the T-4.2B - Traditional Neighborhood Development District. The proposed project should be considered pursuant to Chapter 60, Article XVI, Division 2- Site Plan Review, Division 3 – Special Exception,

Date: February 11, 2025

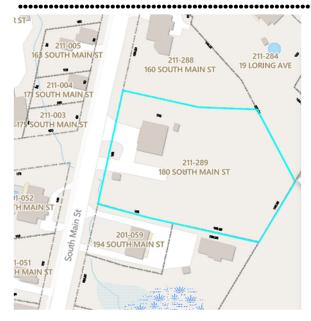

I. PROPOSAL – The City of Auburn, in collaboration with Woodard & Curran, has submitted a Site Plan Review application for the redevelopment of the Auburn Fire Department Engine II public safety project. The project site is located at 180 South Main Street, identified as Tax Map Lot 211-289 within the T-4.2B - Traditional Neighborhood Development District. The proposal includes the demolition of the existing fire station and construction of a new 9,400 square foot fire station adjacent to the current structure. The new facility will include a double apparatus bay, dormitories, kitchen, fitness room, conference room, office space, and decontamination areas. The project will be completed in phases, allowing the existing facility to remain operational during construction. Once the new facility is completed, the existing structure will be demolished, and site improvements will be finalized.

II. ZONING CONSIDERATIONS -

The site is located in the T-4.2B Traditional Neighborhood Development District, which falls under Auburn's Form-Based Code. The proposed use is classified as a Public Safety Facility, which is permitted by Special Exception in this district per Section 60-554, Form Based Code Use and Parking Matrix. The project must comply with the district's building placement, configuration, and use regulations, including Sections 60-556, Form Based Code Plan Types, and 60-548, Form Based Code Development Standards, which establish parameters for site layout and development intensity.

Per Section 60-548B.2, Building Frontages T-4.2B, the standard requires that primary entrances be oriented towards the street, have a minimum transparency of 40% on the ground floor, and incorporate pedestrian-friendly elements such as canopies or stoops. The proposed fire station meets this standard by orienting the main entrance towards South Main Street, integrating transparent windows along the public-facing façade, and providing a pedestrian-accessible pathway from the street to the entrance. They are asking for a waiver to reduce the transparency to 34%, which falls short of the requirement but is justified due to operational needs.

Per Section 60-548B.3, External Elements T-4.2B, the standard mandates that mechanical equipment must be screened from public view, lighting should be designed to avoid glare on adjacent properties, and refuse storage should be enclosed. The project meets this requirement by incorporating landscaping elements and fencing to screen mechanical units, using full-cutoff light fixtures to prevent light spillover, and enclosing the dumpster area within a dedicated screening enclosure to minimize visual impact.

While the applicant has made efforts to comply with these zoning requirements, some waivers are being requested to accommodate the functional and operational needs of a fire station. These requests are discussed in detail in the waiver section.

Standards Met₩ITH Issuance of Waivers ✓%

III. WAIVER REQUESTS

The applicant has requested waivers from specific zoning requirements due to the existing lot configuration and operational needs of a fire station.

Sec. 60-558. (c) Waiver requests. (1) Any waiver request of form-based code standards and requirements must identify what regulation is being requested for the waiver and include a narrative explaining how the waiver, if approved, will allow the project to meet the purpose of the form-based code and the objective of Section 60-1277, site plan review.

Sec. 60-1277 - Objective.

In considering a site plan, the planning board shall make findings that the development has made provisions for:

- (1) Protection of adjacent areas against detrimental or offensive uses on the site by provision of adequate surface water drainage, buffers against artificial and reflected light, sight, sound, dust and vibration; and preservation of light and air.
- (2) Convenience and safety of vehicular and pedestrian movement within the site and in relation to adjacent areas.
- (3) Adequacy of the methods of disposal for wastes.
- (4) Protection of environmental features on the site and in adjacent areas.

1. Waiver from Section 60-548B.1, Building Placement and Configuration – Front Setback

- o **Standard:** The maximum front setback allowed is **25 feet**.
- Request: The proposed building is set back 86 feet from the front property line to accommodate visitor parking, emergency apparatus drive aisles, and site operations.
- Suggested Motion: I make a motion to approve the requested waiver from Section 60-548B.1, Building Placement and Configuration, to allow a front setback of 86 feet where a maximum of 25 feet is permitted.

2. Waiver from Section 60-548B.2, Building Frontages – Window and Door Coverage

• **Standard:** Windows and doors must comprise a minimum of **40%** of the total ground story frontage façade.

- Request: The proposed building includes 34% coverage due to functional needs, energy efficiency, and operational considerations.
- Suggested Motion: I make a motion to approve the requested waiver from Section 60-548B.2, Building Frontages, to allow window and door coverage of 34% where a minimum of 40% is required.

3. Waiver from Section 60-548B.3, External Elements – Parking Location

- Standard: Parking for commercial developments shall be located to the rear of the property, with side yard parking limited to 60 feet wide or 40% of the lot width. Screening is required for parking areas along a street.
- o **Request:** Parking is divided into two dedicated areas: a **68-foot-wide** staff parking area on the west and a **public parking area in front of the building** to allow safe and accessible public access. Screening is provided through plantings.
- Suggested Motion: I make a motion to approve the requested waiver from Section 60-548B.3, External Elements, to allow a parking area of 68 feet in width where a maximum of 60 feet is permitted.

4. Waiver from Section 60-801, Access Management – Driveway Spacing and Number of Driveways

- o **Standard:** The minimum spacing for curb cuts and driveways is **150 feet**, with a limit of **one two-way access** per roadway.
- o **Request:** Two curb cuts are proposed, less than 150 feet apart, to separate emergency and public access. The site's limited frontage makes compliance infeasible. Stop signs will be installed for traffic control.
- Suggested Motion: I make a motion to approve the requested waiver from Section 60-801, Access Management, to allow two curb cuts less than 150 feet apart.

5. Waiver from Section 60-548B.3 and Section 60-607, External Elements and General Provisions – Driveway Width

- o Standard: Driveways shall be a maximum of 20 feet wide.
- o **Request:** The emergency vehicle driveway is **34 feet wide**, and the public access driveway is **24 feet wide** to accommodate fire apparatus and traffic flow.
- Suggested Motion: I make a motion to approve the requested waiver from Sections 60-548B.3 and 60-607, External Elements and General Provisions, to allow driveway widths of 34 feet and 24 feet where a maximum of 20 feet is permitted.

PARKING & ACCESS MANAGEMENT STANDARDS -

Vehicular access to the site has been designed to accommodate emergency vehicles, with a drive-through double apparatus bay ensuring efficient entry and exit. Parking will be provided on-site for staff and visitors in compliance with **Section 60-608**, **Off-Street Parking and Loading Standards**. Given that the site is designated for emergency services, the primary concern is ensuring clear and unobstructed access for fire trucks rather than traditional parking.

The project does not meet the threshold for a Traffic Movement Permit under MDOT regulations as it does not generate more than 100 peak-hour trips. However, the site circulation plan has been reviewed by the City Engineer to ensure compliance with **Article X – Access Management Standards**, particularly regarding driveway placement and curb cut regulations. The engineering department recommends the acceptance of the waivers.

Pedestrian access is also considered, with sidewalks and crosswalks designed in accordance with **Section 60-607**, **Pedestrian Access Standards**, ensuring safe movement within and around the site for personnel and visitors.

Standards Met WITH issuance of waivers */

IV. WETLANDS/STORMWATER -

The project will not create more than one acre of new impervious surface, and the stormwater management system has been designed to ensure post-development runoff does not exceed pre-development conditions for the 2, 10, and 25-year storm events. The applicant has provided a Stormwater Management Plan, which has been reviewed by the City's Engineering Department and found to be compliant with Sec. 60-1301(10)

The applicant has designed a **comprehensive stormwater system** that incorporates multiple strategies to manage both water quantity and quality. The system includes **catch basins** strategically placed to collect runoff from impervious surfaces such as paved parking areas and the building roof. These basins direct water into an **underground storm drain system**, which conveys runoff to a **subsurface detention basin**. This basin is designed to temporarily store stormwater and release it at **pre-development flow rates**, ensuring that downstream areas are not adversely affected by increased runoff.

Additionally, **underdrains** are installed beneath paved areas to manage groundwater levels and prevent surface water accumulation. A **foundation drain** around the building perimeter helps mitigate potential infiltration and groundwater pressure, further protecting the facility from water-related damage. To enhance water quality, **oil-water separators** will be installed to filter pollutants from runoff generated in the fire station's apparatus bay, ensuring compliance with environmental protection standards.

To further mitigate environmental impacts, the project includes **low-impact development (LID) practices**, such as the incorporation of green space and vegetative buffers where feasible. These elements aid in reducing runoff volume, filtering pollutants, and improving groundwater recharge. The applicant has also coordinated with the **Auburn Engineering Department** to ensure that stormwater outfalls are properly directed and stabilized to minimize erosion risks.

The revised stormwater plan submitted in response to city comments ensures compliance with **Auburn's stormwater regulations**, and the Engineering Department has reviewed the updated information to confirm that best management practices (BMPs) have been integrated effectively.

Standards Met%

V. OTHER PERTINENT ITEMS -

The project includes a **lighting plan** utilizing **full cut-off LED wall packs** mounted on the building to provide adequate illumination while minimizing glare and light spillover. The **photometric plan** complies

with Sec. 60-607(11), Lighting Standards, ensuring that lighting is directed downward and does not negatively impact adjacent properties. Additional **pole-mounted lighting** is planned for the parking area to enhance visibility and security.

A waste management plan has been submitted, detailing that sewage will be connected to the Auburn Water and Sewerage District main, and an oil-water separator will be installed in the apparatus bay to manage hazardous materials. A dedicated dumpster pad is included for periodic waste disposal. The dumpster area will be enclosed with an 8-foot-high privacy-screened chain-link fence to reduce visual impacts and contain debris

Landscaping improvements include **low-maintenance plantings** that provide screening while maintaining visibility for emergency vehicles. The landscaping plan includes **shrubs and small trees** in designated areas, focusing on enhancing site aesthetics while ensuring open sight lines for emergency response operations. Some existing vegetation will be preserved where feasible

VI. DEPARTMENT REVIEW-

- a. Police- ✓
- b. Auburn Water and Sewer- ✓
- c. Fire Department/Code Enforcement ✓
- **d.** Engineering Current conditions are roughly two entrances of 36' and 50' and understand the need to keep the public separated from emergency responders. Crash data from the immediate area does not indicate an issue with the two entrances as they are currently laid out. The proposed driveways are a slight improvement to existing conditions and would support the waivers.
- e. Public Services- ✓
- f. Airport ✓

<u>VII. PLANNING BOARD ACTION</u>- The proposed project requires review and findings for approval of Sections 60-1277 and 60-1336:

A. Site Plan Review, Section 60-1277:

- 1. Does the site plan protect adjacent areas against detrimental or offensive uses on the site by provision of adequate surface water drainage, buffers against artificial and reflected light, sight, sound, dust and vibration; and preservation of light and air?
- 2. Is the convenience and safety of vehicular and pedestrian movement within the site and in relation to adjacent areas adequately addressed?
- 3. Are the proposed methods of disposal for wastes adequately addressed?
- 4. Does the site plan provide adequate protection of environment features on the site and adjacent areas?

B. Special Exception, Section 60-1336. - The board shall require evidence of the following:

- 1. That the special exception sought fulfills the specific requirements, if any, set forth in the zoning ordinance relative to such exception.
- 2. That the special exception sought will neither create nor aggravate a traffic hazard, a fire hazard or any other safety hazard.
- 3. That the special exception sought will not block or hamper the master development plan pattern of highway circulation or of planned major public or semipublic land acquisition.

- 4. That the exception sought will not alter the essential characteristics of the neighborhood and will not tend to depreciate the value of property adjoining and neighboring the property under application.
- 5. That reasonable provisions have been made for adequate land space, lot width, lot area, stormwater management in accordance with section 60-1301 (14), green space, driveway layout, road access, off-street parking, landscaping, building separation, sewage disposal, water supply, fire safety, and where applicable, a plan or contract for perpetual maintenance of all the common green space and clustered off-street parking areas to ensure all such areas will be maintained in a satisfactory manner.
- 6. That the standards imposed are, in all cases, at least as stringent as those elsewhere imposed by the city building code and by the provisions of this chapter.
- 7. That essential city services which will be required for the project are presently available or can be made available without disrupting the city's master development plan.

VIII. STAFF RECOMMENDATIONS -

Staff recommends the Planning Board find that the Site Plan for the proposed development, meets the requirements of Sec. 60-1277, and further that the application meets the requirements of Special Exception Law, Sec. 60-1336, and APPROVE the project application. Staff recommends the following conditions:

- No development activity until any bonding or inspection fees are determined by the Auburn Engineering Department.
- * Blasting permit in advance of blasting from the City of Auburn, Planning, Permitting and Code Department.

Suggested Motions:

I make a motion that the proposal meets the requirements of Sections 60-1277 and 60-1336 and approve the Site Plan by Woodard & Curran for the phased construction f a new 9,400 square foot fire station adjacent to the current structure. The new facility will include a double apparatus bay, dormitories, kitchen, fitness room, conference room, office space, decontamination areas, and other associated improvements at 180 South Main Street, Tax Map Lot 211-289. The proposed project has met the standards pursuant to Chapter 60, Article XVI, Division 2- Site Plan Review and Division 3 – Special Exception with the following conditions:

- A. No development activity until any bonding or inspection fees are determined by the Auburn Engineering Department.
- B. Blasting permit in advance of blasting from the City of Auburn, Planning, Permitting and Code Department.

Natalie Thomsen
Planning Coordinator



AUBURN ENGINE 2 FIRE STATION

DEVELOPMENT REVIEW APPLICATION

180 South Main Street Auburn, Maine

Prepared by: Woodard & Curran, Inc. 12 Mountfort Street Portland, ME 04101

woodardcurran.com

0233981.14 December 2024



TABLE OF CONTENTS

SECTION			PAGE NO.
1.	PROJECT SUMMARY		1-2
	1.1 1.2	Development Review Application	
2.	EVIDENCE OF RIGHT, TITLE & INTEREST		2-4
	2.1 2.2	Right, Title & Interest Easements & Other Burdens	2-4 2-4
3.	SITE PLAN REVIEW ORDINANCE		3-5
	3.1 3.2 3.3	ApplicabilitySubmission RequirementsDevelopment Review Checklist Requirements	3-5

ATTACHMENTS

- 01 Development Review Application Form
- 02 Development Review Checklist
- 03 Evidence of Right, Title & Interest
- 04 Permit Drawings
- 05 GIS Parcel Map
- 06 List of Abutting Properties
- 07 FEMA FIRMette
- 08 Stormwater Management Report
- 09 Proof of Financial Capacity
- 10 Auburn Water and Sewerage District Utility Capacity Confirmation Email
- 11 Natural Resource Delineation Memo
- 12 Significant Sand and Gravel Aquifer Map
- 13 Lighting Plan & Information



1. PROJECT SUMMARY

On behalf of the City of Auburn (Applicant), Woodard & Curran (W&C) is pleased to submit this Development Review Application for the construction of a new Engine 2 Fire Station (the Project) located at 180 South Main Street in Auburn, Maine (the Site).

The Project will include demolition of the existing fire station building, and construction of a new approximately 9,400 SF fire station building on the same property as the existing station. The new station will be constructed adjacent to the existing station building, to allow for the existing station to remain in operation during construction of the new facility. The construction will be phased such that once the new building is complete, operations will shift into the new facility, and the existing station will be demolished. Once the existing station is demolished, the remainder of the site improvement work will be completed. The new station will include a drive-through double apparatus bay, fitness room, kitchen, conference room, office, dormitories, and supporting spaces such as equipment rooms, turn-out gear room, and decon areas.

The approximately 1.75-acre Site is located in the T-4.2B Traditional Neighborhood zoning district and is subject to the Form Based Code of the City of Auburn Land Use Ordinance.



Figure 1-1: Site Location



1.1 Development Review Application

The Development Review Application requires the following documents for submission:

- Development Review Application Form (included in Attachment 01)
- Development Review Checklist (included in Attachment 02)
- Evidence of Tight, Title and Interest (included in Attachment 03)
- Permit Drawings (included in Attachment 04)
- A Cover Letter stating the nature of the project (this narrative)

1.2 Application Fees

The City of Auburn Planning & Permitting Fee Schedule (January 2022 revision) indicates a Site Plan Review fee of \$700 for major projects. The City has determined that the Project is exempt from the Site Plan Review fee, as shown in Attachment 01.



2. EVIDENCE OF RIGHT, TITLE & INTEREST

2.1 Right, Title & Interest

The Project will occur on a portion of the parcel of land identified by the City as Map 211, Lots 288 & 289. The parcel is owned by the City of Auburn. A copy of the deeds, Book 669, Page 170, Book 1045, Page 363, and Book 11534, Page 81, are included in Attachment 03.

Although not required, a list of properties abutting and within 500 feet of the Engine 2 station has been provided for this application. The site's zoning and abutting properties are shown in Figure 2-1 below. A GIS Parcel Map and list of properties abutting the project area are included in Attachments 05 and 06.

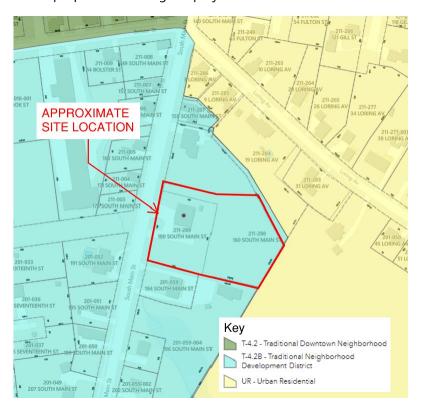


Figure 2-1: General Overview of Site Zoning and Abutters from City of Auburn GIS

2.2 Easements & Other Burdens

There are no known easements on the property.



3. SITE PLAN REVIEW ORDINANCE

3.1 Applicability

Per the City of Auburn Code of Ordinances, Chapter 60, Article IV, Division 14, Section 60-556, the Project will require review by the Planning Board for Special Exception and Site Plan Review, and will seek waivers from the adopted form-based code regulating developing standards.

The Project is considered a Civil Use of Public Safety Services, which is a use allowed by Special Exception in the Form Based Code Traditional Neighborhood T-4.2B (per Sec. 60-554, Form based code and parking matrix table).

3.2 Submission Requirements

Section 60-1301. (1)-(24) of the Ordinance lists submission requirements for Site Review Applications as listed below in *italics*, followed by a description of the materials provided.

- 1. General information including the following:
 - a. Name and address of the owner and developer

Owner & Applicant:

City of Auburn, Maine 60 Court Street Auburn, ME 04210 (207)-333-6601 Ext. 2156

Attn: Dan Goyette, Director of Engineering

Applicant Agent:

Woodard & Curran, Inc. 12 Mountfort Street Portland, ME 04101 (207) 558-3707

Attn: Caitlin Glass, PE, Project Manager

2. Name of development, scale, and meridian arrow, with specific definition of representation, date of plan and legend.

Drawings with this information are included in Attachment 04.

3. Names and addresses of all owners of record of all adjacent property as appear on assessor's records.

A List of Abutters is provided in Attachment 06.



4. Zoning boundaries and 100-year floodplain boundaries including surrounding areas to a distance of 300 feet from the perimeter of the property.

A copy of the City of Auburn GIS Map showing the zoning for site and surrounding areas is included in Attachment 05. The project is outside of the 100-year floodplain. A firmette showing the site and surrounding areas is provided as Attachment 07.

5. Easements; rights-of-way, existing, planned or proposed; or other reservations adjacent to or intersecting the property.

There are no existing or proposed easements anticipated as part of the project.

- 6. Topographic map of the site, containing the following:
 - a. Existing contours, where the slope of existing ground surface is generally two percent or more, the topographic map shall show contours at intervals of five feet of elevation (or lesser intervals as the planning board or engineering department may prescribe). Where the slope of the existing ground surface is generally less than two percent, contour intervals of one foot shall be shown. These contours shall not be copied from the city topographic maps and shall be determined from an on-site survey certified by a registered land surveyor.
 - b. Proposed contours shall be shown at intervals to be determined by the city engineer.
 - Existing topography based on a survey performed by Main-Land Development Consultants, Inc. is shown on Drawing C-0-101. Proposed contours are shown on Drawing C-0-104. See Attachment 04.
- 7. The location of watercourses, wetlands, marshes, surface water, rock outcroppings, wooded areas, single trees with a diameter of ten inches measured three feet from the base of the trunk
 - An Existing Conditions Plan showing the approximate limits of the wetlands, wooded areas, and single trees with diameter greater than or equal to ten inches is included as Attachment 04, Sheet C-0-101.
- 8. Location of buildings existing on the tract to be developed and on adjacent tracts within a distance of 100 feet from the property line, indicating whether existing buildings on the tract are to be retained, modified or removed.
 - A Site Preparation and Demolition Plan showing the demolition scope for the project is included in Attachment 04, Sheet C-0-102.
- 9. The location of water mains, sewer mains, wells, fire hydrants, culverts, drains, pipe sizes, grades and direction of flow. existing within 200 feet of the subject property.
 - An Existing Conditions Plan for the project is included in Attachment 04, Sheet C-0-101.
- 10. Existing soil conditions and soil suitability test results.
 - A Soils Map and Geotechnical Report prepared by SW Cole Engineering are appended to the Stormwater Management Report, included as Attachment 08.



11. Locations of proposed buildings and uses thereof.

A Layout and Materials Plan for the project is included in Attachment 04, Sheet C-0-103. Preliminary architectural drawings have also been included in Attachment 04 for reference.

- 12. Proposed traffic circulation system:
 - a. Including streets, parking lots, driveways and other access and egress facilities, curb lines, sidewalk lines and existing streets.
 - A Layout and Materials Plan showing this information is included in the Drawings, Attachment 04, Sheet C-0-103.
 - b. Including the projected traffic flow patterns into and upon the site for both vehicles and pedestrians and an estimate of the projected number of motor vehicle trips to and from the site for an average day and for peak hours.
 - The proposed site is a redevelopment with the same use. There are no anticipated traffic pattern changes.
- 13. The location of existing and proposed public utility lines: indicating whether proposed lines will be placed underground.
 - A Utility Plan for the project is included in Attachment 04, Sheet C-0-105.
- 14. Site developments requiring stormwater permits pursuant to 38 M.R.S.A. § 420-D shall include the required plan and to the extent permitted under 38 M.R.S.A. § 489-A, be reviewed under the procedures of article XVI of this chapter; and they shall meet and comply with 38 M.R.S.A. § 484(4-A) and those Rules promulgated by the Maine Department of Environmental Protection pursuant to the Site Law and section 420-D, specifically Rules 500, 501 and 502, as last amended August 12, 2015. If a project proposes infiltration and the standards in Rule 500, appendix D are not met, then a waste discharge license may be required from the Maine Department of Environmental Protection. An infiltration system serving a development regulated under the Site Location of Development Act may be required to meet standards in addition to those in appendix D.

The project is required to manage stormwater on the Site in accordance with applicable Maine Department of Environmental Protection (DEP) and City of Auburn regulations. The project will disturb approximately 1.35 acres and result in approximately 0.65 acres of impervious area, inclusive of a net increase of approximately 0.43 acres of impervious area. Therefore, the project requires compliance with the Basic Standards (erosion and sedimentation control) of DEP's Chapter 500 Stormwater Regulations.

The project does not exceed DEP or City of Auburn thresholds for the general standard (stormwater quality treatment) or the flooding standard (stormwater quantity) of DEP Chapter 500 stormwater regulations. The project is not located within the direct watersheds of Lake Auburn or Taylor Pond; therefore, compliance with the City's phosphorous control standard is not required. The proposed stormwater conveyance system will be sized to convey the 25-year storm and the proposed site has been designed to mitigate peak discharge flow rates for the 25-year storm event to prevent adverse impacts to the downstream stormwater infrastructure in compliance with City of Auburn Code of Ordinances Sec. 46-210(a)(3).



Proposed stormwater management systems are shown on the Grading Plan, Attachment 04, C-0-104. Additional information is included in the Stormwater Management Report, Attachment 08

15. The location and design of proposed off-street parking and loading areas. indicating number and size of stalls.

A Layout and Materials Plan showing this information is included in the Drawings, Attachment 04, Sheet C-0-103.

16. Proposed location and direction of and time of use of outdoor lighting.

Outdoor lighting will be provided to light the parking areas outside of the building and will be either building mounted or provided by light poles. The outdoor lighting will be used daily from dusk to dawn and from 4 PM to 6 AM during the winter. The lighting plan and additional information is included Attachment 13.

- 17. Existing and proposed planting, fences and walls.
 - a. Including all landscaping and screening; indicating existing trees to be retained and areas to be left undisturbed.

An Existing Conditions Plan for the project is included in Attachment 04, Sheet C-0-101.

b. Including design features intended to integrate the proposed new development into the existing landscape to enhance aesthetic assets and to screen objectionable features from neighbors.

A Layout and Materials Plan showing this information is included in the Drawings, Attachment 04, Sheet C-0-103.

18. The location, size, design, and manner of illumination of signs.

Not applicable; no illuminating signs are proposed.

19. The disposal location of sewage, trash, solid waste, oil waste, hazardous waste or radioactive waste showing disposal facilities, receptacles, or areas.

Sewage from the proposed building will tie into the existing Auburn Water and Sewerage District sewer main, as shown on the Utility Plan, Attachment 04, C-0-105. An oil water separator is proposed for the floor drains within the apparatus bay. An on-site dumpster pad has been included in the design to allow for periodic removal and storage of on-site solid waste.

Excess soil that may be generated during construction will be disposed of in accordance with Maine Department of Environmental Protection (DEP) solid waste regulations, with the most likely receiving facility being a Maine DEP licensed landfill.

The Contractor will be responsible for legal disposal of any oil waste during construction. W&C does not anticipate any other hazardous or radioactive wastes from the construction of this project.



20. Perimeter boundaries of the site giving complete descriptive lot data by bearings, distances, and radii of curves including the name and seal of the registered land surveyor who prepared the plan.

Perimeter boundaries are shown on the Boundary Survey & Abutter Conveyance plan, prepared by Main-Land Development Consultants, Inc. dated June 14, 2023, included in attachment 04.

21. Description and plan of capacity and location of means of sewage disposal together with approval of sewer district engineer or evidence of soil suitability for such disposal (test pit locations shall be shown on the plans) similarly approved by the city engineer department.

Not applicable; no on-site sewage disposal is proposed. Sewage will be disposed of via a sanitary sewer service connected to the existing Auburn Water and Sewerage District sewer.

- 22. A statement of the amount of area of land involved in the site including:
 - a. The percentage of the site proposed to be covered by buildings.

The proposed building lot coverage is approximately 12%

b. The total number of dwelling units proposed per acre.

No dwelling units are proposed as part of the Project.

c. The area proposed to be devoted to open space.

Approximately 11% of the proposed site qualifies as useable open space.

- d. The area proposed to be paved for parking, driveways, loading space and sidewalks.
 - Approximately 18,580 square feet of impervious area is being proposed for parking, drive aisles, walkways, a dumpster pad, equipment pads, a patio, and gravel surfaces..
- e. The total number of parking spaces required by the zoning chapter for the uses proposed.
 - The existing Engine 2 Fire Station has space for approximately 6 parked vehicles in an existing paved driveway southwest of the building. The proposed Engine 2 facility will include 7 parking spaces in a paved lot to the north of the new building for employee parking, and 3 parking spaces in a paved lot to the west of the building for public and visitor parking, including an accessible parking space.
- f. The number of employees expected per shift and the total floor area of proposed commercial or industrial uses.

It is anticipated that there will be 6 staff members at the station per shift

23. Description and plan of a phase development concept detailing the areas and sequence of phasing.

The construction will be completed in three phases: (1) installation of all erosion and sediment control, construction of the stormwater detention system, and construction of access road; (2)



construction of the new fire station building; (3) demolition of existing fire station building and construction of the remaining site work.

24. A statement by the developer assuring that he has the financial capabilities to fully carry out the project and to comply with the conditions imposed by the planning board.

W&C understands that the City of Auburn has financial capacity to manage the Project as a result of successful bonding in fiscal year 2025 and approved Capital Improvement Plan to bond the additional funds to complete the project in fiscal year 2023 as indicated in a letter from the City of Auburn Finance Director included in Attachment 09.



3.3 Development Review Checklist Requirements

The Development Review Checklist lists submission requirements for an application. Several of these requirements have been discussed herein and conformance has already been demonstrated. This section discusses all other Development Review Checklist Requirements in *italics*, followed by descriptions of the relevant materials provided in this application:

1. Site Plan

Most of the requirements listed on the checklist are addressed in the narrative herein or on the Drawings included in Attachment 04. Responses to other checklist requirements are provided below.

a. Airport Area of Influence.

Not Applicable. The project site is outside of the Airport Area of Influence as shown in Figure 3-1 below.

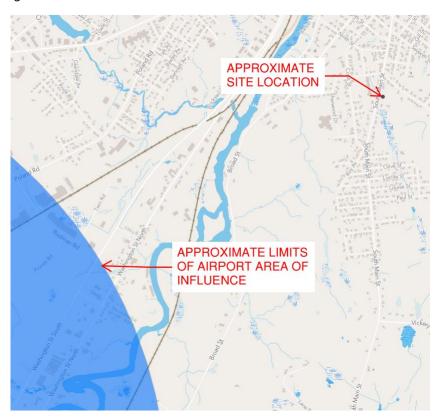


Figure 3-1: Airport Area of Influence Overview from City of Auburn GIS

b. Subdivision Restrictions

Not Applicable.

c. Fire Department Review



The City of Auburn Fire and Police Departments will review this application as part of the Site Plan Review process.

2. Landscape Plan

Most of the requirements listed on the checklist are addressed in the narrative herein or on the Drawings included in Attachment 04. Responses for other checklist requirements are provided below.

a. Greenspace Requirements

The proposed design will result in excess of the 10% minimum useable open space. Useable open space is defined as "open or **green space** [emphasis added] that is accessible for the use and enjoyment of residents..."

b. Setbacks to Parking

All permanent parking areas are separated from adjacent property lines by drive aisles as shown on Drawing C-0-103, Attachment 04.

c. Street Tree Requirements

Not Applicable.

3. Stormwater & Erosion Control Plan

Most of the requirements listed on the checklist are addressed in the narrative herein or on the Drawings included in Attachment 04. Responses for other checklist requirements are provided below.

a. Maine Construction General Permit

The final contract documents will require the Contractor to obtain all applicable construction permits and discharge stormwater from construction activities in accordance with the Maine Construction General Permit.

b. Bonding and Inspection Fees

Based on discussions with the City, a bonding and inspection fee will be dependent on the construction cost and will require ongoing coordination with the City for implementation prior to construction. The Applicant has requested this requirement be waived from the Application but will continue to coordinate a bonding and inspection fee for the contractor prior to construction.



4. Traffic Information

Most of the requirements listed on the checklist are addressed in the narrative herein or on the Drawings included in Attachment 04. Responses for other checklist requirements are provided below.

a. Access Management

The proposed site is a redevelopment with the same use and a similar access configuration to the existing condition. There are no anticipated traffic pattern changes.

b. Signage

Stop signs have been proposed for traffic leaving the site as shown on the Layout and Materials Plan, Attachment 04, C-0-103.

c. PCE - Trips in Peak Hours

The proposed site is a redevelopment with the same use. There are no anticipated traffic pattern changes.

d. Vehicular Movements

The proposed site has been designed to accommodate fire apparatus turning.

e. Safety Concerns

Not Applicable.

f. Pedestrian Circulation

The proposed site includes a separate parking area for pedestrians to visit the fire station. An accessible route has been designed from the parking area to the entrance of the building.

g. Police Traffic

The City of Auburn Police Department will review this application as part of the Site Plan Review process.

h. Engineering Traffic

The proposed site is a redevelopment with the same use. There are no anticipated traffic pattern changes.



5. Utility Plan

The majority of requirements listed on the checklist are addressed in the narrative herein or on the Drawings included in Attachment 04. Responses for other checklist requirements are provided below.

a. Adequacy of Water Supply

The Auburn Water and Sewerage District has confirmed that the existing watermain has enough capacity to service the proposed demands as indicated in the 4 December 2024 email included in Attachment 10.

b. Watermain extension agreement

Not Applicable.

c. Available City sewer capacity

The Auburn Water and Sewerage District has confirmed that the existing sewer line has enough capacity to service the proposed demands as indicated in the 4 December 2024 email included in Attachment 10.

6. Natural Resources

a. Shoreland Zone

Not Applicable. The project site is outside of the Shoreland Zone as shown in Figure 3-2 below.

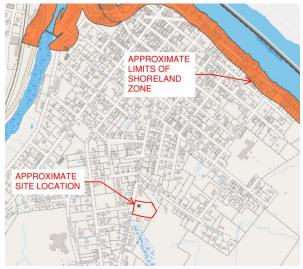


Figure 3-2: Shoreland Zone Overview from City of Auburn GIS



b. Flood Plain

Not Applicable. The project site is outside FEMA identified Flood Zones as shown in Attachment 07.

c. Wetlands or Streams

FB Environmental Associates performed a wetland investigation for the site in March 2023 and found two wetland areas and one ditch. A memo summarizing FB Environmental Associates' findings is included in Attachment 11.

d. Urban Impaired Stream

Not Applicable. Based on the Maine Urban Impaired Stream Watersheds GIS, the project site is not located within an Impaired Stream Watershed as shown below in Figure 3-3.

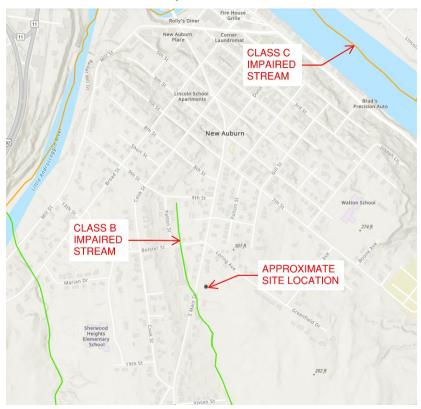


Figure 3-3: Maine Urban Impaired Stream Watersheds Overview from MaineDEP GIS

e. Phosphorus Check

The project is not located within the direct watersheds of Lake Auburn or Taylor Pond; therefore, the City's phosphorous control standard is not required.



f. Aquifer/ Groundwater Protection

The project site is outside of any Significant Sand and Gravel Aquifers as defined by Maine Geological Survey Open-File No. 99-22, included as Attachment 12.

g. Applicable State Permits

A Tier 2 NRPA will be submitted to DEP for the Project, as well as a Maine Construction General Permit (MCGP), as the disturbance area will be greater than one acre.

h. Lake Auburn Watershed

Not Applicable. The project site is outside of the Lake Auburn Watershed as shown in Figure 3-4 below.

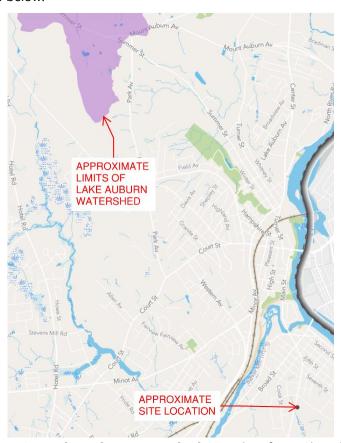


Figure 3-4: Lake Auburn Watershed Overview from City of Auburn GIS



i. Taylor Pond Watershed

Not Applicable. The project site is outside of the Taylor Pond Watershed as shown in Figure 3-5 below.

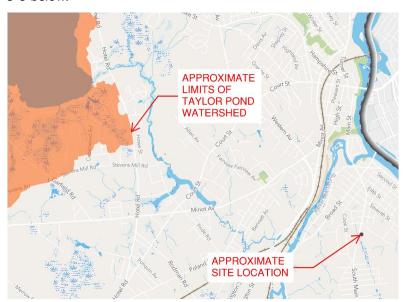


Figure 3-5: Taylor Pond Watershed Overview from City of Auburn GIS

7. Subdivision Law and Additional Subdivision Standards.

Not Applicable.

ATTACHMENT 01: DEVELOPMENT REVIEW APPLICATION FORM





City of Auburn, Maine

Office of Planning & Permitting
Eric J. Cousens, Director
60 Court Street | Auburn, Maine 04210
www.auburnmaine.gov | 207.333.6601

Development Review Application

PROJECT NAME: Audum Engine #2 Station							
PROPOSED DEVELOPMENT ADDRESS: 180 S Main St, Auburn, ME 04210							
PARCEL ID #: 211-289							
REVIEW TYPE: Site Plan ✓	Site Plan Amendment □						
Subdivision \square	Subdivision Amendment						
shown in Figure 1-1 below. The new station will be consinted in operation during construction of the new facility. The shift into the new facility, and the existing station will be improvement work will be completed. The new station office, dormitories, and supporting spaces such as equently 1.75-acre Site is located in the T-4.	Station will be located on the same property as the existing station at 180 S Main St as instructed adjacent to the existing station building, to allow for the existing station to remain a construction will be phased such that once the new building is complete, operations will be demolished. Once the existing station is demolished, the remainder of the site will include a drive-through double apparatus bay, fitness room, kitchen, conference room, sipment rooms, turn-out gear room, and decon areas. 2B Traditional Neighborhood zoning district and is subject to the Form Based Code of the						
City of Auburn Land Use Ordinance.							
Name: Dan Goyette (City of Auburn	n) Name: City of Auburn, Maine						
Address: 60 Court Street	Address:60 Court Street						
City / State Auburn, ME	City / State Auburn, ME						
Zip Code 04210	Zip Code 04210						
Work #: 207-333-6601 Ext. 2156	Work #: 207-333-6601 Ext. 2156						
Cell #:	Cell #:						
Fax #:	Fax #:						
Home #:	Home #:						
Email: dgoyette@auburnmaine.go	Email: dgoyette@auburnmaine.gov						
Project Representative	Other professional representatives for the project (surveyors, engineers, etc.),						
Name: Woodard & Curran, Inc.	Name:						
Address: 12 Mountfort St	Address:						
City / State Portland, ME	City / State						
Zip Code 04101	Zip Code						
Work #(207) 558-3707	Work #:						
Cell #: N/A	Cell #:						
Fax #: N/A	Fax #:						
Home #: N/A	Home #:						
Email: cglass@woodardcurran.co	om Email:						

PROJECT DATA

The following information is required where applicable, in order complete the application

	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	iipioto tii	o upproducer
IMPERVIOUS SURFACE AREA/RATIO			
Existing Total Impervious Area	±8,760	_sq. ft.	
Proposed Total Paved Area	±18,580	_sq. ft.	
Proposed Total Impervious Area	±28,160	_sq. ft.	
Proposed Impervious Net Change	±19,400 ±11.5	_sq. ft.	
Impervious surface ratio existing	±36.9	_% of lot	
Impervious surface ratio proposed	±30.9	_% of lot	area
BUILDING AREA/LOT			
COVERAGE	±5,324*	C+	*Existing Building Footprint is based
Existing Building Footprint	· · · · · · · · · · · · · · · · · · ·	_sq. ft.	on information provided by the Auburn
Proposed Building Footprint	±9,400**	_sq. ft.	Maine Advanced Public Parcel Viewer GIS
Proposed Building Footprint Net change	±4,076 ±5,324*	_sq. ft.	**Proposed Building Footprint includes roof overhangs area
Existing Total Building Floor Area	±9,400**	_sq. ft.	***Proposed Total Building Floor Area based
Proposed Total Building Floor Area	±9,014***	_sq. ft.	on First Floor and Mezzanine Floor Area indicated on preliminary Architectural
Proposed Building Floor Area Net Change	±3,690	_sq. ft. _sq. ft	Drawings. This area is subject to change during design development.
New Building	Yes	(yes or n	
Building Area/Lot coverage existing	±7	% of lot	,
Building Area/Lot coverage proposed	±12	% of lot	
ZONING		_ /0 01 100	arca
Existing	T-4.2B		
Proposed, if applicable	N/A		
LAND USE			
Existing	Public Safety Services****		indicated in this table use is based on the
Proposed	Public Safety Services****	Advanced F	ed for Parcel 211-289 on the Auburn Maine Public Parcel Viewer GIS. The proposed use
RESIDENTIAL, IF APPLICABLE			nge. Land use designations for this site ategorized as "public safety services" per the
Existing Number of Residential Units	N/A	City of Aub	urn's Ordinances, section 60-554 form
Proposed Number of Residential Units	N/A	— based code	e use and parking matrix
Subdivision, Proposed Number of Lots	N/A	_	
PARKING SPACES		_	
Existing Number of Parking Spaces	3 (Paved, Unmarked)		
Proposed Number of Parking Spaces	9 (Paved, marked)	_	
Number of Handicapped Parking Spaces	1 (Paved, marked)	_	
Proposed Total Parking Spaces	10 (Paved, marked)	_	
Troposed Total Lanning opaces		_	
ESTIMATED COST OF PROJECT: \$7M			
DELEGATED REVIEW AUTHORITY CHECKLIST			
SITE LOCATION OF DEVELOPMENT AND STORMWA	ATED MANIACEMENI	т	
Existing Impervious Area	±8,760 ±58,800	_sq. ft.	
Proposed Disturbed Area	±28,160	_sq. ft.	
Proposed Impervious Area		_sq. ft.	
1. If the proposed disturbance is greater than one acre, the	n tne аррисапt snau ap	piy ior a i	Maine Construction
General Permit (MCGP) with MDEP.	to 1 1to 2 20 to 20 to 2		and of the co
2. If the proposed impervious area is greater than one acre			
11/16/05, then the applicant shall apply for a MDEP Sto.	rmwater Management I	Permit, Ci	napter 300, with the
City.	atalia amaatan than 2 a	~~~~ ~ i ~~~	1071 but loss than 7
3. If total impervious area (including structures, pavement,			
acres, then the applicant shall apply for a Site Location of			Sity. If more than /
acres then the application shall be made to MDEP unles 4. If the development is a subdivision of more than 20 acres			applicant shall
apply for a Site Location of Development Permit with th shall be made to MDEP unless determined otherwise.	C 511y. 11 11101C 111a11 100	acies iil	л ше аррисации
shan be made to MDET unless determined otherwise.			
TRAFFIC ESTIMATE			
Total traffic estimated in the peak hour-existing	N/A	assenger ca	ar equivalents (PCE)
(Since July 1, 1997)	p	accorder ca	a equivalente (1 OL)
(J J , · · /			
Total traffic estimated in the peak hour-proposed (Since July 1, 199	97) N/A pa	assenger ca	ır equivalents (PCE)

If the proposed increase in traffic exceeds 100 one-way trips in the peak hour then a traffic movement permit will be required.

Regulations	eres / 76,372 Required/Allowed	square feet(sf). <u>Provided</u>	
Min Lot Area	N/A	/ N/A	
Street Frontage	N/A	/ N/A	
Min Front Yard	5 ft, min.	/ ±86 ft	*Existing indicated in this table use is based on the
Min Rear Yard	10 ft, min.	/ ±134 ft	use indicated for Parcel 211-289 on the Auburn Mai Advanced Public Parcel Viewer GIS, The proposed
Min Side Yard	5 ft, min.	/ ±58 ft	use will not change. Land use designations for this
Max. Building Height	3 Story max.	/ 2 Story	site would be categorized as "public safety services" per the City of Auburn's Ordinances, section 60-554
Use Designation	Public Sa	fety Services*	form based code use and parking matrix
Parking Requirement	1 space/ perN/A_s	square feet of floor area	
Total Parking:	10 Spaces		
Overlay zoning districts (if any):	N/A	/	/
Urban impaired stream watershed?	YES/NOIf yes, was	tershed name	

DEVELOPMENT REVIEW APPLICATION SUBMISSION

Submissions shall include fifteen (15) complete packets containing the following materials:

- 1. 5 Full size plans and 10 smaller (no larger than 11" x 17") plans containing the information found in the attached sample plan checklist.
- Application form that is completed and signed by the property owner or designated representative.
 (NOTE: All applications will be reviewed by staff and any incomplete application will not be accepted until all deficiencies are corrected.
- 3. Cover letter stating the nature of the project.
- 4. All written submittals including evidence of right, title and interest.
- 5. Copy of the checklist completed for the proposal listing the material contained in the submitted application.

Refer to the application checklist for a detailed list of submittal requirements.

Г	o '	view	the	City	of	Auburn	Zoning	Ordinance,	go	to:
---	-----	------	-----	------	----	--------	--------	------------	----	-----

www.auburnmaine.gov under City Departments / Planning, Permitting & Code / Subdivisions / Land Use /Zoning Ordinance

I hereby certify that I am the Owner of record of the named property, or that the owner of record authorizes the proposed work and that I have been authorized by the owner to make this application as his/her authorized agent. I agree to conform to all applicable laws of this jurisdiction. In addition, I certify that the City's authorized representative shall have the authority to enter all areas covered by this permit at any reasonable hour to enforce the provisions of the codes applicable to this permit.

This application is for development review <u>only</u>; a Performance Guarantee, Inspection Fee, Building Permit Application and other associated fees and permits will be required prior to construction.

Signature of Applicant	t:		Date:			
1	(Com	1	8	12.1a	.3024	

Caitlin Suhr

From: Eric Cousens < ECousens@auburnmaine.gov>
Sent: Thursday, November 14, 2024 1:01 PM

To: Caitlin Suhr

Subject: Re: [External]Engine 2 Fire Station Site Plan Review Fee

Yes, Caitlin, we can waive the fee for all local permits and site plan reviews except for Plumbing when we get to that stage.

Eric J. Cousens

Director of Planning and Permitting 60 Court Street | Auburn, Maine 04210 | 207.333.6601 X1154 www.auburnmaine.gov

The City of Auburn is subject to statutes relating to public records. E-mail sent or received by City employees are subject to these laws. Senders and receivers of City e-mail should presume that messages are subject to release.



From: Caitlin Suhr < CSuhr@woodardcurran.com>
Sent: Thursday, November 14, 2024 12:43 PM
To: Eric Cousens < ECousens@auburnmaine.gov>

Subject: [External]Engine 2 Fire Station Site Plan Review Fee

You don't often get email from csuhr@woodardcurran.com. <u>Learn why this is important</u> Hi Eric,

We are preparing to submit the Engine 2 Site Plan Review application to the City on December 6, to get on the January 14, 2025 Planning Board meeting agenda.

Can you please confirm that the Site Plan Review application fee would be waived for the project, given that the City is the applicant?

Thank you, Caitlin

Caitlin Suhr, PE

Project Manager | Associate Principal



ATTACHMENT 02: DEVELOPMENT REVIEW CHECKLIST





City of Auburn, Maine

Office of Planning & Permitting
Eric J. Cousens, Director
60 Court Street | Auburn, Maine 04210
www.auburnmaine.gov | 207.333.6601

Development Review Checklist

The following information is required where applicable to be submitted for an application to be complete

PROJECT NAME: Auburn Engine 2 Fire Station

PROPOSED DEVELOPMENT ADDRESS: 180 Main St, Auburn, ME 04210

PARCEL #: 211-289

Required Information		Check when Submitted		Applicable Ordinance
Site Plan		Applicant Staff		
	Owner's Names/Address	Х		
	Names of Development	Х		
	Professionally Prepared Plan	Х		
	Tax Map or Street/Parcel Number	Х		
	Zoning of Property	Х		
	Distance to Property Lines	Х		
	Boundaries of Abutting land	Х		
	Show Setbacks, Yards and Buffers	Х		
	Airport Area of Influence	N/A		
	Parking Space Calcs	Х		
	Drive Openings/Locations	Х		
	Subdivision Restrictions	N/A		
	Proposed Use	Х		
	PB/BOA/Other Restrictions	Х		
	Fire Department Review	Х		
	Open Space/Lot Coverage	Х		

Required Information		Check when S	Check when Submitted	
Landscape Plan		Applicant	Staff	
	Greenspace Requirements	N/A		
	Setbacks to Parking	N/A		
	Buffer Requirements	N/A		
	Street Tree Requirements	N/A		
	Screened Dumpsters	Х		
	Additional Design Guidelines	N/A		
	Planting Schedule	N/A		
Stormwater & Erosion Control Plan		Applicant	Staff	
	Compliance w/ chapter 500	Х		
	Show Existing Surface Drainage	Х		
	Direction of Flow	Х		
	Location of Catch Basins, etc.	Х		
	Drainage Calculations	Х		
	Erosion Control Measures	X		
	Maine Construction General Permit	Х		
	Bonding and Inspection Fees	N/A		
	Post-Construction Stormwater Plan	Х		
	Inspection/monitoring requirements	Х		
Lighting Plan		Applicant	Staff	
	Full cut-off fixtures	X		
	Meets Parking Lot Requirements	Х		
Traffic Information		Applicant	Staff	
	Access Management	Х		
	Signage	Х		
	PCE - Trips in Peak Hour	N/A		

Required Information		Check when Su		Applicable Ordinance
	Vehicular Movements	Х		
	Safety Concerns	Х		
	Pedestrian Circulation	Х		
	Police Traffic	Х		
	Engineering Traffic	Х		
Utility Plan		Applicant	Staff	
	Water	Х		
	Adequacy of Water Supply	Х		
	Water main extension agreement	N/A		
	Sewer	Х		
	Available city capacity	Х		
	Electric	Х		
	Natural Gas	Х		
	Cable/Phone	Х		
Natural Resources		Applicant	Staff	
	Shoreland Zone	Х		
	Flood Plain	Х		
	Wetlands or Streams	Х		
	Urban Impaired Stream	Х		
	Phosphorus Check	Х		
	Aquifer/Groundwater Protection	Х		
	Applicable State Permits	N/A		
	Lake Auburn Watershed	N/A		
	Taylor Pond Watershed	N/A		
Right, Title or Interest		Applicant	Staff	
	Verify	Х		
	Document Existing Easements, Covenants, etc.	Х		

Required Information		Check when S	Check when Submitted	
Technical & Financial Capacity		Applicant	Staff	
	Cost Est./Financial Capacity	Х		
	Performance Guarantee			
State Subdivision Law		Applicant	Staff	
	Verify/Check	N/A		
	Covenants/Deed Restrictions	N/A		
	Offers of Conveyance to City	N/A		
	Association Documents	N/A		
	Location of Proposed Streets & Sidewalks	N/A		
	Proposed Lot Lines, etc.	N/A		
	Data to Determine Lots, etc.	N/A		
	Subdivision Lots/Blocks	N/A		
	Specified Dedication of Land	N/A		
Additional Subdivision Standards		Applicant	Staff	
	Mobile Home Parks	N/A		
	PUD	N/A		
A JPEG or PDF of the proposed site plan		Applicant	Staff	
Final sets of the approved plans shall be submitted digitally to the City, on a CD or DVD, in AutoCAD format R 14 or greater, along with PDF images of the plans for archiving				

ATTACHMENT 03: EVIDENCE OF RIGHT, TITLE & INTEREST



AFTER RECORDING RETURN TO:

Jeffrey B. Herbert, Esq. Jensen Baird Gardner & Henry P.O. Box 4510 Portland, Maine 04112-4510

WARRANTY DEED Maine Statutory Short Form

DLN: 1002440266127

KNOW ALL PERSONS BY THESE PRESENTS that **DIANE LABONTE**, whose address is 160 South Main Street, Auburn, Maine 04210, for consideration paid, grants to the **CITY OF AUBURN**, a municipal corporation existing under the laws of the State of Maine whose address is 60 Court Street, Auburn, Maine 04210, WITH WARRANTY COVENANTS, that certain property located in the City of Auburn, County of Androscoggin and State of Maine, being more particularly described on <u>Exhibit A</u> attached hereto and made a part hereof.

IN WITNESS WHEREOF, Diane Labonte has caused this instrument to be executed and delivered this <u>151</u> day of March, 2024.

WITNESS:

STATE OF MAINE

COUNTY OF CUMBERLAND, ss.

Diane Labonte

March _____, 2024

Then personally appeared the above-named Diane Labonte and acknowledged the foregoing instrument to be her free act and deed.

Before me.

Print Name:

BAS NO. 004965

EXHIBIT A

A certain lot or parcel of land, situated on the easterly side of South Main Street, so-called, in the City of Auburn, County of Androscoggin, and State of Maine, being more particularly bounded and described as follows, to wit:

Beginning at a point on the easterly side of South Main Street at the northwesterly corner of land now or formerly of the Grantee herein (Book 669, Page 170);

Thence, from the Point of Beginning, North 12° 44' 40" East, along the easterly side of South Main Street, a distance of 30.00 feet to a 5/8 inch rebar capped "Buker 2397", to be set;

Thence, South 77° 06' 04" East, along remaining land of the Grantor herein, a distance of 148.76 feet to a 5/8 inch rebar capped "Buker 2397", to be set;

Thence, South 87° 22' 24" East, along said remaining land of the Grantor herein, a distance of 112.15 feet to a 5/8 inch rebar capped "Buker 2397", to be set, on the westerly side of land now or formerly of Robert R. & Diana K. Pontbriand (Book 6469, Page 316);

Thence, South 27° 41' 47" East, along land now or formerly of Pontbriand, a distance of 156.26 feet to a 5/8 inch rebar capped "PLS 1278" on the northwesterly side of land now or formerly of James E. & Steven M. Pollard (Book 6627, Page 324);

Thence, South 31° 24' 15" West, along land now or formerly of Pollard, a distance of 136.36 feet to a 5/8 inch rebar on the northeasterly corner of land now or formerly of JFM No. 3 Corp (Book 7824, Page 274);

Thence, North 77° 10' 05" West, along land now or formerly of JFM No. 3 Corp, a distance of 169.14 feet to a 5/8 inch rebar on the southeasterly corner of other land now or formerly of the Grantee herein (Book 1045, Page 363);

Thence, North 13° 00' 37" East, along said other land now or formerly of the Grantee herein and said land now or formerly of the Grantee herein, a distance of 198.16 feet to a 5/8 inch rebar capped "PLS 1278";

Thence, North 77° 06' 04" West, along said land now or formerly of the Grantee herein, a distance of 148.76 feet to the Point of Beginning.

The above-described parcel of land contains 1.08 acres, more or less.

All bearings are referenced to Maine State Grid, West Zone, NAD 83 and based on a plan entitled, "Plan showing a Standard Boundary Survey & Abutter Conveyance Engine 2 Fire

Station City of Auburn", dated June 9, 2023, made for the City of Auburn, surveyed by Main-Land Development Consultants, Inc.

All Book and Pages refer to the Androscoggin County Registry of Deeds.

Meaning and intending to convey a portion, and only a portion, of a parcel of land conveyed from George E. Richardson and Robert L. Pontbriand, duly appointed and acting as co-personal representatives of the Estate of Fernand L. Pontbriand to James Labonte and Diane Labonte, by a deed dated October 29, 2004, and recorded in Book 6123, Page 131 on November 1, 2004. James Labonte died August 8, 2016, leaving Diane Labonte as the surviving joint tenant.

Know all Men by these Presents.

\$ 2.20 Dec. Rev. Stamps Cancelled

Received

April 1,

That we, Arthur J. Pontbriand and Ida A. Pondbriand, both of Auburn, in the County of Androscoggin and State of Maine
in consideration of one dollar and other valuable consideration paid by
City of Auburn, a municipal corporation located in Androscoggin and State of Maine

the receipt whereof we do hereby acknowledge, do hereby give, grant, bargain, sell, and convey unto the said City of Auburn, its successors been and assigns forever

a certain lot or parcel of land situated in said Auburn, and bounded and described as follows, to wit: Beginning at a point on the easterly line of South Main Street, two hundred (200) feet southerly from the southerly line of land of Wilfred L. Chandler and Velma Chandler; thence southerly one hundred (100) feet by the easterly line of South Main Street; thence easterly at right angles with the easterly line of South Main Street one hundred fifty (150) feet; thence northerly and parallel with the easterly line of South Main Street one hundred (100) feet; thence westerly one hundred fifty (150) feet to the easterly line of South Main Street at the point of beginning.

Being part of the same premises conveyed to us by Katherine M. Small, by deed dated June 23, 1944, and recorded in Book 550, Page 93.

```
have good right to sell and convey the same to the said grantee
          we
to hold as aforesaid; and that we
                                                        heirs shall and will warrant and defend the same to the
                                      and
                                              our
said Grantee, its successors been and assigns forever, against the lawful claims and demands of all persons.
   In Witness Whereof, we the said Arthur J. Pontbriand and Ida A. Pondbriand,
husband and wife, joining in this deed as Grantors, and relinquishing and
conveying our right by descent and all other rights
                                                                           in the above described premises
have hereunto set our
                      handS
                                   and seals
                                                                          day of
in the year of our Lord one thousand nine hundred and fifty-two.
   Signed, Sealed and Delivered in the Presence of
Laureat E. Roy
                                                          Arthur J. Pontbriand
                                                                                        (SEAL)
Laureat E. Roy
                                                          Ida A. Pontbriand
                                                                                        (SEAL)
State of Maine, androscoggin ss.
                                       March 31.
                                                        1952, 1952.
Personally appeared the above named Arthur J. Pontbriand
                       and acknowledged the foregoing instrument to be
                                                                     his
                                                                                       free act and deed.
                                          xobaroex
                                   Before me, Laureat E. Roy, Notary Public
                                                                                      ( SEAL )
```

at 9 o'clock

A. M. and recorded from the original.

19.52

MAINE SHORT FORM WARRANTY DEED

We, BERTRAND L. PONTBRIAND, GERALD R. PONTBRIAND, FERNAND L. PONTBRIAND, being umarried, and LEO P. PONTBRIAND, all of Auburn, County of Androscoggin, State of Maine, and MURIEL BARTASIUS, of Poland, said County and State, for consideration paid, grant to THE INMABITANTS OF THE CITY OF AUBURN, a Municipal Corporation located in the County of Androscoggin and State of Maine, with WARRANTY COVENANTS the land situated in said Auburn, bounded and described as follows:

Beginning at a point on the easterly line of South Main Street at the southwesterly corner of land conveyed by Arthur J. and Ida A. Pontbriand to this grantee by deed dated 1952 and acknowledged on March 31, 1952, recorded in the Androscoggin County Registry of Deeds in Book 669, Page 170; thence the line runs in an easterly direction perpendicular to South Main Street along the southerly line of this grantee a distance of one hundred fifty (150) feet to the southeasterly corner of the land of this grantee; thence the line runs in a southerly direction parallel with South Main Street a distance of ninety-eight (98) feet to a point; thence the line runs in a westerly direction parallel with said southerly line of this grantee a distance of one hundred fifty (150) feet to a point in said line of South Main Street; thence the line runs in a northerly direction along said line of South Main Street ninety-eight (98) feet to the point of beginning.

For the source of title of said Pontbriands, see deed from Katherine M. Small dated June 23, 1944, recorded in said Registry of Deeds in Book 550, Page 93. See also probate records of the estates of said Arthur J. and Ida A. Pontbriand duly recorded in the Androscoggin County Registry of Probate.

ALSO hereby conveying all rights, casements, privileges, and appurtenances belonging to the premises hereinabove described.

CARMEN PONTERIAND, wife of the said BERTRAND L. PONTERIAND, THELMA R. PONTERIAND, wife of the said GERALD R. PONTERIAND, EDWINA D. PONTERIAND, wife of the said LEO P. PONTERIAND, and FRANCIS BARTASIUS, husband of the said MURIEL BARTASIUS, join as grantors and release all rights by descent and all other rights.

WITNESS our	hands and scals	this day	of July, 1	971.	
	,	1.1	7 1	ATTOM	
		(AFUZ)	ellient	LTontera	and for its
			Da 0	O(1000
		k.a.l <u></u>	registed by	Pondo nario	<u> </u>
		1 P P		116614	und
		— 31 /-	<u>emun</u>	- SAULE	Marie San Company

•	• • • • • • • • • • • • • • • • • • • •
	188 des Vanthame (
	m & Musiel Bartasuin
	of Carmon to Ponthriand
·	JAP A. Theling Tout Greater)
	Exe Edura D. Pontorian ()
	of Fruis Bentasuro

STATE OF MAINE ANDROSCOGGIN, SS.

Then personally appeared the above named BERTRAND L. PONTBRIAND and acknowledged the foregoing instrument to be his free act and deed,

Before me,

ANDROSCOGGIN, \$5, 1971 H/5M.P.W. and recorded from the original


ATTACHMENT 04: PERMIT DRAWINGS (BOUND SEPARATELY)



ATTACHMENT 05: GIS PARCEL MAP



ArcGIS Web Map

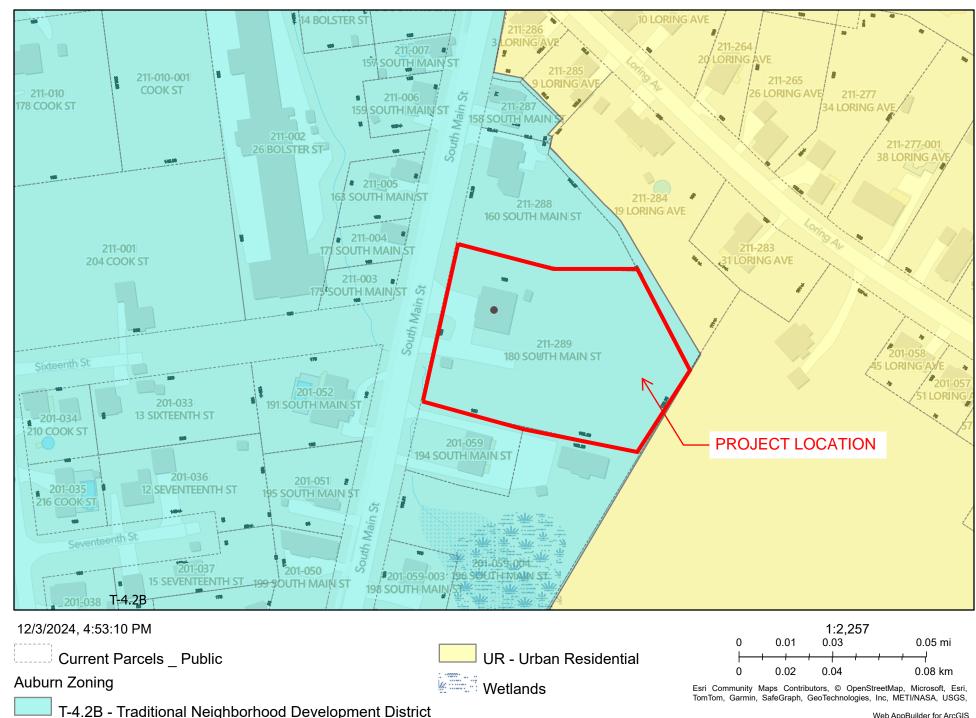

ATTACHMENT 06: LIST OF ABUTTING PROPERTIES





A b	Engline	2	1:445	A builtara	within 500'
Aubulli		Z -	LIST OI	Abullers	WILIIII JUU

Auburn Engine 2 - List of Abutters within 500°								
Parcel ID	Owner	Mailing Address						
211-288	Diane LaBonte	160 S Main St, Auburn, ME 04210						
201-059	JFM No 3 Corp.	800 Center St, Auburn, ME, 04210						
201-059-004	JFM No 3 Corp.	800 Center St, Auburn, ME, 04210						
211-284	Gabriel Fecteau	314 Fletcher Rd, Auburn, ME 04210						
211-282	Matthew M. Fournier	68 Whipple St, Lewiston, ME 04240						
201-052	Richard F. Doyon	191 South Main St, Auburn, ME 04210						
211-003	City of Auburn	60 Court St, Auburn, ME 04210						
211-004	Maurice B. McKenna	171 South Main St, Auburn, ME 04210						
		 						

Contact: Robert Angelo, PE | Project Engineer | rangelo@woodardcurran.com | (978) 482-7804

ATTACHMENT 07: FEMA FIRMETTE



National Flood Hazard Layer FIRMette


250

500

1,000

1,500



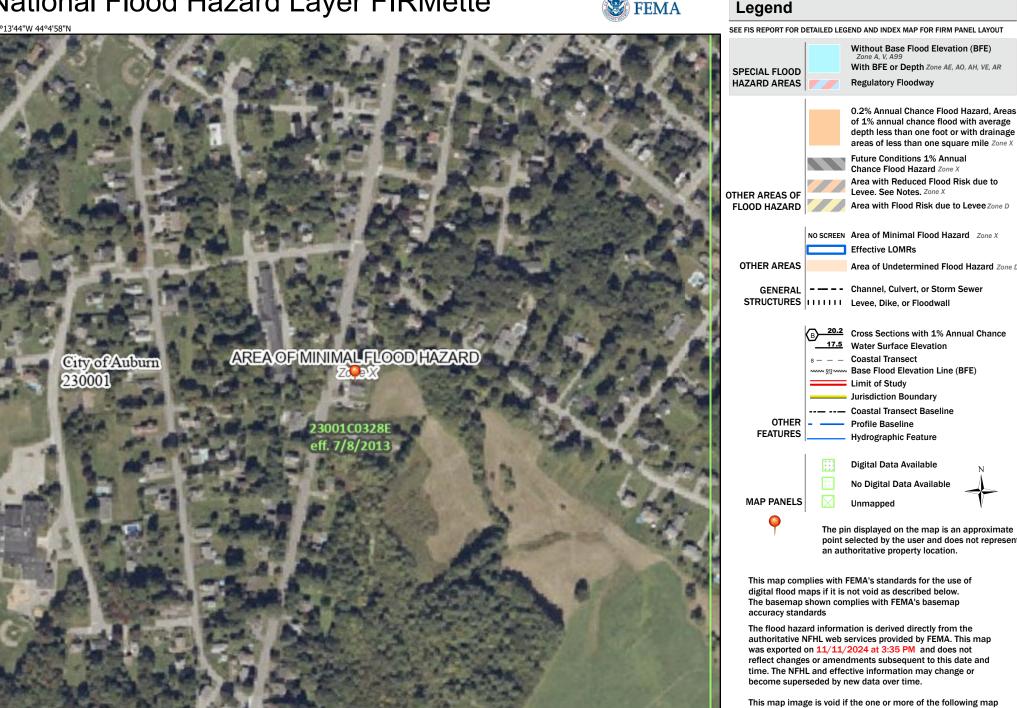

1:6,000

2,000

Area of Undetermined Flood Hazard Zone D

STRUCTURES | LILLI Levee, Dike, or Floodwall

17.5 Water Surface Elevation ₩ 513 W Base Flood Elevation Line (BFE) Jurisdiction Boundary

Coastal Transect Baseline Hydrographic Feature

Digital Data Available

No Digital Data Available

The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 11/11/2024 at 3:35 PM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.

ATTACHMENT 08: STORMWATER MANAGEMENT REPORT





CITY OF AUBURN, MAINE ENGINE 2

DESIGN
DEVELOPMENT
STORMWATER
MANAGEMENT

REPORT

Prepared for: City of Auburn 60 Court Street Auburn, Maine 04210

Prepared By: 12 Mountfort Street Portland, ME 04101 800.426.4262

0233981.13 December 2024

woodardcurran.com



TABLE OF CONTENTS

SEC	SECTION			PAGE NO.	
1.	STORMWATER MANAGEMENT PLAN			2	
	1.1	Exi	sting Co	onditions	2
	1.2	Pro	posed [Development	3
	1.3	Ins	pection	& Maintenance Requirements	4
	1.4		•	r Standards and Applicable Criteria	
		1.4.1	Basic	Standard (Soil Erosion & Sediment Control)	5
		1.4.2		eral Standard (Stormwater Quality)	
		1.4.3		ding Standard (Stormwater Quantity)	
		1	1.4.2.1		
		•	1.4.2.2		

APPENDICES

Appendix A: Watershed Area Plans Appendix B: Geotechnical Information

Appendix C: Stormwater Operations & Maintenance Plan

Appendix D: HydroCAD Calculations



1. STORMWATER MANAGEMENT PLAN

This Stormwater Management Plan (SWMP) describes existing site conditions, the proposed redevelopment, erosion and sediment control measures, inspection and maintenance requirements for the proposed stormwater system, and compliance with applicable stormwater standards for the proposed Engine #2 Public Safety Building located at 180 South Main Street, Auburn, Maine.

1.1 Existing Conditions

The existing Engine #2 facility is a one-story building featuring paved parking and a storage shed containing sand to the south. This property, referred to as the "Site" in both its current and redeveloped conditions, is situated between two residential properties to the north and south. To the east, the Site is bordered by a grass meadow, brushed, and wooded areas, as illustrated in **Figure 1** below.



FIGURE 1: AERIAL IMAGERY FROM APRIL 2023 OF THE SITE, OBTAINED FROM GOOGLE EARTH PRO.

The existing Site consists of several different land cover conditions including pavement, roof, grass, meadow, brush, and wooded area. The Site's topography slopes generally from west to east with the developed portion set at a slightly higher elevation. The existing watershed areas for the Site, which also collect run-on from the abutting properties to the north and east, are generally split by a ridge at the fire apparatus bay driveway. Areas contributing run-on and runoff north of the ridge line are regarded as Existing Watershed Area 1 (EWA-1); Areas contributing stormwater run-on and runoff to the south of the ridge line are regarded as Existing Watershed Area 2 (EWA-2) The existing Site drainage infrastructure consists of a catch basin at the northwest of parcel behind the S Main St curb (Design Point 1, DP-1) and a



drainage ditch (Design Point 2, DP-2) with a culvert serving as the outlet control structure at the southwest of the parcel, both ultimately discharging to the same location west of S Main St.

EWA-1 totals 1.60 acres with multiple surface cover types including such as roofs, impervious pavements, wooded areas, grass, meadows, and brush. The Time of Concentration (Tc) path for EWA-1, resulting in a Tc of 16 minutes, is based on runoff from residential parcels along Loring Avenue which sheet and shallow concentrated flows through wooded areas, meadow, brush, and grass areas that slope gradually from the northeast to the southwest before discharging to DP-1. Once collected at DP-1 the stormwater flows are conveyed through the municipal system along S Main Street before discharging to an outfall west of S Main St across from DP-2.

EWA-2 totals 2.67 acres with multiple surface cover types including roofs, impervious surfaces, wooded areas, grass, meadows, and brush. The Time of Concentration (Tc) path for EWA-2, resulting in a Tc of 19.5 minutes, is also based on runoff from residential parcels at Loring Avenue sheet flow and shallow concentrated flow from Loring Avenue through wooded areas, meadow, brush, and grass areas that slope gradually from the northeast to the southwest before discharging to DP-2. Flows through the culvert at DP-2 are then conveyed and discharged to an outfall west of S Main St.

The existing drainage areas, land cover types, and Time of Concentration paths are shown in more detail on the Existing Watershed Area Plan included in **Appendix A**.

The United States Department of Agriculture (USDA) Natural Resource Conservation Service's (NRCS) Web Soil Survey classifies the existing subsurface soils for EWA-1 and EWA-2 into three main soils. Hartland very fine sandy loam (with a Hydrologic Soils Group B), Lyman-Tunbridge complex (with a Hydrologic Soils Group D), and Scantic silt loam (with a Hydrologic Soils Group D). We understand that the existing in-situ soil includes several different types of stratified soil types, ranging from organic silts to clay, based on geotechnical exploration and assessment performed by SW Cole in 2024. Geotechnical information is provided in **Appendix B**.

1.2 Proposed Development

The proposed redevelopment of the existing Auburn Engine #2 Site includes the construction of a new approximately 8,300-square-foot fire station directly east of the existing building, along with the redevelopment of the surrounding Site. The existing facility will remain in use for the majority of the construction period. Additional Site improvements include a paved wrap-around fire apparatus drive aisle on the north side of the building, designed to allow fire apparatus to enter through the rear entrance and exit at the front, removing the need for turning around to park after emergency calls. The proposed design also includes seven parking spaces on the north side of the building, along with a paved walkway around the building. Additionally, a second entrance is planned for a small parking lot to the right of the emergency vehicle entrance for visitor parking. The new building will have two different roof. The northern most roof above the apparatus bay will be flat and will have a roof drain system that discharges to the site's stormwater system. The southernmost roof above the dormitory area will be sloped without dedicated roof drainage.

Proposed stormwater improvements include the addition of catch basin inlets, drainage manholes, a subsurface detention system with an outlet control structure, and associated storm drain piping. ADS Stormtech SC-800 chambers are proposed for subsurface detention.



The proposed Site will manage stormwater runoff from portions of EWA-1 and EWA-2. Under the redeveloped conditions, these areas conveyed to DP-1 are now referred to as Proposed Watershed Area #1A (PWA-1A) and Proposed Watershed Area #1B (PWA-1B). The stormwater conveyed to DP-2 is now referred to as Proposed Watershed Area #2 (PWA-2).

PWA-1A includes most of the EWA-1 area for flows that will bypass the Site's redevelopment and some periphery portions of the redeveloped area. PWA-1A totals 1.50 acres and consists of multiple surface cover types including roofs, impervious area, wooded areas, grass, meadow, brush, and gravel. The Tc for PWA-1A remains 16.0 minutes, as this remains relatively unchanged to the existing condition.

PWA-1B totals 0.50 acres including 0.10 acres of redeveloped area from EWA-1 and 0.40 acres of redeveloped area from EWA-2. The subcatchment features multiple surface cover types including impervious area, roofs, and grass. Runoff in this subcatchment is collected by deep sump hooded catch basins, conveyed through a closed drainage system, attenuated by the subsurface detention system, and then discharged through the outlet control structure to DP-1. The subsurface detention system's outlet control structure has been designed with a narrow-slotted weir to attenuate flows from the redeveloped area. PWA-1B consists predominantly of impervious areas; therefore the minimum Tc of 6 minutes was assumed

PWA-2 includes most of the EWA-2 flows that will bypass the Site's redevelopment and the southern side of the redevelopment, totaling 2.28 acres. The subcatchment features multiple surface cover types including impervious areas, roofs, wooded areas, grass, meadow, brush, and gravel. Runoff is conveyed via overland flow to the existing drainage ditch and culvert on Site (DP-2). Through the grading adjustments made for the redevelopment of the Site, the new Tc for the sheet flow and shallow concentration flow increases to 20.7 minutes.

The proposed drainage areas, land cover types, and Time of Concentration paths are shown in more detail on the Proposed Watershed Area Plan included in **Appendix A**.

1.3 Inspection & Maintenance Requirements

General inspection and maintenance of stormwater systems will take place during and after construction. During construction, the Contractor will be responsible for inspecting and maintaining the Site, as described in **Section 1.4.1** of this Report. Upon completion of construction, the property owner will be responsible for implementing the Operations and Maintenance Plan for the proposed stormwater system, which is provided in **Appendix C** of this Report.

1.4 Stormwater Standards and Applicable Criteria

The project is required to manage stormwater on the Site in accordance with applicable Maine Department of Environmental Protection (DEP) and City of Auburn regulations. The project will disturb approximately 1.35 acres and result in approximately 0.65 acres of impervious area, inclusive of a net increase of approximately 0.43 acres of impervious area. Therefore, the project will requires compliance with Basic Standards (erosion and sedimentation control) of DEP's Chapter 500 Stormwater Regulations. Anticipated non-stormwater discharges may be on Site including discharges from firefighting activity, vehicle wash water if detergents are not used, dust control runoff, and uncontaminated groundwater dewatering.

The project does not exceed DEP or City of Auburn thresholds for the general standard (stormwater quality treatment) or the flooding standard (stormwater quantity) of DEP Chapter 500 stormwater regulations. The



project is not located within the direct watersheds of Lake Auburn or Taylor Pond; therefore, compliance with the City's phosphorous control standard is not required. The proposed stormwater conveyance system will be sized to convey the 25-year storm and the proposed site has been designed to mitigate peak discharge flow rates for the 25-year storm event to prevent adverse impacts to the downstream stormwater infrastructure in compliance with City of Auburn Code of Ordinances Sec. 46-210(a)(3).

1.4.1 Basic Standard (Soil Erosion & Sediment Control)

A variety of erosion and sediment control measures will be utilized during construction, including but not limited to the following:

- Stabilized construction entrances;
- Up-gradient runoff diversion barriers;
- Downgradient sediment barriers;
- Catch basin inlet protection devices;
- Preservation and maintenance of vegetated areas to the maximum extent possible;
- Temporary stabilization of disturbed areas to be exposed for more than seven days;
- Permanent stabilization of final graded areas;
- Controls for fugitive dust, debris, and other materials; and
- Inspection of all measures until the Site is permanently stabilized.

Structural measures will be installed as shown on the design drawings. Details and specifications for these measures are included on the drawings. All measures will be implemented in accordance with the "Maine Erosion and Sedimentation Handbook for Construction: Best Management Practices". All temporary measures will be installed prior to any earth-disturbing activities and will be removed upon permanent stabilization of the Site. The Contractor will be responsible for implementing and maintaining all erosion and sediment control measures in an effective operating condition during construction. Permanent erosion control measures will include vegetation and pavement. After construction, the Owner will be responsible for inspecting and maintaining the Site as described in **Section 1.3** of this Report.

1.4.2 General Standard (Stormwater Quality)

The project does not exceed DEP or City of Auburn thresholds for the general standard (stormwater quality treatment) of DEP Chapter 500 stormwater regulations. The project is not located within the direct watersheds of Lake Auburn or Taylor Pond; therefore, compliance with the City's phosphorous control standard is not required.

Although not required by local or State stormwater regulations, some water quality treatment measures will be provided, such as deep sump catch basins and pretreatment within the subsurface detention system, are proposed as part of the project to help improve the quality of stormwater runoff in accordance with stormwater management best practices.



1.4.3 Flooding Standard (Stormwater Quantity)

The project does not exceed DEP or City of Auburn thresholds for the general standard or the flooding standard (stormwater quantity) of DEP Chapter 500 stormwater regulations.

The proposed stormwater conveyance system will be sized to convey the 25-year storm and the proposed site has been designed to mitigate peak discharge flow rates for the 25-year storm event to prevent adverse impacts to the downstream stormwater infrastructure in compliance with City of Auburn Code of Ordinances Sec. 46-210(a)(3).

Stormwater models were prepared for the pre-development and post-development Site conditions. Adequate provisions have been made to collect and control stormwater via the subsurface detention system. The following sections describe the stormwater modeling methodology and the results of the HydroCAD analysis.

1.4.2.1 Stormwater Modeling Methodology

Stormwater modeling was completed using the HydroCAD 10.20-5c Stormwater Modeling System by HydroCAD Software Solutions, LLC., which uses TR-20 runoff calculation methodology. The HydroCAD output for both the pre- and post-development models are provided in **Appendix C**. A 24-hour duration and Type III rainfall distribution was applied to the rainfall depths for the 2-year, 5-year, 10-year, and 25-year storm events from Appendix H of the DEPs Chapter 500 Rules.

HydroCAD provides a lookup table for curve number (CN), which is a measure of the retention and runoff properties of various surfaces based on the Hydrological Soil Group (HSG) and land cover type using TR-55 methodology. The Site contains subsurface soils within Hydrologic Soil Group B and D. We understand that the existing in-situ soil for five test borings (B-201 through B-205) include several different types of stratified soil types, ranging from organic silts to clay, based on geotechnical exploration and assessment performed by SW Cole in 2024. Conservatively, we have assumed poor infiltration due to the clay layers in the areas with a corresponding Hydrologic Soils Group of D. The area of each land cover type was delineated utilizing topographical survey information and HydroCAD computed the final CN for each subcatchment based on an area-weighted average.

The Time of Concentration is the time required for runoff to travel from the most hydrologically distant point of a watershed to the point of discharge. The longest hydraulic flow path is partitioned into segments based on flow types, land cover, and slopes. The Tc for each watershed is computed within HydroCAD as the sum of the travel times for each consecutive flow segment along the longest hydraulic flow path. The primary types of flow consist of sheet flow, shallow concentrated flow, and channel flows; sheet flow typically occurs within the first 100-feet of runoff. A minimum Tc of six minutes is typically utilized for urban developed areas that are predominantly impervious.

As previously described, the project area ultimately discharges runoff in two locations; these two discharge points have been utilized as the Design Points for the stormwater analysis:

- Design Point #1: the existing catch basin located on northwest of the Site.
- Design Point #2: the existing ditch at the southwest of the Site.

Existing and proposed drainage patterns and features are shown in the drawings provided in **Appendix A**.



1.4.2.2 Pre- and Post-Development Peak Runoff Rate Results

The table below provides a summary of the peak runoff rates for the 24-hour, 2-, 5-, 10-, and 25-year Type III storm events:

	PEAK RUNOFF RATE (CFS)					
Des	SIGN POINT	2-YEAR STORM	5-YEAR STORM	10-Year Storm	25-YEAR STORM	
	Pre-Development	1.08	1.74	2.35	3.56	
#1	Post-Development	1.03	1.65	2.24	3.51	
	Net Change	-0.05	-0.09	-0.11	-0.05	
	Pre-Development	1.66	2.67	3.62	5.47	
#2	Post-Development	1.60	2.49	3.31	4.90	
	Net Change	-0.06	-0.18	-0.31	-0.57	

The proposed stormwater management system has been designed to maintain current runoff conditions to the maximum extent possible. The table above demonstrates an overall reduction in the net peak runoff rates from the Site during the 2-, 5-, 10- and 25-year storm events.



APPENDIX A: WATERSHED AREA PLANS.







APPENDIX B: GEOTECHNICAL INFORMATION



REPORT - rev. 1

21-0920.1 S

September 16, 2024

Explorations and Geotechnical Engineering Services

Proposed Engine 2 Fire Station Replacement 180 South Main Street Auburn, Maine

Prepared For:

Woodard & Curran, Inc. Attention: Barry Sheff, P.E. 12 Mountfort Street Portland, ME 04101

Prepared By:

S. W. Cole Engineering, Inc. 286 Portland Road Gray, ME 04039 T: 207-657-2866

www.swcole.com | info@swcole.com

TABLE OF CONTENTS

1.0 INTRODUC	TION	1
1.1 Scope an	d Purpose	1
1.2 Site and F	Proposed Construction	1
2.0 EXPLORAT	TION AND TESTING	2
2.1 Exploration	ons	2
2.1.2 Cu	rrent Explorations	2
2.1.2 Pri	or Explorations	2
2.2 Field Tes	ting	3
2.3 Laborator	ry Testing	3
3.0 SUBSURFA	ACE CONDITIONS	3
3.1 Soil and E	Bedrock	3
3.2 Groundwa	ater	4
4.0 EVALUATION	ON AND RECOMMENDATIONS	5
4.1 General F	Findings	5
4.2 Site and S	Subgrade Preparation	6
4.3 Excavation	on and Dewatering	7
4.4 Foundation	ons	8
4.5 Foundation	on Drainage	9
4.6 Slab-On-0	Grade	9
4.7 Entrance	Slabs and Sidewalks	10
4.8 Fill, Backt	fill and Compaction	10
4.9 Weather	Considerations	11
4.10 Paved A	reas	11
4.11 Design F	Review and Construction Testing	12
5.0 CLOSURE.		13
Appendix A	Limitations	
Appendix B	Figures	
Appendix C	Exploration Logs & Key	



21-0920.1 S

September 16, 2024

Woodard & Curran, Inc. Attention: Barry Sheff, P.E. 12 Mountfort Street Portland. ME 04101

Subject: Explorations and Geotechnical Engineering Services – Rev. 1

Proposed Engine 2 Fire Station Replacement

180 South Main Street

Auburn, Maine

Dear Barry:

In accordance with our Agreement, dated April 18, 2024, and Contract Addendum, dated August 1, 2024, we have performed subsurface explorations for the subject project. This report summarizes our findings and geotechnical recommendations and its contents are subject to the limitations set forth in Appendix A.

1.0 INTRODUCTION

1.1 Scope and Purpose

The purpose of our services was to obtain subsurface information at the site in order to develop geotechnical recommendations relative to foundations, earthwork, and pavement associated with the proposed construction. Our scope of services included a review of preliminary phase explorations, design phase explorations, soils laboratory testing, a geotechnical analysis of the subsurface findings, and preparation of this report.

1.2 Site and Proposed Construction

The site is located at 180 South Main Street in Auburn, Maine and is comprised of the existing Engine 2 Fire Station and an undeveloped open field and low laying vegetated areas south and east of the existing station. Existing grades generally rise across the



site to the east, ranging from approximately elevation 252 (project datum) in the southwest corner to elevation 269 feet in the southeast corner.

S. W. Cole Engineering, Inc. (S.W.COLE) provided preliminary explorations and geotechnical engineering services for the prior proposed fire station concept in 2023. Since that time, we understand the proposed development has been revised and now includes a new approximate 8,300 SF fire station with associated paved and landscape areas. We understand the building will be on-grade and single-story except for a partial mezzanine level. High apparatus bays are proposed on the northerly side of the building. We understand a finish floor elevation of 260 feet is proposed, requiring tapered grade-raise fills approaching 3 feet.

Paved access drives and parking areas will be provided on the north, east, and west sides of the proposed building. A retaining wall up to about 3 feet tall is proposed on the edge of the proposed paved area in the northeast corner of the site.

2.0 EXPLORATION AND TESTING

2.1 Explorations

2.1.2 Current Explorations

Five design-phase test borings (B-201 through B-205) were made at the site on May 2 and 3, 2024 by Seaboard Drilling, LLC. These exploration locations were requested by Thornton Tomasetti (project structural engineer) and established in the field by S. W. Cole Engineering, Inc. (S.W.COLE) using measurements from existing site features. Additionally, three Cone Penetration Tests (CPT-1 through CPT-3) were made at the site on August 26, 2024 by Seaboard Drilling, LLC. These explorations were established in the field by S.W.COLE using measurements from existing site features. The approximate exploration locations are shown on the "Exploration Location Plan" attached in Appendix B. Logs of these explorations and a key to the notes and symbols used on the logs are attached in Appendix C. The elevations shown on the logs were estimated based on topographic information shown on the "Exploration Location Plan".

2.1.2 Prior Explorations

Five preliminary-phase test borings (B-101 through B-105) were made at the site on May 16, 2023 by S. W. Cole Explorations, LLC. These exploration locations were



selected and established in the field by S. W. Cole Engineering, Inc. (S.W.COLE) using GPS methods. The approximate exploration locations are shown on the "Exploration Location Plan" attached in Appendix B. Logs of these explorations and a key to the notes and symbols used on the logs are attached in Appendix C.

2.2 Field Testing

The test borings were drilled using a combination of hollow stem auger and cased wash-boring techniques. The soils were sampled at 2 to 5 foot intervals using a split spoon sampler and Standard Penetration Testing (SPT) methods. Pocket Penetrometer Tests (PPT) were performed where stiffer cohesive soils were encountered. Shelby tube sampling and Vane Shear Testing (VST) were attempted where softer cohesive soils were encountered. SPT blow counts, PPT, and VST results are shown on the logs.

The CPT's were made by pushing a Vertek digital cone to collect cone resistance (q_c) , sleeve friction (f_s) , and pore water pressure (u) data. Additionally, shear wave velocity (V_s) testing was performed at approximate 1-meter intervals during CPT advancement. CPT data and shear wave velocity testing results are noted on the CPT logs.

2.3 Laboratory Testing

The soils encountered in the test borings were visually classified. Soil samples obtained from the explorations were returned to our laboratory for further classification and testing. Moisture content test results are noted on the boring logs.

3.0 SUBSURFACE CONDITIONS

3.1 Soil and Bedrock

The test borings encountered a soils profile generally consisting of uncontrolled fill and buried relic organics, or a relatively thick surficial layer of topsoil and organics, overlying native glaciomarine sand, silt, and clay, overlying glacial till and refusal surfaces (probable boulder or bedrock) with depth. The principal soils encountered at the explorations are summarized below. Not all of the strata were encountered at each exploration; refer to the attached boring logs for more detailed subsurface information.



<u>Uncontrolled Fill and Buried Relic Organics</u>: Borings B-202, B-203, and B-204 and CPT-1 encountered uncontrolled fill extending to depths ranging from about 3.5 to 5 feet below ground surface (bgs). The uncontrolled fill consisted of loose brown and gray-brown sand or silt with varying portions of gravel and organics. Underlying the uncontrolled fill, borings B-203 and B-204 encountered layers of buried relic organics up to about 1-foot thick.

<u>Topsoil and Organics</u>: Outside the areas of encountered uncontrolled fill, the remaining explorations encountered a surficial layer of topsoil, organics, and clayey silt with roots up to about 2 feet thick. We anticipate portions of the site were once cultivated for agricultural purposes and, therefore, thicker layers of topsoil and organics may be present.

Glaciomarine Deposits: Underlying the surficial organics, uncontrolled fill, and buried relic organics, the explorations encountered glaciomarine soil deposits. The glaciomarine deposits generally consisted of an upper "crust" of layered sand, silt and, very stiff to stiff brown to gray-brown silty clay which extended to depths of about 10 to 15 feet below ground surface (bgs). Underlying the upper crust, the glaciomarine deposit transitioned to layers of relatively softer gray silty clay with frequent sand seams and layers which extended to depths varying from about 13 to 30 feet bgs.

<u>Glacial Till</u>: Underlying the glaciomarine deposits, borings B-101, B-102, B-103, B-201, B-202, B-203, and B-205 encountered glacial till consisting of loose to very dense, gray to brown, silty sand or silt and sand with varying portions of gravel and cobbles. Rod probing performed at borings B-104 and B-105 and the CPTs also encountered granular soils underlying the glaciomarine deposits.

<u>Refusal Surface</u>: Underlying the glacial till, borings B-103 and B-204, encountered refusal surfaces (probable boulder or bedrock) at depths ranging from about 19 and 22 feet bgs. The CPTs also encountered refusal surfaces at depths ranging from about 19 to 30 feet bgs.

3.2 Groundwater

The soils encountered at the test borings were moist to wet from the ground surface. Saturated soils were encountered at depths varying from 5 to 16 feet. Standing water was present in the lower laying wet areas of the site during the explorations. Groundwater likely becomes perched on the relatively impervious silty clay and glacial till encountered at



the test borings. Long term groundwater information is not available. It should be anticipated that groundwater levels will fluctuate, particularly in response to periods of snowmelt and precipitation, as well as changes in site use.

4.0 EVALUATION AND RECOMMENDATIONS

4.1 General Findings

Based on the subsurface findings, the proposed construction appears feasible from a geotechnical standpoint. The principle geotechnical considerations include:

- The explorations made in the undeveloped portions of the site encountered relatively thick layers of topsoil and organics. We recommend all existing topsoil and organics be removed from beneath the proposed building, paved areas, and retaining wall. Considering the subsurface findings and probable prior agricultural cultivation at the site, the contractor should anticipate a relatively deep stripping and grubbing depth.
- The explorations made around the existing Engine 2 fire station and developed areas of the site encountered layers of uncontrolled fill and buried relic organics which are unsuitable for support of the proposed building and paved areas. We recommend all existing fill, buried relic organics, pavement, utilities, structures, and foundations be removed from beneath the proposed building, pavement, and retaining walls, and backfilled with compacted Granular Borrow.
- The layers of softer gray silty clay underlying the site are compressible under new loading from grade-raise fills, building foundations, and floor slab loads; however, the layers are relatively thin and appears overconsolidated. We recommend that grade-raise fills beneath the building be placed a minimum of 30 days prior to excavating for foundations to help reduce post-construction settlement.
- Spread footing foundations and slab-on-grade floors bearing on properly prepared subgrades appear suitable for the proposed building. Footings should bear on at least 6-inches of compacted Crushed Stone overlying undisturbed native nonorganic soils. On-grade floor slabs in the apparatus bays should bear on at least 6 inches of MaineDOT 703.06 Aggregate Base Type A, overlying at least 12-inches



of compacted Structural Fill, overlying properly prepared subgrades. On-grade floor slabs in less heavily loaded areas should bear on at least 12-inches of compacted Structural Fill overlying properly prepared subgrades.

- Existing uncontrolled fill and buried relic organics should be removed beneath proposed paved areas and backfilled with compacted Granular Borrow.
- Woven geotextile should be provided over pavement subgrades consisting of silty clay, anticipated in proposed cut areas of the site.
- Subgrades across the site will consist of sensitive, wet silts and clays. Earthwork
 and grading activities should occur during drier, non-freezing weather of Spring,
 Summer, and Fall. Rubber tired construction equipment should not operate
 directly on the native clays when wet. Temporary haul roads overlying woven
 geotextile will likely be needed Excavation of bearing surfaces should be
 completed with a smooth-edged bucket to lessen subgrade disturbance.
- Imported Crushed Stone, Structural Fill, and Granular Borrow will be needed for construction; Granular Borrow for Underwater Backfill will be needed over wet subgrades. The site soils are unsuitable for reuse in building and paved areas, but may be suitable for reuse as compacted Common Borrow in landscape areas provided they are at a compactable moisture content at the time of reuse.

4.2 Site and Subgrade Preparation

We recommend that site preparation begin with the construction of an erosion control system to protect adjacent drainage ways and areas outside the construction limits. Organics, roots and topsoil should be completely removed from areas of proposed fill and construction. As much vegetation as possible should remain outside the construction areas to lessen the potential for erosion and site disturbance.

<u>Building Pad and Footings</u>: We recommend topsoil, soils with organics, uncontrolled fill, buried relic organics, pavement, utilities, structures, and foundations be removed from beneath the proposed building and retaining walls and backfilled with compacted Granular Borrow. The extent of removal should extend 1 foot laterally outward from outside edge of perimeter footings for every 1-foot of excavation depth (1H:1V bearing splay). The overexcavated area should be backfilled with compacted Granular Borrow.



As discussed, we recommend grade-raise fills beneath the building be placed a minimum of 30 days prior to excavating for foundations to reduce post-construction settlement due to the underlying silty clay.

We recommend that footings be excavated using a smooth-edged bucket and that footings be underlain by at least 6 inches of compacted Crushed Stone. On-grade floor slabs in the apparatus bays should bear on at least 6 inches of MaineDOT 703.06 Aggregate Base Type A, overlying at least 12-inches of compacted Structural Fill, overlying properly prepared subgrades. On-grade floor slabs in less heavily loaded areas should bear on at least 12-inches of compacted Structural Fill overlying properly prepared subgrades.

<u>Paved and Utilities</u>: Uncontrolled fills and buried relic topsoil should be removed beneath proposed paved areas and backfilled with compacted Granular Borrow. A woven geotextile fabric, such as Mirafi 600X, should be installed over pavement subgrades consisting of native silty clay, anticipated in proposed cut areas.

Beneath pipes and utility structures with soft trench bottoms, we recommend overexcavating with a smooth edged bucket and installing at least 1 foot of Underdrain Sand below customary bedding materials wrapped in geotextile fabric. The depth of customary bedding materials for soft trench bottoms should be at least 12 inches for pipes and 24 inches for structures.

We recommend that stormdrains installed beneath paved areas in the rear of the site where cuts are proposed and silty clay subgrades are anticipated, be designed and installed as MaineDOT Type C Underdrains.

4.3 Excavation and Dewatering

Excavation work will generally encounter uncontrolled fills, buried relic organics, relatively thick surficial layers of topsoil and organics, and sensitive wet silty clay soils. Care must be exercised during construction to limit disturbance of the bearing soils. Earthwork and grading activities should occur during drier, non-freezing weather of Spring, Summer and Fall. Rubber tired construction equipment should not operate directly on the native silts and clays, when wet. Low ground pressure tracked equipment may be needed and temporary haul roads overlying geotextile fabric may be necessary. Final cuts to subgrade



should be performed with a smooth-edged bucket to help reduce strength loss from soil disturbance.

Vibrations from construction should be controlled below threshold limits of 0.5 in/sec for structures, water supply wells and infrastructure within 500 feet of the project site. More restrictive vibration limits may be warranted in specific cases with sensitive equipment, historic structures or artifacts on-site or within close proximity.

Sumping and pumping dewatering techniques should be adequate to control groundwater in excavations. Controlling the water levels to at least one foot below planned excavation depths will help stabilize subgrades during construction. Excavations must be properly shored or sloped in accordance with OSHA Regulations to prevent sloughing and caving of the sidewalls during construction. Care must be taken to preclude undermining adjacent structures, utilities and roadways. The design and planning of excavations, excavation support systems, and dewatering is the responsibility of the contractor.

4.4 Foundations

We recommend the proposed buildings be supported on spread footings founded on at least 6-inches of compacted Crushed Stone bearing on undisturbed, non-organic, native silty clay, or compacted Granular Borrow used to backfill overexcavations overlying undisturbed, non-organic, native silty clay. For foundations bearing on properly prepared subgrades, we recommend the following geotechnical parameters for design consideration:

Geotechnical Parameters for Spread	d Footings and Foundation Walls
Design Frost Depth (100 year AFI)	4.5 feet
Net Allowable Soil Bearing Pressure	2.0 ksf
Base Friction Factor	0.35
Total Unit Weight of Backfill	125 pcf
At-Rest Lateral Earth Pressure Coefficient	0.5
Internal Friction Angle of Backfill	30°
Seismic Soil Site Class	D (IBC 2015 – Shear Wave Velocity)
Estimated Total Settlement	1-inch
Differential Settlement	½-inch



4.5 Foundation Drainage

We recommend an underdrain system be installed on the outside edge of perimeter footings. The underdrain pipe should consist of 4-inch diameter, perforated SDR-35 foundation drain pipe bedded in Crushed Stone and wrapped in non-woven geotextile fabric. The underdrain pipe must have a positive gravity outlet protected from freezing, clogging and backflow. Surface grades should be sloped away from the building for positive surface water drainage.

4.6 Slab-On-Grade

On-grade floor slabs in heated areas may be designed using a subgrade reaction modulus of 100 pci (pounds per cubic inch). On-grade floor slabs in the apparatus bays should bear on at least 6 inches of compacted MaineDOT 703.06 Aggregate Base Type A, overlying at least 12-inches of compacted Structural Fill, overlying properly prepared subgrades. On-grade floor slabs in less heavily loaded areas should bear on at least 12-inches of compacted Structural Fill overlying properly prepared subgrades.. The structural engineer or concrete consultant must design steel reinforcing and joint spacing appropriate to slab thickness and function, as well as cracking and curling.

We recommend a sub-slab vapor retarder particularly in areas of the building where the concrete slab will be covered with an impermeable surface treatment or floor covering that may be sensitive to moisture vapors. The vapor retarder must have a permeance that is less than the floor cover or surface treatment that is applied to the slab. The vapor retarder must have sufficient durability to withstand direct contact with the sub-slab base material and construction activity. The vapor retarder material should be placed according to the manufacturer's recommended method, including the taping and lapping of all joints and wall connections. The architect and/or flooring consultant should select the vapor retarder products compatible with flooring and adhesive materials.

The floor slab should be appropriately cured using moisture retention methods after casting. Typical floor slab curing methods should be used for at least 7 days. The architect or flooring consultant should assign curing methods consistent with current applicable American Concrete Institute (ACI) procedures with consideration of curing method compatibility to proposed surface treatments, flooring and adhesive materials.



4.7 Entrance Slabs and Sidewalks

Entrance slabs and sidewalks adjacent to the building must be designed to reduce the effects of differential frost action between adjacent pavement, doorways, and entrances. We recommend that non-frost susceptible Structural Fill be provided to a depth of at least 4.5 feet below the top of entrance slabs. This thickness of Structural Fill should extend the full footprint of the entrance slab, thereafter transitioning up to the bottom of the adjacent sidewalk or pavement gravels at a 3H:1V or flatter slope.

4.8 Fill, Backfill and Compaction

We recommend the following fill and backfill materials: recycled products must also be tested in accordance with applicable environmental regulations and approved by a qualified environmental consultant.

<u>Common Borrow</u>: Fill to raise grades in landscape areas should be non-organic compactable earth meeting the requirements of 2020 MaineDOT Standard Specification 703.18 Common Borrow.

<u>Granular Borrow</u>: Fill to raise grades in building and paved areas, as well as to repair soft areas, should be sand or silty sand meeting the requirements of 2020 MaineDOT Standard Specification 703.19 Granular Borrow.

<u>Structural Fill</u>: Backfill for foundations, slab base material and material below exterior entrances slabs should be clean, non-frost susceptible sand and gravel meeting the gradation requirements for Structural Fill as given below:

Struct	ural Fill
Sieve Size	Percent Finer by Weight
4 inch	100
3 inch	90 to 100
½ inch	25 to 90
No. 40	0 to 30
No. 200	0 to 6

<u>Underdrain Sand</u>: Sand used for bedding materials in soft trench bottoms should be clean, free-draining sand meeting the requirements of 2020 MaineDOT Standard Specification 703.22 Underdrain Backfill Material Type B.



<u>Crushed Stone</u>: Crushed Stone, used beneath foundations, for pipe bedding, and for underdrain aggregate should be washed ¾-inch crushed stone meeting the requirements of 2020 MaineDOT Standard Specification 703.13 Crushed Stone ¾-Inch.

Reuse of Site Soils: The non-organic on-site soils are unsuitable for reuse in building and paved areas, but may be suitable for reuse as Common Borrow in landscape areas, provided they are at a compactable moisture content at the time of reuse.

<u>Placement and Compaction</u>: Fill should be placed in horizontal lifts and compacted such that the desired density is achieved throughout the lift thickness with 3 to 5 passes of the compaction equipment. Loose lift thicknesses for grading, fill and backfill activities should not exceed 12 inches. We recommend that fill and backfill in building and paved areas be compacted to at least 95 percent of its maximum dry density as determined by ASTM D-1557. Crushed Stone should be compacted with 3 to 5 passes of a vibratory plate compactor having a static weight of at least 500 pounds.

4.9 Weather Considerations

Construction activity should be limited during wet and freezing weather and the site soils may require drying or thawing before construction activities may continue. The contractor should anticipate the need for water to temper fills in order to facilitate compaction during dry weather. If construction takes place during cold weather, subgrades, foundations and floor slabs must be protected during freezing conditions. Concrete and fill must not be placed on frozen soil; and once placed, the concrete and soil beneath the structure must be protected from freezing.

4.10 Paved Areas

We anticipate heavy duty paved areas will be subjected emergency vehicle and fire truck traffic and standard duty paved areas will be subjected to passenger vehicles. Considering the site soils, and proposed usage, we offer the following pavement section for consideration:



FLEXIBLE (HMA) PAVEMENT SECTION - 2	2020 MaineDOT Sta	andard Specs
Pavement Layer	Standard Duty	Heavy Duty
MaineDOT 9.5 mm Hot Mix Asphalt	1 ½ inches	1 ½ inches
MaineDOT 19.0 mm Hot Mix Asphalt	2 ½ inches	3 ½ inches
MaineDOT 703.06 Aggregate Base Type A	6 inches	6 inches
MaineDOT 703.06 Aggregate Subbase Type D	12 inches	18 inches
Woven Geotextile (Mirafi 600X) provide	ed over silty clay su	bgrades

The base and subbase materials should be compacted to at least 95 percent of their maximum dry density as determined by ASTM D-1557. Hot mix asphalt pavement should be compacted to 92 to 97 percent of its theoretical maximum density as determined by ASTM D-2041. A tack coat should be used between successive lifts of bituminous pavement.

It should be understood that frost penetration can be on the order of 4.5 feet in this area. In the absence of full depth excavation of frost susceptible soils below paved areas and subsequent replacement with non-frost susceptible compacted fill, frost penetration into the subgrade will occur and some heaving and distress of pavement must be anticipated.

We recommend that stormdrains installed beneath paved areas in the rear of the site where cuts are proposed and silty clay subgrades are anticipated, be designed and installed as MaineDOT Type C Underdrains.

4.11 Design Review and Construction Testing

S.W.COLE should be retained to review the construction documents prior to bidding to determine that our earthwork, foundation, and pavement recommendations have been properly interpreted and implemented.

A construction materials testing and quality assurance program should be implemented during construction to observe compliance with the design concepts, plans, and specifications. S.W.COLE is available to observe earthwork activities, the preparation of foundation bearing surfaces and pavement subgrades, as well as to provide testing and IBC Special Inspection services for soils, concrete, steel, spray-applied fireproofing, firestopping, structural masonry and asphalt construction materials.



5.0 CLOSURE

It has been a pleasure to be of assistance to you with this phase of your project. We look forward to working with you during the construction phase of the project.

Sincerely,

S. W. Cole Engineering, Inc.

Evan M. Walker, P.E.

Senior Geotechnical Engineer

EMW:tjb

APPENDIX A

Limitations

This report has been prepared for the exclusive use of Woodard & Curran, Inc. for specific application to the proposed Engine 2 Fire Station Replacement at 180 South Main Street in Auburn, Maine. S. W. Cole Engineering, Inc. (S.W.COLE) has endeavored to conduct our services in accordance with generally accepted soil and foundation engineering practices. No warranty, expressed or implied, is made.

The soil profiles described in the report are intended to convey general trends in subsurface conditions. The boundaries between strata are approximate and are based upon interpretation of exploration data and samples.

The analyses performed during this investigation and recommendations presented in this report are based in part upon the data obtained from subsurface explorations made at the site. Variations in subsurface conditions may occur between explorations and may not become evident until construction. If variations in subsurface conditions become evident after submission of this report, it will be necessary to evaluate their nature and to review the recommendations of this report.


Observations have been made during exploration work to assess site groundwater levels. Fluctuations in water levels will occur due to variations in rainfall, temperature, and other factors.

S.W.COLE's scope of services has not included the investigation, detection, or prevention of any Biological Pollutants at the project site or in any existing or proposed structure at the site. The term "Biological Pollutants" includes, but is not limited to, molds, fungi, spores, bacteria, and viruses, and the byproducts of any such biological organisms.

Recommendations contained in this report are based substantially upon information provided by others regarding the proposed project. In the event that any changes are made in the design, nature, or location of the proposed project, S.W.COLE should review such changes as they relate to analyses associated with this report. Recommendations contained in this report shall not be considered valid unless the changes are reviewed by S.W.COLE.

APPENDIX B

Figures

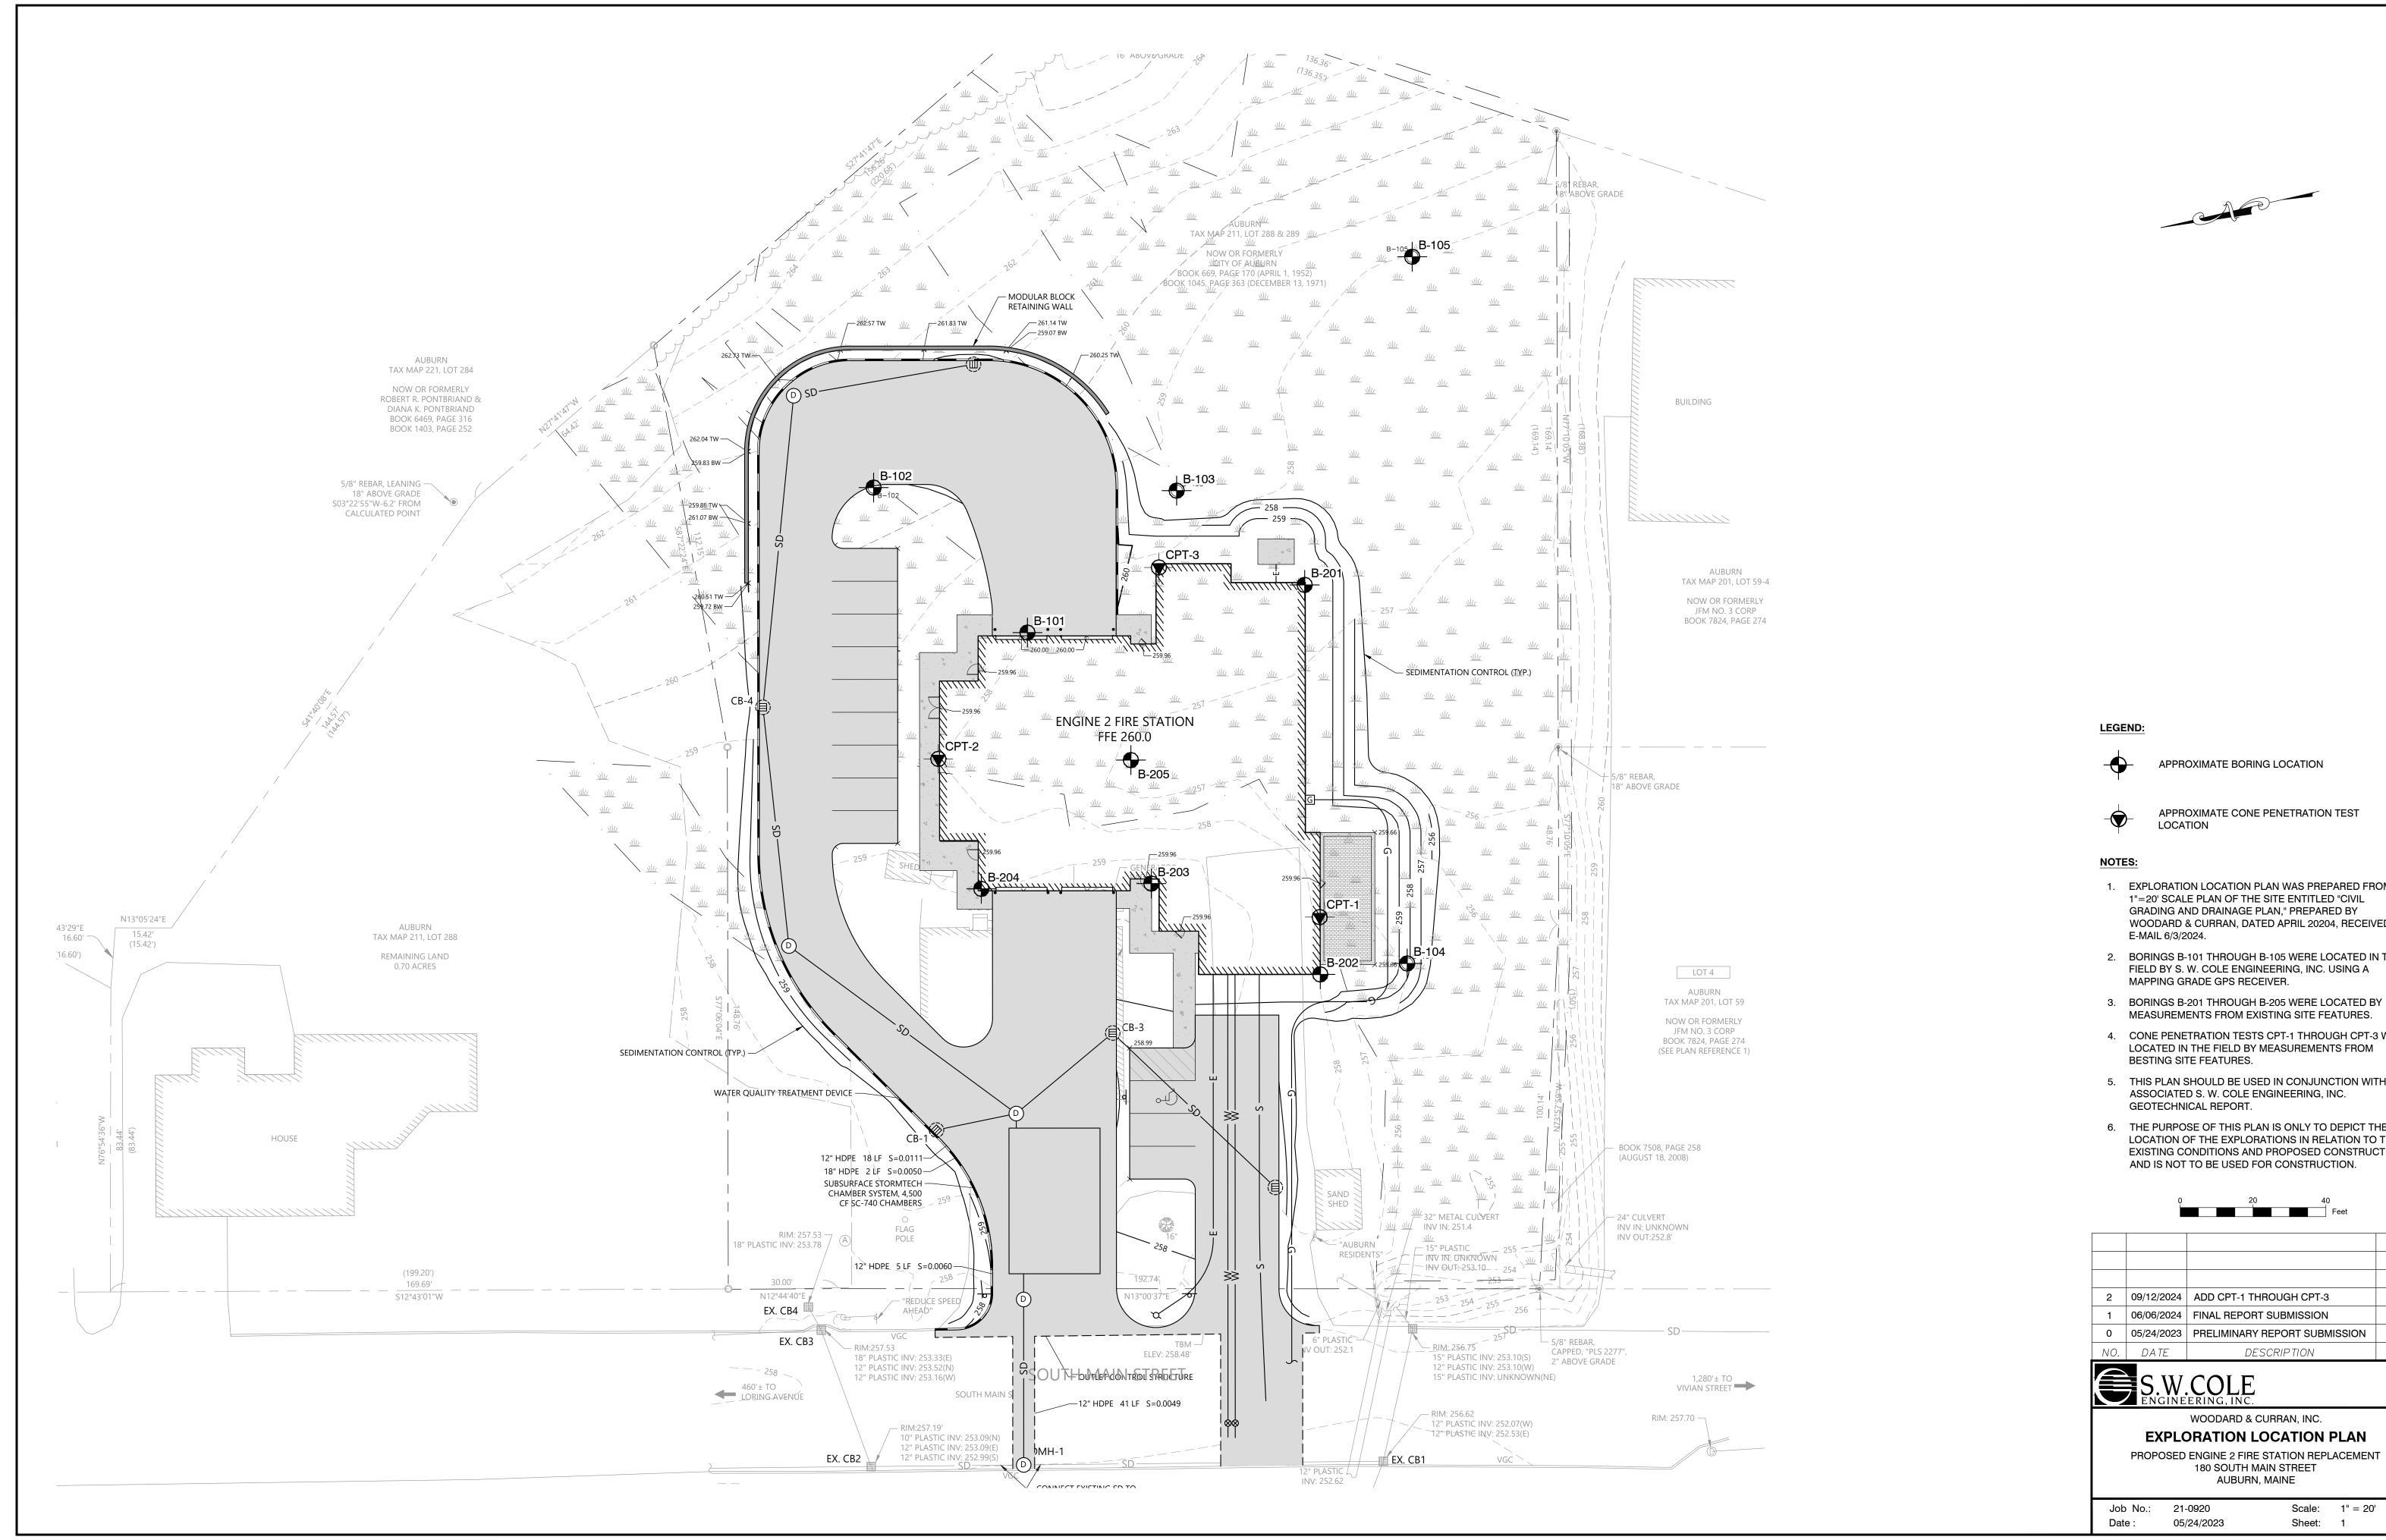

APPROXIMATE BORING LOCATION

APPROXIMATE CONE PENETRATION TEST LOCATION

- 1. EXPLORATION LOCATION PLAN WAS PREPARED FROM A 1"=20' SCALE PLAN OF THE SITE ENTITLED "CIVIL GRADING AND DRAINAGE PLAN," PREPARED BY WOODARD & CURRAN, DATED APRIL 20204, RECEIVED VIA
- 2. BORINGS B-101 THROUGH B-105 WERE LOCATED IN THE FIELD BY S. W. COLE ENGINEERING, INC. USING A MAPPING GRADE GPS RECEIVER.
- MEASUREMENTS FROM EXISTING SITE FEATURES.
- 4. CONE PENETRATION TESTS CPT-1 THROUGH CPT-3 WERE LOCATED IN THE FIELD BY MEASUREMENTS FROM BESTING SITE FEATURES.
- 5. THIS PLAN SHOULD BE USED IN CONJUNCTION WITH THE ASSOCIATED S. W. COLE ENGINEERING, INC. GEOTECHNICAL REPORT.
- 6. THE PURPOSE OF THIS PLAN IS ONLY TO DEPICT THE LOCATION OF THE EXPLORATIONS IN RELATION TO THE EXISTING CONDITIONS AND PROPOSED CONSTRUCTION AND IS NOT TO BE USED FOR CONSTRUCTION.



2	09/12/2024	ADD CPT-1 THROUGH CPT-3	CEM
1	06/06/2024	FINAL REPORT SUBMISSION	CEM
0	05/24/2023	PRELIMINARY REPORT SUBMISSION	CEM
NO.	DATE	DESCRIPTION	BY

WOODARD & CURRAN, INC. **EXPLORATION LOCATION PLAN** PROPOSED ENGINE 2 FIRE STATION REPLACEMENT

AUBURN, MAINE

Job No.: 21-0920 Scale: 1'' = 20'Sheet: 1

APPENDIX C

Exploration Logs and Key



CLIENT: Woodard & Curran, Inc.

PROJECT: Proposed Engine 2 Fire Station Replacement

LOCATION: 180 South Main Street, Auburn, ME

B-201 **BORING NO.:** SHEET: 1 of 1

PROJECT NO. 21-0920.1 DATE START: 5/3/2024

5/3/2024

Drilling Information

LOCATION: See Exploration Location Plan

DRILLING CO.: Seaboard Drilling RIG TYPE: Track Mounted Diedrich D-50

HAMMER TYPE: Automatic / Automatic HAMMER CORRECTION FACTOR:

ELEVATION (FT): 257.5' +/-

DRILLER: Kevin Hanscom

AUGER ID/OD: N/A / N/A HAMMER WEIGHT (lbs): 140 / 140

HAMMER DROP (inch): 30/30

CASING ID/OD: 4 in / 4 1/2 in CORE BARREL:

TOTAL DEPTH (FT): 32.0

SAMPLER: Standard Split-Spoon

DATE FINISH:

DRILLING METHOD: Cased Boring

LOGGED BY: Evan Walker

GENERAL NOTES:

KEY TO NOTES AND SYMBOLS:

D = Split Spoon Sample U = Thin Walled Tube Sample ▼ At Completion of Drilling ▼ After Drilling R = Rock Core Sample V = Field Vane Shear

Pen. = Penetration Length Rec. = Recovery Length bpf = Blows per Foot mpf = Minute per Foot

WOR = Weight of Rods WOH = Weight of Hammer RQD = Rock Quality Designation PID = Photoionization Detector

S_v = Field Vane Shear Strength, kips/sq.ft. qu = Unconfined Compressive Strength, kips/sq.ft

Ø = Friction Angle (Estimated) N/A = Not Applicable

SAMPLE INFORMATION -og Sample H₂0 Depth Elev. Depth Casing Blow Graphic Pen / Pen Description & Remarks Depth Count Field / Lab (ft) Sample /be (ft) (bpf) Rec. Classification No. (ft) or Test Data (in) RQD 1D 0-2 24/24 1-1-3-4 Vegetation / Topsoil Very stiff to stiff, brown, silty CLAY, with 2D 2-4 24/22 3-5-6-7 q_P=6-7 ksf frequent sand seams 255 5 3D 5-7 q_P=3.5-5 ksf 24/22 3-3-4-3 ∇ 4D 7-9 24/24 5-5-4-4 q_p=2-4 ksf 250 8.0 Stiff, gray-brown, silty CLAY 9.0 Medium, gray, silty CLAY 10 5D 10-12 24/20 WOH/12 1-2 Layered, brown and and gray-brown, medium silty CLAY, and loose silty SAND 245 15 6D 15-17 24/22 WOH/18" Medium, gray, silty CLAY, with frequent sand 1 seams 240 19.1 Loose to medium dense, gray, silty SAND, 20 7D 20-22 24/16 5-3-1-4 trace gravel 235 25 8D 25-27 24/15 10-7-12-15 230 30 30.0 9D 30-31.5 18/16 48-46-Very dense, gray, SILT AND SAND, some gravel (Till) Bottom of Exploration at 32.0 feet

Stratification lines represent approximate boundary between soil types, transitions may be gradual. Water level readings have been made at times and under conditions stated. Fluctuations of groundwater may occur due to other factors than those present at the time measurements were made

10-12-2022 21-0920.1.GPJ SWCE TEMPLATE.GDT 7/12/24

30RING / WELL

BORING NO.:



CLIENT: Woodard & Curran, Inc.

PROJECT: Proposed Engine 2 Fire Station Replacement LOCATION: 180 South Main Street, Auburn, ME

B-202 BORING NO.: SHEET: 1 of 1

PROJECT NO. 21-0920.1 DATE START: 5/2/2024 DATE FINISH: 5/2/2024

Drilling Information

LOCATION: See Exploration Location Plan **DRILLING CO.:** Seaboard Drilling

RIG TYPE: Track Mounted Diedrich D-50

HAMMER TYPE: Automatic / Automatic HAMMER CORRECTION FACTOR:

ELEVATION (FT): 258' +/-**DRILLER:** Kevin Hanscom

AUGER ID/OD: N/A / N/A HAMMER WEIGHT (lbs): 140 / 140

HAMMER DROP (inch): 30 / 30

TOTAL DEPTH (FT): 32.0 LOGGED BY: Evan Walker

DRILLING METHOD: Cased Boring SAMPLER: Standard Split-Spoon

CASING ID/OD: 4 in / 4 1/2 in CORE BARREL:

GENERAL NOTES:

KEY TO NOTES AND SYMBOLS:

D = Split Spoon Sample U = Thin Walled Tube Sample ▼ At Completion of Drilling R = Rock Core Sample
▼ After Drilling V = Field Vane Shear

Pen. = Penetration Length Rec. = Recovery Length bpf = Blows per Foot mpf = Minute per Foot

WOR = Weight of Rods WOH = Weight of Hammer RQD = Rock Quality Designation

 S_v = Field Vane Shear Strength, kips/sq.ft. q_U = Unconfined Compressive Strength, kips/sq.ft
 Ø = Friction Angle (Estimated)

PID = Photoionization Detector N/A = Not Applicable

					SAMPL	E INFO	RMATION	N	Вc			
Elev. (ft)	Depth (ft)	Casing Pen. (bpf)	Sample No.	Type	Depth (ft)	Pen./ Rec. (in)	Blow Count or RQD	Field / Lab Test Data	Graphic Log	Sample Description & Classification	H ₂ 0 Depth	Remarks
- - 255 —	-		1D 2D	X	0-2 2-4	24/5 24/1	4-4-3-3 3-3-2-4			Loose, gray-brown, SAND, some gravel, some silt, trace organics (FILL)		
-	- 5 -		3D 4	X	5-7	24/24	4-4-5-6 4-5-5-4	$q_P = 6-9 \text{ ksf}$ $q_P = 5-6 \text{ ksf}$		Very stiff, gray-brown, silty CLAY, with frequent sand seams and layers		
250 —	10		4	X	7-9	24/24				9.0 Stiff, brown, silty CLAY, with frequent sand		
- 245 —	- - -		5D 6	X	10-12 12-14	24/20 24/18	3-3-4-3	$q_P=1-3 \text{ ksf}$ $q_P=1 \text{ ksf}$		Stiff, gray, silty CLAY, with frequent sand seams		
- - -	- - 15		7D \$	X	15-17	24/18	1-1-2-1			Layered, gray, medium silty CLAY and loose silty fine SAND		
240 -	20		8D 5		20-22	24/24	WOH/18"			17.0 Medium, gray, silty CLAY, with occasional sand seams		
235 —	-		() ()	X	20-22	24/24	1					
-	- - 25		1U		25-26.6	19/19				25.0 Loose, gray, SILT AND SAND, trace gravel	-	
230 —	-		9D	X	26.6- 28.6	24/16	4-5-6-6			27.0 Medium dense, gray, SILT AND SAND, trace gravel (Till)		
-	- 30		10D	X	30-32	24/18	8-13- 18-22			Dense, gray, silty SAND, some gravel (Till)		
										Bottom of Exploration at 32.0 feet		

Stratification lines represent approximate boundary between soil types, transitions may be gradual. Water level readings have been made at times and under conditions stated. Fluctuations of groundwater may occur due to other factors than those present at the time measurements were made.

10-12-2022 21-0920.1.GPJ SWCE TEMPLATE.GDT 7/12/24

30RING / WELL

BORING NO.:



CLIENT: Woodard & Curran, Inc.

PROJECT: Proposed Engine 2 Fire Station Replacement

LOCATION: 180 South Main Street, Auburn, ME

B-203 BORING NO.: SHEET: 1 of 1

PROJECT NO. 21-0920.1 DATE START: 5/2/2024 DATE FINISH: 5/2/2024

Drilling Information

LOCATION: See Exploration Location Plan

ELEVATION (FT): 259' +/-**DRILLING CO.:** Seaboard Drilling DRILLER: Kevin Hanscom AUGER ID/OD: N/A / N/A

RIG TYPE: Track Mounted Diedrich D-50 HAMMER WEIGHT (lbs): 140 / 140 HAMMER TYPE: Automatic / Automatic

HAMMER DROP (inch): 30 / 30 HAMMER CORRECTION FACTOR:

DRILLING METHOD: Cased Boring

TOTAL DEPTH (FT): 32.0 LOGGED BY: Evan Walker

SAMPLER: Standard Split-Spoon

CASING ID/OD: 4 in / 4 1/2 in CORE BARREL: N/A

GENERAL NOTES:

KEY TO NOTES AND SYMBOLS:

D = Split Spoon Sample U = Thin Walled Tube Sample ▼ At Completion of Drilling R = Rock Core Sample
▼ After Drilling V = Field Vane Shear

Pen. = Penetration Length Rec. = Recovery Length bpf = Blows per Foot mpf = Minute per Foot

WOR = Weight of Rods WOH = Weight of Hammer PID = Photoionization Detector

 S_v = Field Vane Shear Strength, kips/sq.ft. WOH = Weight of Hammer q_U = Unconfined Compressive Strength, kips/sq.ft RQD = Rock Quality Designation \varnothing = Friction Angle (Estimated)

		-	ı							
					SAMPL	E INFO	RMATION	١	00	
Elev. (ft)	Depth (ft)	Casing Pen. (bpf)	Sample No.	Type	, ,	Pen./ Rec. (in)	Blow Count or RQD	Field / Lab Test Data	Graphic Log	Sample Description & H ₂ 0 Depth Remarks Classification
_			1D	M	0-2	24/16	2-2-2-3		\bowtie	0.5 Vegetation / Topsoil (FILL)
-	_		2D	A	2-4	24/18	2-2-3-4			1.6 Loose, dark, gray-brown, silty SAND, some gravel, trace organics (FILL) Gray-brown and brown, layered, silty CLAY,
255 —	5		3D	M	5-7	24/24	3-3-5-5	q _P =7 ksf		clayey SILT, and silty SAND, trace organics (FILL) 5.2 Loose, gray, clayey SILT, with rootlets
-			4D	A	7-9	24/24	6-7-8-9	q _P =5-5.5 ksf		Gray-brown and brown, layered, very stiff silty CLAY, clayey SILT, and silty fine SAND
250 —	+			Н						
-	10		5D	M	10-12	24/24	5-7-9-6	q _P =7 ksf		Very stiff, brown, silty CLAY, with frequent sand seams
-	†		6D	М	12-14	24/18	5-4-3-2	q_P =0.5 ksf		12.0 Stiff, gray-brown, silty CLAY
245 — - - -	15		7D	A X	15-17	24/24	WOH/18" 4	-		Medium, gray, silty CLAY, with frequent sand seams and layers
240 — - - -	20		8D	X	20-22	24/24	WOH/24"	w =37.8 %		
235 —	_									
-	25		1U		25-27	24/18				25.0 Loose, gray, SILT AND SAND, trace gravel
-	_		1V		27-27	0				
230 —	30		9D	X	30-32	24/18	15-33- 38-46			Very dense, gray, silty SAND, some gravel (Till)
										Bottom of Exploration at 32.0 feet

Stratification lines represent approximate boundary between soil types, transitions may be gradual. Water level readings have been made at times and under conditions stated. Fluctuations of groundwater may occur due to other factors than those present at the time measurements were made.

10-12-2022 21-0920.1.GPJ SWCE TEMPLATE.GDT 7/12/24

30RING / WELL

BORING NO.:



CLIENT: Woodard & Curran, Inc. PROJECT: Proposed Engine 2 Fire Station Replacement

LOCATION: 180 South Main Street, Auburn, ME

B-204 BORING NO.: SHEET: 1 of 1

PROJECT NO. 21-0920.1 DATE START: 5/2/2024 DATE FINISH: 5/2/2024

Drilling Information

LOCATION: See Exploration Location Plan **DRILLING CO.:** Seaboard Drilling

HAMMER CORRECTION FACTOR:

RIG TYPE: Track Mounted Diedrich D-50 HAMMER TYPE: Automatic / Automatic

DRILLER: Kevin Hanscom AUGER ID/OD: N/A / N/A HAMMER WEIGHT (lbs): 140 / 140

ELEVATION (FT): 259' +/-

HAMMER DROP (inch): 30 / 30

TOTAL DEPTH (FT): 22.3 LOGGED BY: Evan Walker DRILLING METHOD: Cased Boring

SAMPLER: Standard Split-Spoon

CASING ID/OD: 4 in / 4 1/2 in CORE BARREL: N/A

GENERAL NOTES:

KEY TO NOTES AND SYMBOLS:

D = Split Spoon Sample U = Thin Walled Tube Sample ▼ At Completion of Drilling R = Rock Core Sample
▼ After Drilling V = Field Vane Shear

Pen. = Penetration Length Rec. = Recovery Length bpf = Blows per Foot mpf = Minute per Foot

WOR = Weight of Rods WOH = Weight of Hammer PID = Photoionization Detector

 S_v = Field Vane Shear Strength, kips/sq.ft. WOH = Weight of Hammer q_u = Unconfined Compressive Strength, kips/sq.ft. RQD = Rock Quality Designation \varnothing = Friction Angle (Estimated)

										- F	pirodbio	
					SAMPL	E INFO	RMATION	١	Log			
Elev. (ft)	Depth (ft)	Casing Pen. (bpf)	Sample No.	Type	Depth (ft)	Pen./ Rec. (in)	Blow Count or RQD	Field / Lab Test Data	Graphic Lo	Sample Description & Classification	H ₂ 0 Depth	Remarks
			1D	M	0-2	24/16	1-1-1-2					
			2D	\bigvee	2-4	24/22	3-3-4-3			Loose, brown and gray-brown, clayey SILT, trace sand, wit rootlets (FILL)		
255 -	_			А					\	Loose, dark gray, clayey SILT, with black		
-	- 5		3D	M	5-7	24/22	3-4-5-5	q _P =6-7 ksf		very stiff, brown, silty CLAY, with frequent		
				M						sand seams	∇	
	_		4D	M	7-9	24/24	5-5-5-5	q _P =4 ksf		7.0 Brown, layered, stiff silty CLAY, and medium dense silty fine SAND	_	
250 —				Н						defice only into 67 a 15		
-	10		5D	X	10-12	24/24	1- 1/12"-1			10.0 Medium, gray, silty CLAY		
-	-		6D	M	12-14	24/20	1-1-1-2					
245 -				М								
	_ 15		7D	\mathbb{H}	15-17	24/18	2-1-1-1			15.0 Loose, brown to gray, silty fine SAND, with		
-	_		''	X	10 17	2 17 10				frequent silty clay seams		
				\Box								
240 -	_											
-	_ 20		8D	H	20-22	24/20 \	NOH/18"	-		20.0 Gray, layered, medium silty CLAY and loose		
-	_			\mathbb{N}			2			silty fine SAND		
			l							Bottom of Exploration at 22.3 feet		

10-12-2022 21-0920.1.GPJ SWCE TEMPLATE.GDT 7/12/24 **30RING / WELL**

Stratification lines represent approximate boundary between soil types, transitions may be gradual. Water level readings have been made at times and under conditions stated. Fluctuations of groundwater may occur due to other factors than those present at the time measurements were made

BORING NO.:



CLIENT: Woodard & Curran, Inc.

PROJECT: Proposed Engine 2 Fire Station Replacement

LOCATION: 180 South Main Street, Auburn, ME

B-205 BORING NO.: SHEET: 1 of 1

PROJECT NO. 21-0920.1 **DATE START:** 5/2/2024 DATE FINISH: 5/2/2024

Drilling Information

LOCATION: See Exploration Location Plan

HAMMER CORRECTION FACTOR:

DRILLING CO.: Seaboard Drilling

RIG TYPE: Track Mounted Diedrich D-50 HAMMER TYPE: Automatic / Automatic

ELEVATION (FT): 257' +/-DRILLER: Kevin Hanscom

AUGER ID/OD: N/A / N/A

HAMMER WEIGHT (lbs): 140 / 140 HAMMER DROP (inch): 30/30

DRILLING METHOD: Cased Boring SAMPLER: Standard Split-Spoon

TOTAL DEPTH (FT): 32.0

CASING ID/OD: 4 in / 4 1/2 in CORE BARREL:

GENERAL NOTES:

KEY TO NOTES AND SYMBOLS:

Water Level □ At time of Drilling ▼ At Completion of Drilling ▼ After Drilling

D = Split Spoon Sample U = Thin Walled Tube Sample R = Rock Core Sample V = Field Vane Shear

Pen. = Penetration Length Rec. = Recovery Length bpf = Blows per Foot mpf = Minute per Foot

WOR = Weight of Rods WOH = Weight of Hammer RQD = Rock Quality Designation

S_v = Field Vane Shear Strength, kips/sq.ft. qu = Unconfined Compressive Strength, kips/sq.ft

LOGGED BY: Evan Walker

Ø = Friction Angle (Estimated) N/A = Not Applicable

PID = Photoionization Detector SAMPLE INFORMATION -og Sample H₂0 Depth Elev. Depth Casing Blow Graphic Pen / Pen Description & Remarks Depth Count Field / Lab Sample /be (ft) (ft) (bpf) Rec. Classification No. (ft) or Test Data (in) RQD 1D 0-2 24/18 1/12 Vegetation / Topsoil 2-2 Loose, gray-brown, clayey SILT AND SAND, 255 2D 2-4 24/20 3-4-4-5 q_P=6-7 ksf with rootlets and organics Very stiff to stiff, brown, silty CLAY, with frequent sand seams 5 3D 5-7 $a_0=5-7 \text{ ksf}$ 24/24 3-5-5-5 w = 24.5 % ∇ 250 4D 7-9 24/24 5-7-7-5 q_P=7 ksf 7.0° Layered, brown, stiff silty CLAY, clayey SILT, and medium dense silty SAND 10 10.0 5D 10-12 WOH-24/24 Medium, gray, silty CLAY, with frequent sand 1/12"-2 w =34.3 % 245 15 6D 15-17 24/20 WOH-Layered, gray, medium silty CLAY and loose 2-1/12 silty SAND 240 20 7D 20-22 24/24 WOH/24 235 Loose, gray, silty SAND, trace gravel 25 8D 25-27 24/24 1-1-5-9 Medium dense to very dense, gray, gravelly 230 silty SAND (Till) 30 9D 30-32 24/24 27-36-46-48

Bottom of Exploration at 32.0 feet

Stratification lines represent approximate boundary between soil types, transitions may be gradual. Water level readings have been made at times and under conditions stated. Fluctuations of groundwater may occur due to other factors than those present at the time measurements were made

SWCE TEMPLATE.GDT 7/12/24

21-0920.1.GPJ

10-12-2022

30RING / WELL

B-205 BORING NO.:



CLIENT: Woodard & Curran, Inc. PROJECT: Proposed Engine 2 Fire Station Replacement

LOCATION: 180 South Main Street, Auburn, ME

B-101 BORING NO.: SHEET: 1 of 1

PROJECT NO. 21-0920 DATE START: 5/16/2023 DATE FINISH: 5/16/2023

Drilling Information

LOCATION: See Exploration Location Plan DRILLING CO.: S. W. Cole Explorations, LLC

RIG TYPE: Track Mounted Mobile Drill B-48

HAMMER TYPE: Automatic HAMMER CORRECTION FACTOR: **ELEVATION (FT):** 258' +/-DRILLER: Matt Bussey

AUGER ID/OD: 2 1/4 in / 5 5/8 in

HAMMER WEIGHT (lbs): 140

SAMPLER: Standard Split-Spoon

TOTAL DEPTH (FT): 25.4

DRILLING METHOD: Hollow Stem Auger CASING ID/OD: N/A /N/A

CORE BARREL:

HAMMER DROP (inch): 30

GENERAL NOTES:

KEY TO NOTES AND SYMBOLS:

▼ At Completion of Drilling
▼ After Drilling

D = Split Spoon Sample U = Thin Walled Tube Sample R = Rock Core Sample V = Field Vane Shear

Pen. = Penetration Length Rec. = Recovery Length bpf = Blows per Foot mpf = Minute per Foot

WOR = Weight of Rods WOH = Weight of Hammer RQD = Rock Quality Designation PID = Photoionization Detector

 S_v = Field Vane Shear Strength, kips/sq.ft. q_U = Unconfined Compressive Strength, kips/sq.ft \emptyset = Friction Angle (Estimated)

LOGGED BY: Evan Walker

N/A = Not Applicable

				SAMPL	E INFO	RMATION	١	Log			
Elev. (ft)	Depth (ft)	Casing Pen. (bpf)	No.	(11)	Pen./ Rec. (in)	Blow Count or RQD	Field / Lab Test Data	Graphic	Classification	H₂0 Depth	Remarks
- 255 — -	- 5		1D 2D 3D 7	0-2 2-4 7 5-7	24/18 24/22 24/22	4-6-7- 11 4-3-4-6	q_p =6 to 9 ksf q_p =5 to 6 ksf	1 /y	0.5— Vegetation / Topsoil Damp, loose, gray-brown, clayey SILT, some 2.0— fine sand, with roots and organics Damp, very stiff to stiff, brown, silty CLAY, with frequent sand seams and layers		
250 — 	10		4D 5D	10-12	24/24	1-2-1-3			Wet to Saturated, varved, medium gray silty CLAY, loose gray-brown silty fine SAND, and loose SILT AND FINE SAND, some clay	∇	
-	15		6D 7	15-17	24/22	WOH- 1-2-2			15.0 Saturated, stiff to medium, gray, silty CLAY, with frequent sand seams and layers		
240	20		7D	20-22	24/20	2-1-1-5			18.0 Saturated, loose to medium dense, gray, SILT AND SAND, trace gravel (Till)		
-	25		8D≥	<	5/4	50/5" ,			Bottom of Exploration at 25.4 feet		

Stratification lines represent approximate boundary between soil types, transitions may be gradual. Water level readings have been made at times and under conditions stated. Fluctuations of groundwater may occur due to other factors than those present at the time measurements were made.

BORING NO.: **B-101**

10-12-2022 21-0920.GPJ SWCE TEMPLATE.GDT 7/12/24 **30RING / WELL**



CLIENT: Woodard & Curran, Inc. PROJECT: Proposed Engine 2 Fire Station Replacement

LOCATION: 180 South Main Street, Auburn, ME

B-102 BORING NO.: SHEET: 1 of 1

PROJECT NO. 21-0920 DATE START: 5/16/2023 DATE FINISH: 5/16/2023

Drilling Information

LOCATION: See Exploration Location Plan DRILLING CO.: S. W. Cole Explorations, LLC

RIG TYPE: Track Mounted Mobile Drill B-48

HAMMER TYPE: Automatic HAMMER CORRECTION FACTOR:

ELEVATION (FT): 261' +/-DRILLER: Matt Bussey

AUGER ID/OD: 2 1/4 in / 5 5/8 in

HAMMER WEIGHT (lbs): 140 HAMMER DROP (inch): 30

DRILLING METHOD: Hollow Stem Auger SAMPLER: Standard Split-Spoon

TOTAL DEPTH (FT): 21.3

CASING ID/OD: N/A /N/A

CORE BARREL:

GENERAL NOTES:

KEY TO NOTES AND SYMBOLS:

D = Split Spoon Sample U = Thin Walled Tube Sample ▼ At Completion of Drilling R = Rock Core Sample
▼ After Drilling V = Field Vane Shear

Pen. = Penetration Length Rec. = Recovery Length bpf = Blows per Foot mpf = Minute per Foot

WOR = Weight of Rods PID = Photoionization Detector

 S_v = Field Vane Shear Strength, kips/sq.ft. WOH = Weight of Hammer q_U = Unconfined Compressive Strength, kips/sq.ft. RQD = Rock Quality Designation \emptyset = Friction Angle (Estimated)

LOGGED BY: Evan Walker

N/A = Not Applicable

					SAMPL	E INFO	RMATIO	N	Log	
Elev. (ft)	Depth (ft)	Casing Pen. (bpf)	Sample No.	Type	Depth (ft)	Pen./ Rec. (in)	Blow Count or RQD	Field / Lab Test Data	Graphic Lo	Sample Description & H ₂ 0 Depth Classification Remarks
260 -	-		1D 2D	X	0-2 2-4	24/20 24/22	1-3-3-5 4-6-5-7	q _P =7 ksf q _P =5 to 6 ksf	\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\	Vegetation / Topsoil 1.0 Moist, very stiff, brown, silty CLAY, with roots 2.0 Damp, very stiff to stiff, brown, silty CLAY, with frequent sand seams and layers
255 — -	5		3D	X	5-7	24/24	2-3-3-3	q_p =2 to 5 ksf		
250 -	10		4D 5D	X	10-12 12-14	24/18 24/24	1/12"- 1-1 1-2-1-1	q_P =0.5 to 1 ksf q_P =0.5 ksf		10.0 Wet to saturated, brown to gray, varved medium silty CLAY and loose silty fine SAND 12.0 Saturated, medium, gray, silty CLAY, with frequent sand seams
245 — -	15		6D	X	15-17	24/16	5-1-2- 17			14.5 Saturated, gray to rust-brown, silty SAND, some gravel, with occasional cobbles (Till)
240 -	20		7D	X	20-22	24/16	18-41- 50			Bottom of Exploration at 21.3 feet

Stratification lines represent approximate **30RING / WELL** boundary between soil types, transitions may be gradual. Water level readings have been made at times and under conditions stated. Fluctuations of groundwater may occur due to other factors than those present at the time measurements were made

BORING NO.:



CLIENT: Woodard & Curran, Inc.

PROJECT: Proposed Engine 2 Fire Station Replacement

LOCATION: 180 South Main Street, Auburn, ME

B-103 BORING NO.: SHEET: 1 of 1

PROJECT NO. 21-0920 DATE START: 5/16/2023 DATE FINISH: 5/16/2023

Drilling Information

LOCATION: See Exploration Location Plan

DRILLING CO.: S. W. Cole Explorations, LLC

RIG TYPE: Track Mounted Mobile Drill B-48

HAMMER TYPE: Automatic HAMMER CORRECTION FACTOR: **ELEVATION (FT):** 258.5' +/-

DRILLER: Matt Bussey

AUGER ID/OD: 2 1/4 in / 5 5/8 in HAMMER WEIGHT (lbs): 140

HAMMER DROP (inch): 30

SAMPLER: Standard Split-Spoon

DRILLING METHOD: Hollow Stem Auger

TOTAL DEPTH (FT): __19.1___

CASING ID/OD: N/A /N/A

CORE BARREL:

WATER LEVEL DEPTHS (ft):

□ 10 ft Soils Damp to Moist from Surface, Wet to Saturated Below 10' +/-

GENERAL NOTES:

KEY TO NOTES AND SYMBOLS:

D = Split Spoon Sample U = Thin Walled Tube Sample ▼ At Completion of Drilling R = Rock Core Sample

Pen. = Penetration Length Rec. = Recovery Length bpf = Blows per Foot mnf = Minute per Foot

WOR = Weight of Rods $\begin{tabular}{lll} WOH = Weight of Hammer & q_U = Unconfined Compressive Strength, kips/sq.ft. \\ RQD = Rock Quality Designation & \varnothing = Friction Angle (Estimated) \\ \end{tabular}$

 S_v = Field Vane Shear Strength, kips/sq.ft.

LOGGED BY: Evan Walker

PID = Photoionization Detector

		▼ Af	ter Drilling			V = Field \	/ane Shear	mpf =	Minu	e per Foot PID = Photoionization Detector N/A = Not Applicable
					SAMPL	E INFO	RMATION	N	Log	
Elev. (ft)	Depth (ft)	Casing Pen. (bpf)	No.	Type	()	Pen./ Rec. (in)	Blow Count or RQD	Field / Lab Test Data	Graphic Lo	Sample Description & H ₂ 0 Depth Remarks Classification
255 -	- - - - - -		1D 2D	X	0-2 2-4	24/24	1-3-3-6 5-7-7- 10	q _P =7 ksf	\(\frac{1}{2}\frac{1}{	Vegetation / Topsoil 1.3 Moist, stiff, brown, silty CLAY, with roots Damp to wet, very stiff to stiff, brown, silty CLAY, with frequent sand seams
250 -	5		3D	X	5-7	24/24	4-3-5-6	q _P =6 to 7 ksf		
245 –	10		4D	X	10-12	24/24	1-1-2-2	q _P =1 to 1.5 ksf		10.5 Wet to saturated, stiff, gray, silty CLAY, with frequent sand seams and layers 12.5 Medium dense, gray, SILT AND SAND, some
240 -	- - 15 - -		5D	X	15-17	24/24	10-7-7- 6			gravel (Till)
240	_									Refusal at 19.1 feet

Probable Boulder or Bedrock

Stratification lines represent approximate **30RING / WELL** boundary between soil types, transitions may be gradual. Water level readings have been made at times and under conditions stated. Fluctuations of groundwater may occur due to other factors than those present at the time

measurements were made

BORING NO.: **B-103**

S.W.COLE

CLIENT: Woodard & Curran, Inc.

PROJECT: Proposed Engine 2 Fire Station Replacement

LOCATION: 180 South Main Street, Auburn, ME

B-104 BORING NO.: SHEET: 1 of 1

PROJECT NO. 21-0920 DATE START: 5/16/2023 DATE FINISH: 5/16/2023

Drilling Information

LOCATION: See Exploration Location Plan

DRILLING CO.: S. W. Cole Explorations, LLC

RIG TYPE: Track Mounted Mobile Drill B-48

HAMMER TYPE: Automatic HAMMER CORRECTION FACTOR:

ELEVATION (FT): 257' +/-DRILLER: Matt Bussey

AUGER ID/OD: 2 1/4 in / 5 5/8 in

HAMMER WEIGHT (lbs): 140

HAMMER DROP (inch): 30

WATER LEVEL DEPTHS (ft):

□ 10 ft Soils Damp to Moist from Surface, Saturated Below 10' +/-

GENERAL NOTES:

KEY TO NOTES AND SYMBOLS:

D = Split Spoon Sample U = Thin Walled Tube Sample ▼ At Completion of Drilling R = Rock Core Sample
▼ After Drilling V = Field Vane Shear

Pen. = Penetration Length Rec. = Recovery Length bpf = Blows per Foot mpf = Minute per Foot

WOR = Weight of Rods WOH = Weight of Hammer RQD = Rock Quality Designation

CASING ID/OD: N/A /N/A

 S_v = Field Vane Shear Strength, kips/sq.ft. q_U = Unconfined Compressive Strength, kips/sq.ft Ø = Friction Angle (Estimated)

CORE BARREL:

PID = Photoionization Detector N/A = Not Applicable

DRILLING METHOD: Hollow Stem Auger

SAMPLER: Standard Split-Spoon

TOTAL DEPTH (FT): 29.9 LOGGED BY: Evan Walker

		Casing Pen. (bpf)			SAMPL	E INFO	RMATION	1	Graphic Log	
Elev. [ft)	Depth (ft)		No.	Type	(ft) R	Pen./ Rec. (in)	Blow Count or RQD	Field / Lab Test Data		Sample Description & H ₂ 0 Depth Remarks Classification
255 — - -	- 5		1D 2D	X	0-2 2-4	24/24	4-7-7-9		1 1/2 1 1/2 1 1 1/2	0.5 Vegetation / Topsoil Damp, stiff, brown, silty CLAY, with roots 2.0 Damp to moist, very stiff, brown, silty CLAY, with frequent sand seams and layers
250 — - - -	10		3D 4D	X	5-7 10-12	24/22 24/24	3-2-3-2 1-1-1-2			10.0 Saturated stiff gray brown silty CLAV with
245 — - - -			5D	X		·				11.0 frequent sand seams Saturated, stiff to medium, gray, silty CLAY, with frequent sand seams
240 — - - -	20		טפ	X	15-17	24/20	1-2-2-1			Saturated, loose, gray, silty fine SAND, with frequent silty clay seams and layers ROD PROBE Depth Resistance Interpreted Soil Type 17-29.5 HYD Silty Clay
235	25									
-										ROD PROBE Depth Resistance Interpreted Soil Type 29.5-29.9 50 Granular Soils Bottom of Exploration at 29.9 feet

Stratification lines represent approximate boundary between soil types, transitions may be gradual. Water level readings have been made at times and under conditions stated. Fluctuations of groundwater may occur due to other factors than those present at the time measurements were made.

BORING NO.:

B-104

10-12-2022 21-0920.GPJ SWCE TEMPLATE.GDT 7/12/24 **30RING / WELL**



CLIENT: Woodard & Curran, Inc.

PROJECT: Proposed Engine 2 Fire Station Replacement

LOCATION: 180 South Main Street, Auburn, ME

B-105 BORING NO.: SHEET: 1 of 1

PROJECT NO. 21-0920 DATE START: 5/16/2023 DATE FINISH: 5/16/2023

Drilling Information

LOCATION: See Exploration Location Plan DRILLING CO.: S. W. Cole Explorations, LLC

RIG TYPE: Track Mounted Mobile Drill B-48

HAMMER TYPE: Automatic HAMMER CORRECTION FACTOR: **ELEVATION (FT):** 258' +/-

DRILLER: Matt Bussey

AUGER ID/OD: 2 1/4 in / 5 5/8 in

HAMMER WEIGHT (lbs): 140

HAMMER DROP (inch): 30

GENERAL NOTES:

KEY TO NOTES AND SYMBOLS:

D = Split Spoon Sample U = Thin Walled Tube Sample ▼ At Completion of Drilling R = Rock Core Sample
▼ After Drilling V = Field Vane Shear

Pen. = Penetration Length Rec. = Recovery Length bpf = Blows per Foot mpf = Minute per Foot

WOR = Weight of Rods WOH = Weight of Hammer

CASING ID/OD: N/A /N/A

 S_v = Field Vane Shear Strength, kips/sq.ft. WOH = Weight of Hammer q_u = Unconfined Compressive Strength, kips/sq.ft. RQD = Rock Quality Designation \varnothing = Friction Angle (Estimated)

PID = Photoionization Detector N/A = Not Applicable

CORE BARREL:

TOTAL DEPTH (FT): 23.0 LOGGED BY: Evan Walker

DRILLING METHOD: Hollow Stem Auger

SAMPLER: Standard Split-Spoon

					SAMPL	E INFO	RMATION	١	Log	
Elev. De (ft)	epth (ft)	Casing Pen. (bpf)	Sample No.	Type	Depth (ft)	Pen./ Rec. (in)	Blow Count or RQD	Field / Lab Test Data	Graphic Lo	Sample Description & H ₂ 0 Depth Classification H ₂ 0 Depth Remarks
+			1D	M	0-2	24/22	WOH/12" 3-5	-	13 12 13 12	Vegetation / Wet, dark brown, clayey SILT, with roots and organics
255 —			2D		2-4	24/24	5-6-7-9	q _P =6 to 7 ksf	7.7.	Wet, stiff, gray-brown, silty CLAY, with roots Moist to wet, very stiff, gray-brown, silty CLAY, with frequent sand seams and layers
+	5		3D	X	5-7	24/20	3-3-3-5	q _P =4 to 6 ksf		Wet, very stiff to stiff, gray-brown, silty CLAY, with frequent sand seams and layers
250 —	10		4D	X	10-12	24/16	4-3-4-2			Wet to saturated, varved, loose brown gravelly silty SAND, loose brown silty fine sand, and stiff brown silty CLAY
245 — + + + + + + + + + + + + + + + + + +	15		5D	X	15-17	24/24	1-1-1-2			Saturated, varved, loose gray silty fine SAND, and medium gray silty CLAY ROD PROBE Depth Resistance Interpreted Soil Type 17-21 HYD Silty Clay
235	20									21.0 ROD PROBE Depth Resistance Interpreted Soil Type 21-22 52 Granular Soils 22-23 68 Bottom of Exploration at 23.0 feet

Stratification lines represent approximate

10-12-2022 21-0920.GPJ SWCE TEMPLATE.GDT 7/12/24

30RING / WELL

boundary between soil types, transitions may be gradual. Water level readings have been made at times and under conditions stated. Fluctuations of groundwater may occur due to other factors than those present at the time measurements were made

BORING NO.: **B-105**

KEY TO NOTES & SYMBOLS <u>Test Boring and Test Pit Explorations</u>

Stratification lines represent the approximate boundary between soil types and the transition may be gradual.

Key to Symbols Used:

w - water content, percent (dry weight basis)

qu - unconfined compressive strength, kips/sq. ft. - laboratory test

 S_{v} - field vane shear strength, kips/sq. ft. L_v - lab vane shear strength, kips/sq. ft.

qp - unconfined compressive strength, kips/sq. ft. – pocket penetrometer test

O - organic content, percent (dry weight basis)

W_L - liquid limit - Atterberg test
 W_P - plastic limit - Atterberg test
 WOH - advance by weight of man
 WOR - advance by weight of rods

HYD - advance by force of hydraulic piston on drill

RQD - Rock Quality Designator - an index of the quality of a rock mass.

 γ_T - total soil weight γ_B - buoyant soil weight

Description of Proportions: Description of Stratified Soils

Parting: 0 to 1/16" thickness

Trace: 0 to 5% Seam: 1/16" to 1/2" thickness

Some: 5 to 12% Layer: ½" to 12" thickness

"Y" Alternating seams or let

"Y" 12 to 35% Varved: Alternating seams or layers
And 35+% Occasional: one or less per foot of thickness
With Undifferentiated Frequent: more than one per foot of thickness

REFUSAL: <u>Test Boring Explorations</u> - Refusal depth indicates that depth at which, in the drill foreman's opinion, sufficient resistance to the advance of the casing, auger, probe rod or sampler was encountered to render further advance impossible or impracticable by the procedures and equipment being used.

REFUSAL: Test Pit Explorations - Refusal depth indicates that depth at which sufficient resistance to the advance of the backhoe bucket was encountered to render further advance impossible or impracticable by the procedures and equipment being used.

Although refusal may indicate the encountering of the bedrock surface, it may indicate the striking of large cobbles, boulders, very dense or cemented soil, or other buried natural or man-made objects or it may indicate the encountering of a harder zone after penetrating a considerable depth through a weathered or disintegrated zone of the bedrock.


SEABOARD DRILLING

COMPANY: Seaboard Drilling PROJECT: Proposed Engine 2 Fire Station SITE: 180 South Main Street LOCATION: Auburn, ME OPERATOR: Kevin Hanscom

CPT-1

FILENAME: CPT-101.DAT

TEST ID: CPT-1 TEST DATE: Mon 26/Aug/2024 GROUND SURFACE ELEV.: 000 +/-TOTAL DEPTH: 29.659 ft

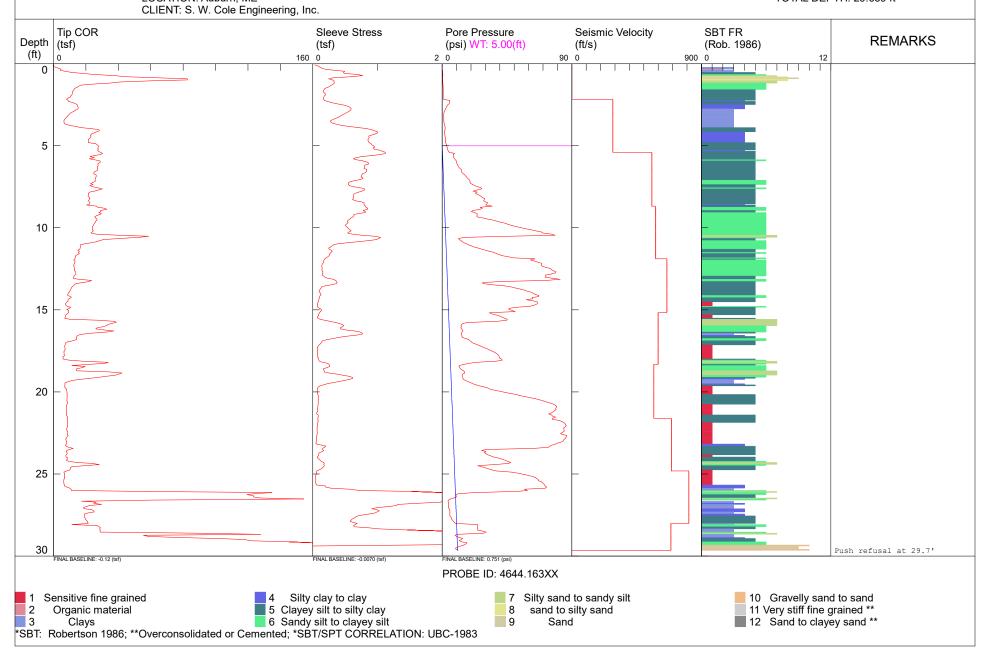


SEAB@ARD
DRILLING

COMPANY: Seaboard Drilling PROJECT: Proposed Engine 2 Fire Station SITE: 180 South Main Street LOCATION: Auburn, ME OPERATOR: Kevin Hanscom

CPT-2

FILENAME: CPT-102 .DAT

TEST ID: CPT-2 TEST DATE: Mon 26/Aug/2024 GROUND SURFACE ELEV.: 000 +/-TOTAL DEPTH: 25.476 ft

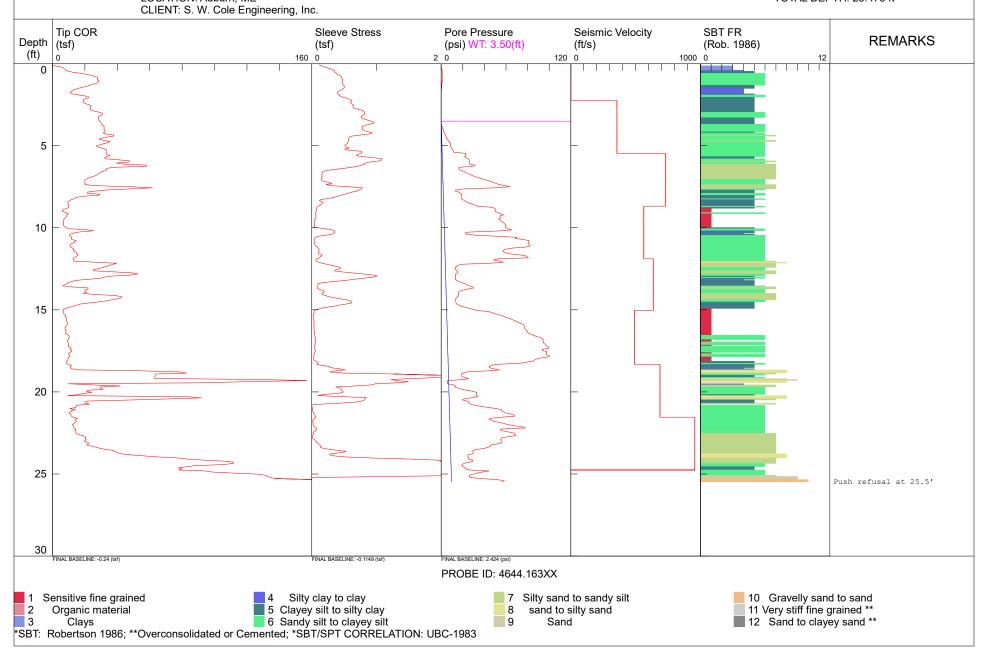


SEAB@ARD
DRILLING


COMPANY: Seaboard Drilling PROJECT: Proposed Engine 2 Fire Station SITE: 180 South Main Street LOCATION: Auburn, ME OPERATOR: Kevin Hanscom

CPT-3

FILENAME: CPT-103.DAT

TEST ID: CPT-3 TEST DATE: Mon 26/Aug/2024 GROUND SURFACE ELEV.: 000 +/-TOTAL DEPTH: 18.783 ft

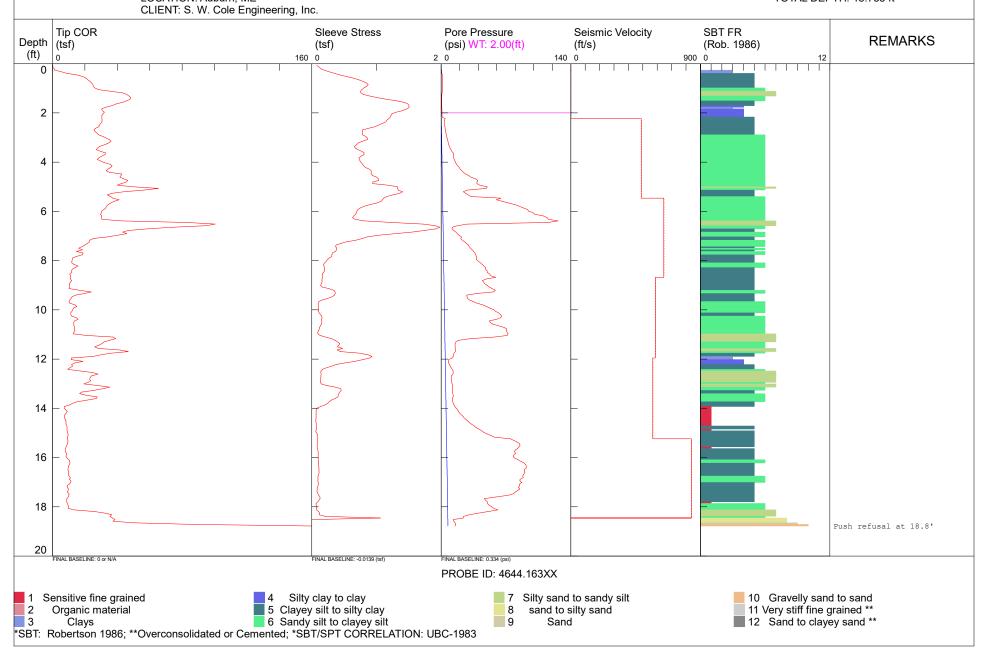

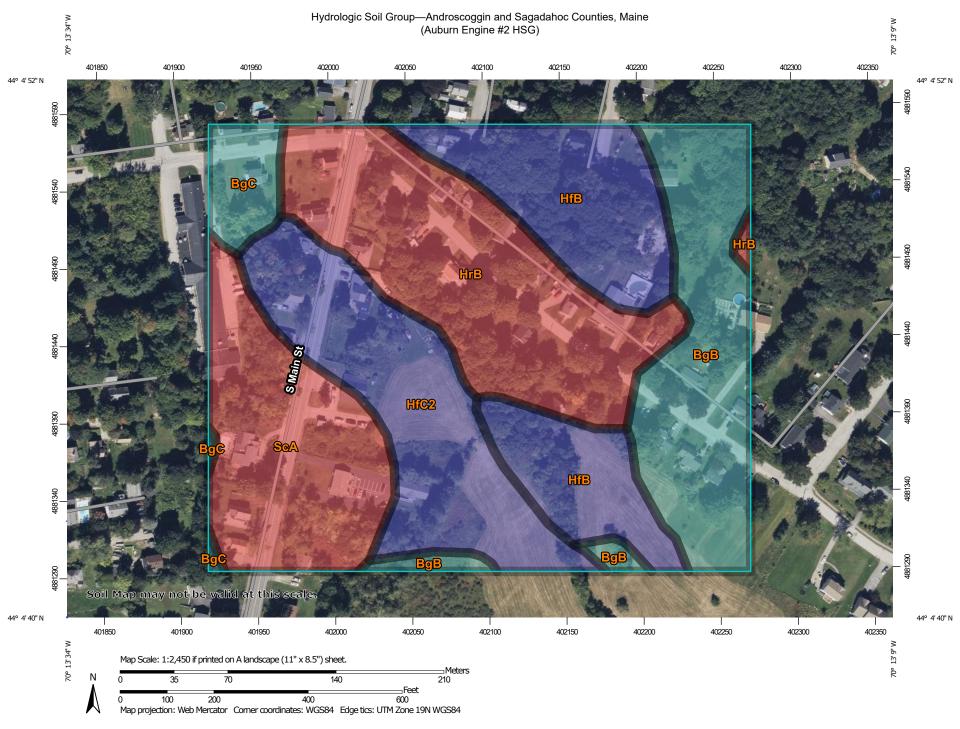

MAP LEGEND MAP INFORMATION The soil surveys that comprise your AOI were mapped at Area of Interest (AOI) С 1:15.800. Area of Interest (AOI) C/D Soils Warning: Soil Map may not be valid at this scale. D **Soil Rating Polygons** Enlargement of maps beyond the scale of mapping can cause Not rated or not available Α misunderstanding of the detail of mapping and accuracy of soil **Water Features** line placement. The maps do not show the small areas of A/D Streams and Canals contrasting soils that could have been shown at a more detailed Transportation B/D Rails ---Please rely on the bar scale on each map sheet for map measurements. Interstate Highways C/D Source of Map: Natural Resources Conservation Service **US Routes** Web Soil Survey URL: D Major Roads Coordinate System: Web Mercator (EPSG:3857) Not rated or not available -Local Roads Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts Soil Rating Lines Background distance and area. A projection that preserves area, such as the Aerial Photography Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required. This product is generated from the USDA-NRCS certified data as of the version date(s) listed below. B/D Soil Survey Area: Androscoggin and Sagadahoc Counties, Survey Area Data: Version 25, Aug 26, 2024 Soil map units are labeled (as space allows) for map scales 1:50,000 or larger. Not rated or not available Date(s) aerial images were photographed: Jul 11, 2021—Oct 29, **Soil Rating Points** 2021 The orthophoto or other base map on which the soil lines were A/D compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident. B/D

Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI	
BgB	Nicholville very fine sandy loam, 0 to 8 percent slopes	С	4.6	18.4%	
BgC	Nicholville very fine sandy loam, 8 to 15 percent slopes	С	0.9	3.7%	
HfB	Hartland very fine sandy loam, 2 to 8 percent slopes	В	4.8	19.2%	
HfC2	Hartland very fine sandy loam, 8 to 15 percent slopes, eroded	В	4.6	18.2%	
HrB	Lyman-Tunbridge complex, 0 to 8 percent slopes, rocky	D	6.0	23.7%	
ScA	Scantic silt loam, 0 to 3 percent slopes	D	4.2	16.7%	
Totals for Area of Inter	rest	1	25.2	100.0%	

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Rating Options

Aggregation Method: Dominant Condition

Component Percent Cutoff: None Specified

Tie-break Rule: Higher



APPENDIX C: STORMWATER OPERATIONS & MAINTENANCE PLAN



STORMWATER MANAGEMENT SYSTEM OPERATION AND MAINTENANCE PLAN

City of Auburn, ME Engine #2

Prepared for: City of Auburn 60 Court Street Auburn, Maine 04210

Prepared By: 12 Mountfort Street Portland, ME 04101 800.426.4262

0233981.13 December 2024

woodardcurran.com



STORMWATER MANAGEMENT SYSTEM OPERATION & MAINTENANCE PLAN

This Stormwater Management System Operations & Maintenance Plan (the Plan) assumes that the City of Auburn, ME will maintain an effective stormwater management system at the following:

180 South Main Street Auburn. ME 04210

herein referred to as "the Site". Periodic and scheduled inspection and maintenance measures are recommended to prevent deficiencies and to promote the proper performance of the stormwater management system. Failure to implement these measures can reduce the hydraulic capacity and the pollutant removal efficiency of stormwater measures, which may result in poor water quality of stormwater runoff discharging from the Site.

Responsible Party & Estimated Annual Budget

Woodard and Curran (W&C) has been informed that the City of Auburn, ME will define responsibilities for operation and maintenance at the Site. The City of Auburn is responsible for implementing this Plan and identifying the source of necessary funding is as follows:

City of Auburn, Maine 60 Court St Auburn, ME 04210

The estimated annual budget for implementing this Plan is \$10,000.

Good Housekeeping

The Site will be maintained as clean and orderly. Routine inspections of the Site for debris and sediment accumulations shall be performed. Debris and sediment shall be disposed of in accordance with local and State requirements.

Stormwater System Maintenance

Stormwater management is provided by deep sump catch basins, a subsurface detention system, and an outlet control structure. These measures are illustrated on the project plans. Routine inspections and maintenance of the stormwater management system shall be performed in accordance with **Table 1** of this report for the Site. These measures are recommended to prevent deficiencies with the system that may result in poor quality stormwater runoff.

Landscape Management

Lawn and landscaped areas shall be inspected for patches of dead vegetation and erosion. If these conditions occur, effected areas shall be stabilized and replanted with vegetation to prevent sediment from entering the stormwater management system.



The following additional measures are provided in an effort to minimize the potential for runoff pollution due to overwatering, dead vegetation and erosion, direct disposal of lawn clippings, and over-application of materials such as fertilizers and pesticides.

Lawn Mowing

The following mowing practices are recommended:

- Maintain sharp mower blades.
- Grass shall not be cut shorter than 2 to 3 inches to minimize weed growth. Grass can be cut lower in the spring and fall to stimulate root growth, but no shorter than 1½ inches.
- Do not dispose of grass clippings within the stormwater management system.
- Employ practices to minimize the potential for grass clippings to enter the stormwater management system.

Fertilizers & Pesticides

Use of pesticides and fertilizers should be minimized to the extent practicable. Application of these materials may degrade the quality of stormwater runoff and should therefore be applied judiciously. In addition, fertilizers and pesticides shall not be applied when rain is expected. These materials should be stored under cover to prevent their exposure to stormwater.

Inspections & Maintenance Measures

The stormwater management system at the Site consists of a deep sump catch basins, a detention system, and an outlet control structure. The best management practices are illustrated in **FIGURE A**. provides the Inspection Form that is recommended for use during routine inspections of the system. The form includes a table (**Table 1**) that outlines specific inspection and maintenance measures for the detention system, in addition to the following information:

- Name of inspector
- Name of the site and its location
- Date and time of inspection
- Weather conditions during inspection
- Outline of items inspected
- Condition of the stormwater management measures, including corrective measures taken to maintain the system

At a minimum, inspect the stormwater management system twice a year. Completed Inspections Forms should be kept at the Site to enable both facility managers and regulatory agencies to ensure that operation of the system is in compliance with permit requirements and submitted to the City Engineer's office.

Long-Term Pollution Prevention Plan

Good Housekeeping Practices



Prevent or reduce pollutant runoff from the project development through the use of street sweeping, and erosion and catch basin cleaning.

Provisions for storing materials and waste products inside or under cover: All materials stored on site shall be stored in a neat and orderly fashion in their appropriate containers and under a roof or other secure enclosure. Waste products should be placed in secure receptacles until they are emptied by a licensed solid waste management company in Massachusetts.


Spill Prevention and Response Plans

Prevention: All materials and equipment stored on site shall be stored in a neat and orderly fashion in their appropriate containers and under a roof or other secure enclosure. Products will be kept in their original containers with the original manufacturer's label. Products should not be mixed with one another unless recommended by the manufacturer. If possible, all of the product should be used up before disposing of the container. The manufacturer's recommendations for proper use and disposal should be followed.

Response: Manufacturer's recommended methods for cleanup shall be followed. Spills should be cleaned up immediately after discovery. The spill area shall be kept well-ventilated, and personnel shall wear appropriate protective clothing to prevent injury from contact with a hazardous substance. Spills of toxic or hazardous material shall be reported to the appropriate State and/or local authority in accordance with local and/or State regulations.



FIGURE A – STORMWATER BEST MANAGEMENT PRACTICES

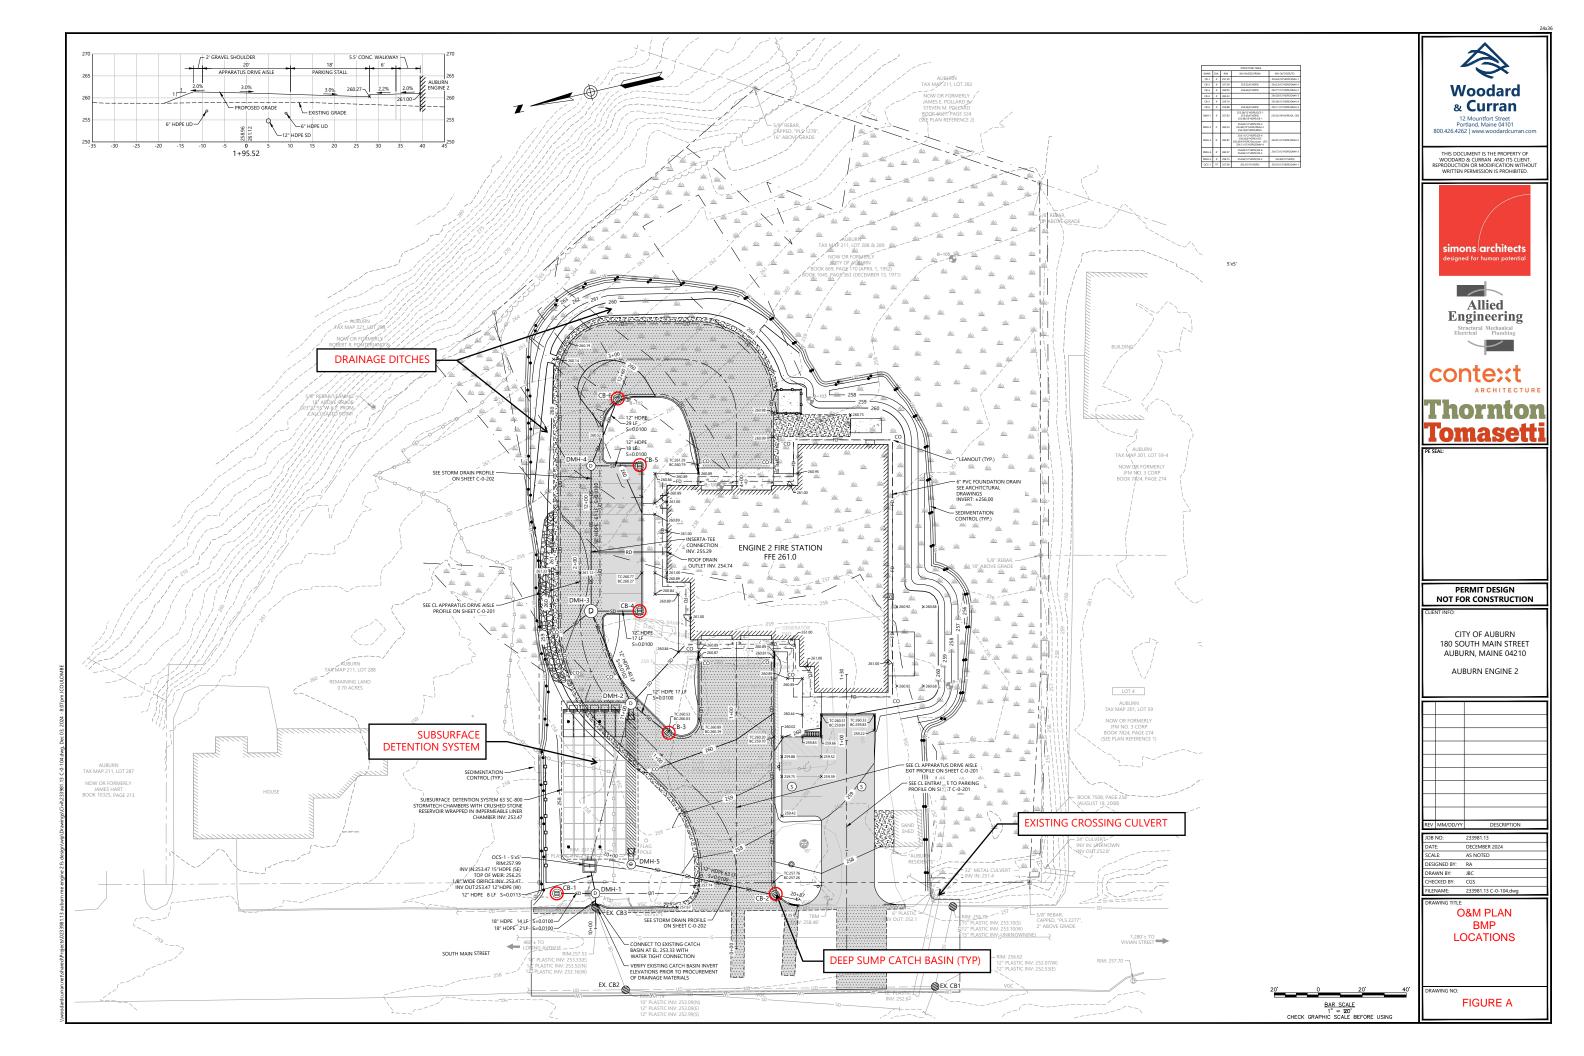



ATTACHMENT A - INSPECTION FORM



STORMWATER MANAGEMENT SYSTEM INSPECTION FORM

Engine 2 Fire Station Auburn, Maine

Name of Inspector:
Date/Time:
Weather:
Date of Last Inspection:
Items Inspected (Refer to Table 1 . Provide additional sheets if necessary.):
Comments & Corrective Actions Taken (Provide additional sheets if necessary.):



TABLE 1 – OPERATIONS & MAINTENANCE MEASURES

	Subsurface Detention System								
Objective: M	aintain the storage capacity and removal efficiency of the proprietary structure.								
Frequency	Measure								
Ongoing/As Needed	 Remove obstructions that may limit runoff from entering the subsurface detention system, including sediment, trash, debris, and leaves. Remove sediment and other trapped pollutants at the frequency or level specified by the manufacturer. A post-installation inspection should be performed to allow the owner to measure the invert prior to the accumulation of sediment. This survey will allow the monitoring of sediment build-up without requiring access to the detention system. The following is the recommended procedure for pre-inspections: Locate the riser section or cleanouts of the retention/detention system. The riser will typically be 24" in diameter or larger and the cleanouts are usually 4", 6" or 8" in diameter. Remove the lid of the riser or cleanouts. Insert a measuring device into the opening and make note to a point of reference on the stick or string. (This is done so that sediment buildup can be determined in the future without having to enter the system.) If measured sediment build-up is between 5% - 20% of the pipe diameter, cleaning should be considered; if sediment build-up exceeds 20%, cleaning should be performed at the earliest opportunity. A thorough cleaning of the system (manifolds and laterals) shall be performed by either manual methods or by a vacuum truck. Inspect in accordance with manufacturer requirements, but no less than twice a year following installation, and no less than once a year thereafter. 								
After Heavy Rainfall Events ¹	Inspect in accordance with manufacturer requirements.								
As needed	 Note any standing water that may be present in the subsurface detention system. If standing water is evident in the system, repairs may be necessary. If repairs are not deemed necessary and standing water persists, the Owner should implement a yearly mosquito spray for the system during the spring of each year using EPA-registered products that do not pose unreasonable risks to human health, wildlife, or the environment. Notify Owner of any system repairs needed and/or operational problems. The City is responsible for repairs and correcting operational problems not caused by improper construction. 								

¹ At a minimum, an event accumulating approximately 2.71 inches of rainfall in a 24-hour period.



	Closed Drainage System								
-	Objective: Preserve the hydraulic capacity of the closed conduit drainage systems, including maintenance of the manholes. Drainage piping, deep sump hooded catch basins, and outlet control structures.								
Frequency									
	INSPECTION:								
Ongoing/As Needed ¹	• Inspect drainage structure grates and covers for damage. Repair as necessary. Covers and grates shall not be welded to the frame so that the structure can be inspected and maintained.								
	MAINTENANCE:								
Ongoing/As Needed ¹	 Avoid placement of snow on top of drainage structure grates and covers. Remove sediment from bottom of drainage structures whenever the depth of sediment is greater than or equal to half the sump depth. Dispose of sediment in accordance with all applicable regulations. Remove obstructions that may impede flow through grates, including trash, debris, and accumulated grass clippings and leaves. Dispose of material in accordance with all applicable regulations. Inspect drainage piping for structural deficiency and debris accumulation. Repair piping as required. Dispose material in accordance with all applicable regulations. 								
Annually	• Remove sediment from bottom of drainage structures when using ½ sump depth with sediment. Dispose of sediment in accordance with all applicable regulations.								

	Culvert							
Objective: Pre	Objective: Preserve the hydraulic capacity of the culvert, including maintenance of the drainage ditch.							
Frequency	Measure							
	INSPECTION:							
Ongoing/As Needed ¹	Inspect drainage structure for damage and obstructions. Repair as necessary.							
	MAINTENANCE:							
Ongoing/As Needed ¹	 Remove obstructions that may impede flow through culvert, including trash, debris, and accumulated grass clippings and leaves. Dispose of material in accordance with all applicable regulations. Inspect drainage piping for structural deficiency and debris accumulation. Repair piping as required. Dispose material in accordance with all applicable regulations. 							
Annually	• Remove vegetation and sediment from bottom of culvert when necessary. Dispose of sediment in accordance with all applicable regulations.							




Grassed Drainage Ditches								
Objective: Ma	Objective: Maintain the conveyance capacity and mitigate erosion through drainage channel.							
Frequency	Frequency Measure							
	INSPECTION:							
Ongoing/As Needed	 Inspect channel for adequate vegetation and signs of rilling and gullying the first few months after construction and twice a year thereafter. Inspect the channel for signs of soil erosion, ponding, and sediment accumulation. 							
	MAINTENANCE:							
Ongoing/As Needed	 Repair any damaged rills or gullies as needed. Replace dead vegetation as needed. Mow grass as necessary. Grass height shall not exceed 6 inches. Remove sediment and debris manually at least once a year. Reseed as necessary. 							
	NOTIFICATION:							
As Needed • Notify Owner of any system repairs needed and/or operational problems.								

	Vegetated Areas							
Objective: Ide	Objective: Identify active or potential erosion problems.							
Frequency	Measure							
	INSPECTION:							
Ongoing/As Needed	• Inspect vegetated areas, particularly slopes and embankments, for signs of erosion during the growing season or after heavy rainfall.							
	MAINTENANCE:							
Ongoing/As Needed	 Replace dead vegetation as needed. Mow grass as necessary. Grass height shall not exceed 6 inches. Reseed as necessary. 							
	NOTIFICATION:							
As Needed	Notify Owner of any system repairs needed and/or operational problems.							



APPENDIX D: HYDROCAD CALCULATIONS

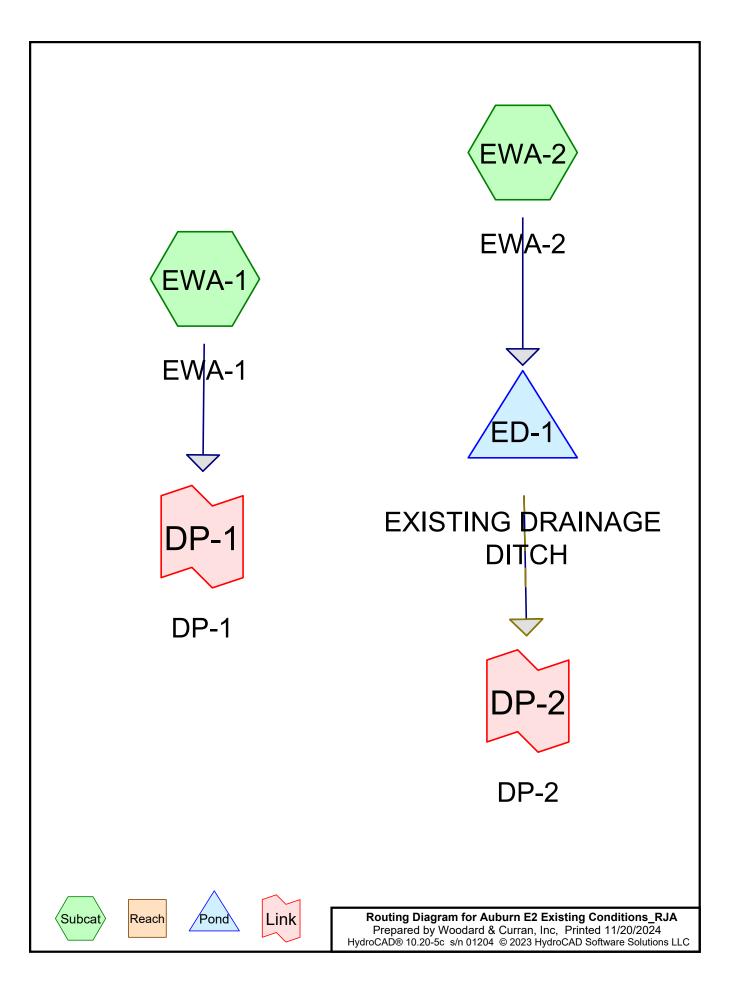

Printed 11/20/2024

Page 2

Rainfall Events Listing (selected events)

Event#	Event	Storm Type	Curve	Mode	Duration	B/B	Depth	AMC
	Name				(hours)		(inches)	
1	2-Year	Type III 24-hr		Default	24.00	1	3.00	2
2	5-Year	Type III 24-hr		Default	24.00	1	3.70	2
3	10-Year	Type III 24-hr		Default	24.00	1	4.30	2
4	25-Year	Type III 24-hr		Default	24.00	1	5.40	2

Printed 11/20/2024 Page 3

Area Listing (all nodes)

Area	CN	Description	
(acres)		(subcatchment-numbers)	
0.306	69	50-75% Grass cover, Fair, HSG B (EWA-1, EWA-2)	
0.163	84	50-75% Grass cover, Fair, HSG D (EWA-1, EWA-2)	
0.301	56	Brush, Fair, HSG B (EWA-1, EWA-2)	
0.357	77	Brush, Fair, HSG D (EWA-2)	
0.660	58	Meadow, non-grazed, HSG B (EWA-1, EWA-2)	
0.023	78	Meadow, non-grazed, HSG D (EWA-2)	
0.011	98	Paved parking, HSG B (EWA-2)	
0.326	98	Paved parking, HSG D (EWA-2)	
0.078	98	Roofs, HSG B (EWA-1)	
0.058	98	Unconnected roofs, HSG B (EWA-2)	
0.172	98	Unconnected roofs, HSG D (EWA-1, EWA-2)	
0.645	60	Woods, Fair, HSG B (EWA-1, EWA-2)	
1.175	79	Woods, Fair, HSG D (EWA-1, EWA-2)	
4.275	73	TOTAL AREA	

Printed 11/20/2024 Page 4

Soil Listing (all nodes)

Area	Soil	Subcatchment
(acres)	Group	Numbers
0.000	HSG A	
2.059	HSG B	EWA-1, EWA-2
0.000	HSG C	
2.216	HSG D	EWA-1, EWA-2
0.000	Other	
4.275		TOTAL AREA

Printed 11/20/2024

Page 5

Ground Covers (all nodes)

HS	G-A H	ISG-B	HSG-C	HSG-D	Other	Total	Ground	Subcatchment
(ac	res) (acres)	(acres)	(acres)	(acres)	(acres)	Cover	Numbers
0.	000	0.306	0.000	0.163	0.000	0.469	50-75% Grass cover, Fair	EWA-1,
								EWA-2
0.	000	0.301	0.000	0.357	0.000	0.658	Brush, Fair	EWA-1,
								EWA-2
0.	000	0.660	0.000	0.023	0.000	0.683	Meadow, non-grazed	EWA-1,
								EWA-2
0.	000	0.011	0.000	0.326	0.000	0.337	Paved parking	EWA-2
0.	000	0.078	0.000	0.000	0.000	0.078	Roofs	EWA-1
0.	000	0.058	0.000	0.172	0.000	0.230	Unconnected roofs	EWA-1,
								EWA-2
0.	000	0.645	0.000	1.175	0.000	1.820	Woods, Fair	EWA-1,
								EWA-2
0.	.000	2.059	0.000	2.216	0.000	4.275	TOTAL AREA	

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 6

Summary for Subcatchment EWA-1: EWA-1

Runoff = 1.08 cfs @ 12.25 hrs, Volume= 0.103 af, Depth> 0.77"

Routed to Link DP-1: DP-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs Type III 24-hr 2-Year Rainfall=3.00"

_	Area	(ac) C	N Des	cription							
	0.	078 9	8 Roo	Roofs, HSG B							
	0.	244 6	39 50-7	50-75% Grass cover, Fair, HSG B							
	0.	063	58 Mea	dow, non-	grazed, HS	GB					
	0.	083 5	6 Brus	h, Fair, H	SG B						
	0.	354 6	30 Woo	ds, Fair, F	ISG B						
	0.	081 9	98 Unc	onnected r	oofs, HSG	D					
					cover, Fair	r, HSG D					
_	0.	627	79 Woo	ds, Fair, F	ISG D						
	1.	604	73 Weig	ghted Aver	age						
		445	90.0	9% Pervio	us Area						
		159	9.91	% Impervi	ous Area						
	0.	081	50.9	4% Uncon	nected						
	_										
	Tc	Length	Slope	Velocity	Capacity	Description					
_	(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)						
	8.1	100	0.0880	0.20		Sheet Flow,					
						Grass: Dense n= 0.240 P2= 3.00"					
	0.7	103	0.2340	2.42		Shallow Concentrated Flow,					
						Woodland Kv= 5.0 fps					
	1.7	123	0.0310	1.23		Shallow Concentrated Flow,					
		405	0.0040	0.00		Short Grass Pasture Kv= 7.0 fps					
	5.5	105	0.0040	0.32		Shallow Concentrated Flow,					
_						Woodland Kv= 5.0 fps					
	16.0	431	Total								

Prepared by Woodard & Curran, Inc

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 7

Summary for Subcatchment EWA-2: EWA-2

Runoff = 1.66 cfs @ 12.30 hrs, Volume= 0.172 af, Depth> 0.77"

Routed to Pond ED-1: EXISTING DRAINAGE DITCH

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs Type III 24-hr 2-Year Rainfall=3.00"

Area	(ac) C	N Des	cription							
0.	.011 9	98 Pave	Paved parking, HSG B							
0.	.058	98 Unc	Jnconnected roofs, HSG B							
0.	062 6	69 50 - 7	5% Grass	cover, Fair	r, HSG B					
0.	218 5	6 Brus	h, Fair, HS	SG B						
0.	597 5	58 Mea	dow, non-	grazed, HS	G B					
0.	291 6	30 Woo	ds, Fair, F	ISG B						
0.	326	8 Pave	ed parking	, HSG D						
0.	.091 9	98 Unc	onnected r	oofs, HSG	D					
0.	.089	34 50-7	5% Grass	cover, Fair	r, HSG D					
			h, Fair, HS							
0.	.023 7			grazed, HS	G D					
0.	548 7	79 Woo	ds, Fair, F	ISG D						
2.	671 7	73 Weig	ghted Aver	age						
	185	81.8	0% Pervio	us Area						
	486			/ious Area						
0.	149	30.6	6% Uncon	nected						
_										
Tc	Length	Slope	Velocity	Capacity	Description					
(min)_	(feet)	(ft/ft)	(ft/sec)	(cfs)						
12.5	100	0.0840	0.13		Sheet Flow,					
					Woods: Light underbrush n= 0.400 P2= 3.00"					
1.0	126	0.1880	2.17		Shallow Concentrated Flow,					
					Woodland Kv= 5.0 fps					
2.7	213	0.0360	1.33		Shallow Concentrated Flow,					
					Short Grass Pasture Kv= 7.0 fps					
3.3	212	0.0240	1.08		Shallow Concentrated Flow,					
					Short Grass Pasture Kv= 7.0 fps					
19.5	651	Total								

Printed 11/20/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 8

Summary for Pond ED-1: EXISTING DRAINAGE DITCH

Inflow Area = 2.671 ac, 18.20% Impervious, Inflow Depth > 0.77" for 2-Year event Inflow 1.66 cfs @ 12.30 hrs, Volume= 0.172 af 1.66 cfs @ 12.30 hrs, Volume= Outflow 0.172 af, Atten= 0%, Lag= 0.2 min 1.66 cfs @ 12.30 hrs, Volume= Primary = 0.172 af Routed to Link DP-2: DP-2 Secondary = 0.00 cfs @ 5.00 hrs, Volume= 0.000 af Routed to Link DP-2: DP-2 5.00 hrs, Volume= Tertiary 0.00 cfs @ 0.000 af Routed to Link DP-2: DP-2

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs / 3 Peak Elev= 252.08' @ 12.31 hrs Surf.Area= 55 sf Storage= 22 cf

Plug-Flow detention time= 0.4 min calculated for 0.171 af (100% of inflow) Center-of-Mass det. time= 0.3 min (834.4 - 834.1)

Volume	Invert	Avail.Sto	rage Storage	Description	
#1	251.40'	15,18	36 cf Custom	Stage Data (P	rismatic)Listed below (Recalc)
Elevatio		urf.Area	Inc.Store	Cum.Store	
(fee	t)	(sq-ft)	(cubic-feet)	(cubic-feet)	
251.4	-0	20	0	0	
252.0	00	41	18	18	
253.0	00	212	127	145	
254.0	00	550	381	526	
255.0	00	1,071	811	1,336	
256.0	00	5,591	3,331	4,667	
257.0	00	15,446	10,519	15,186	
Device	Routing	Invert	Outlet Devices	S	
#1	Primary	251.40'	32.0" Round	Culvert	
	•		L= 55.0' CMF	P, end-section o	conforming to fill, Ke= 0.500
			Inlet / Outlet Ir	nvert= 251.40' /	251.09' S= 0.0056 '/' Cc= 0.900
			n= 0.025 Cori	rugated metal,	Flow Area= 5.59 sf
#2	Secondary	256.75'	4.0" x 4.0" Ho	oriz. Orifice/Gra	ate X 5.00 columns
			X 4 rows C= 0	0.600 in 24.0" x	24.0" Grate (56% open area)
				r flow at low hea	,
#3	Tertiary	256.95'	55.0' long x 1	1.0' breadth Br	oad-Crested Rectangular Weir
	•				0.80 1.00 1.20 1.40 1.60 1.80 2.00
			2.50 3.00		
			Coef. (English) 2.69 2.72 2.	75 2.85 2.98 3.08 3.20 3.28 3.31
			3.30 3.31 3.3		

Auburn E2 Existing Conditions_RJAPrepared by Woodard & Curran, Inc

Type III 24-hr 2-Year Rainfall=3.00" Printed 11/20/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 9

Primary OutFlow Max=1.66 cfs @ 12.30 hrs HW=252.08' (Free Discharge)
—1=Culvert (Barrel Controls 1.66 cfs @ 2.21 fps)

Secondary OutFlow Max=0.00 cfs @ 5.00 hrs HW=251.40' (Free Discharge) 2=Orifice/Grate (Controls 0.00 cfs)

Tertiary OutFlow Max=0.00 cfs @ 5.00 hrs HW=251.40' (Free Discharge) 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Type III 24-hr 2-Year Rainfall=3.00" Printed 11/20/2024

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 10

Summary for Link DP-1: DP-1

Inflow Area = 1.604 ac, 9.91% Impervious, Inflow Depth > 0.77" for 2-Year event

Inflow = 1.08 cfs @ 12.25 hrs, Volume= 0.103 af

Primary = 1.08 cfs @ 12.25 hrs, Volume= 0.103 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Auburn E2 Existing Conditions_RJAPrepared by Woodard & Curran, Inc

Type III 24-hr 2-Year Rainfall=3.00" Printed 11/20/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 11

Summary for Link DP-2: DP-2

Inflow Area = 2.671 ac, 18.20% Impervious, Inflow Depth > 0.77" for 2-Year event

Inflow = 1.66 cfs @ 12.30 hrs, Volume= 0.172 af

Primary = 1.66 cfs @ 12.30 hrs, Volume= 0.172 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Prepared by Woodard & Curran, Inc

Printed 11/20/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 12

Summary for Subcatchment EWA-1: EWA-1

Runoff = 1.74 cfs @ 12.24 hrs, Volume= 0.160 af, Depth> 1.20"

Routed to Link DP-1: DP-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs Type III 24-hr 5-Year Rainfall=3.70"

	Area	(ac) C	N Des	cription				
	0.078 98 Roofs, HSG B							
	0.	244 6	39 50 - 7	5% Grass	r, HSG B			
	0.	063 5	58 Mea	dow, non-	grazed, HS	SG B		
	0.	083 5	56 Brus	sh, Fair, H	SG B			
	0.	354 6		ds, Fair, F				
					oofs, HSG			
					cover, Fair	r, HSG D		
_	0.	627	79 Woo	ds, Fair, F	ISG D			
				ghted Aver				
		445		9% Pervio				
		159		% Impervi				
	0.	081	50.9	4% Uncon	inected			
	_		01			B 1.0		
	Tc	Length	Slope	Velocity		Description		
_	(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)			
	8.1	100	0.0880	0.20		Sheet Flow,		
						Grass: Dense n= 0.240 P2= 3.00"		
	0.7	103	0.2340	2.42		Shallow Concentrated Flow,		
						Woodland Kv= 5.0 fps		
	1.7	123	0.0310	1.23		Shallow Concentrated Flow,		
		405	0.0040	2.22		Short Grass Pasture Kv= 7.0 fps		
	5.5	105	0.0040	0.32		Shallow Concentrated Flow,		
						Woodland Kv= 5.0 fps		
	16.0	431	Total					

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 13

Summary for Subcatchment EWA-2: EWA-2

Runoff = 2.68 cfs @ 12.29 hrs, Volume= 0.267 af, Depth> 1.20"

Routed to Pond ED-1: EXISTING DRAINAGE DITCH

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs Type III 24-hr 5-Year Rainfall=3.70"

Area	(ac) C	N Des	cription			
0.011 98 Paved parking, HSG B						
0.058 98 Unconnected roofs, HSG B						
0.062 69 50-75% Grass cover, Fair, HSG B						
0.	.218		sh, Fair, HS			
0.	.597	58 Mea	dow, non-	grazed, HS	SG B	
0.	.291		ods, Fair, F			
0.	.326	98 Pave	ed parking	, HSG D		
0.	.091	98 Unc	onnected r	oofs, HSG	D	
0.	.089	34 50-7	'5% Grass	cover, Fair	r, HSG D	
0.	.357	77 Brus	sh, Fair, HS	SG D		
0.	.023	78 Mea	dow, non-	grazed, HS	SG D	
0	.548	79 Woo	ods, Fair, F	ISG D		
2.	.671	73 Wei	ghted Aver	age		
2.	.185	81.8	0% Pervio	us Area		
0.	.486	18.2	:0% Imper	∕ious Area		
0.	.149	30.6	66% Uncon	nected		
_						
Tc	Length	Slope	Velocity	Capacity	Description	
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)		
12.5	100	0.0840	0.13		Sheet Flow,	
					Woods: Light underbrush n= 0.400 P2= 3.00"	
1.0	126	0.1880	2.17		Shallow Concentrated Flow,	
					Woodland Kv= 5.0 fps	
2.7	213	0.0360	1.33		Shallow Concentrated Flow,	
					Short Grass Pasture Kv= 7.0 fps	
3.3	212	0.0240	1.08		Shallow Concentrated Flow,	
					Short Grass Pasture Kv= 7.0 fps	
19.5	651	Total				

Prepared by Woodard & Curran, Inc

Printed 11/20/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 14

Summary for Pond ED-1: EXISTING DRAINAGE DITCH

Inflow Area = 2.671 ac, 18.20% Impervious, Inflow Depth > 1.20" for 5-Year event Inflow 2.68 cfs @ 12.29 hrs, Volume= 0.267 af 2.67 cfs @ 12.29 hrs, Volume= Outflow 0.267 af, Atten= 0%, Lag= 0.3 min Primary = 2.67 cfs @ 12.29 hrs, Volume= 0.267 af Routed to Link DP-2: DP-2 Secondary = 0.00 cfs @ 5.00 hrs, Volume= 0.000 af Routed to Link DP-2: DP-2 5.00 hrs, Volume= Tertiary 0.00 cfs @ 0.000 af Routed to Link DP-2: DP-2

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs / 3 Peak Elev= 252.26' @ 12.29 hrs Surf.Area= 86 sf Storage= 35 cf

Plug-Flow detention time= 0.4 min calculated for 0.267 af (100% of inflow) Center-of-Mass det. time= 0.2 min (824.6 - 824.3)

Volume	Invert	Avail.Sto	rage Storage	Description			
#1	251.40'	15,18	36 cf Custom	Stage Data (P	rismatic)Listed below (Recalc)		
□ 14:	0.		In a Otama	O Ot			
Elevation		urf.Area	Inc.Store	Cum.Store			
(fee		(sq-ft)	(cubic-feet)	(cubic-feet)			
251.4	10	20	0	0			
252.0	00	41	18	18			
253.0	00	212	127	145			
254.0	00	550	381	526			
255.0	00	1,071	811	1,336			
256.0	00	5,591	3,331	4,667			
257.0		15,446	10,519	15,186			
		-, -	- ,	-,			
Device	Routing	Invert	Outlet Device	S			
#1	Primary	251.40'	32.0" Round	Culvert			
	,		L= 55.0' CMI	P, end-section o	conforming to fill, Ke= 0.500		
			Inlet / Outlet Invert= 251.40' / 251.09' S= 0.0056 '/' Cc= 0.900				
					Flow Area= 5.59 sf		
#2	Secondary	256.75'			ate X 5.00 columns		
	o o o o i i dai y	2000			24.0" Grate (56% open area)		
			Limited to weir flow at low heads				
#3	Tertiary	256.95'			oad-Crested Rectangular Weir		
πΟ	1 Citial y	200.00			0.80 1.00 1.20 1.40 1.60 1.80 2.00		
			2.50 3.00	.20 0.40 0.00	0.00 1.00 1.20 1.40 1.00 1.00 2.00		
				.) 260 272 2	75 0 05 0 00 0 00 0 00 0 00 0 04		
					75 2.85 2.98 3.08 3.20 3.28 3.31		
			3.30 3.31 3.32				

Type III 24-hr 5-Year Rainfall=3.70" Printed 11/20/2024

Prepared by Woodard & Curran, Inc HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 15

Primary OutFlow Max=2.66 cfs @ 12.29 hrs HW=252.26' (Free Discharge)
—1=Culvert (Barrel Controls 2.66 cfs @ 2.56 fps)

Secondary OutFlow Max=0.00 cfs @ 5.00 hrs HW=251.40' (Free Discharge) 2=Orifice/Grate (Controls 0.00 cfs)

Tertiary OutFlow Max=0.00 cfs @ 5.00 hrs HW=251.40' (Free Discharge)

3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Type III 24-hr 5-Year Rainfall=3.70"

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Printed 11/20/2024

Page 16

Summary for Link DP-1: DP-1

Inflow Area = 1.604 ac, 9.91% Impervious, Inflow Depth > 1.20" for 5-Year event

Inflow = 1.74 cfs @ 12.24 hrs, Volume= 0.160 af

Primary = 1.74 cfs @ 12.24 hrs, Volume= 0.160 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Type III 24-hr 5-Year Rainfall=3.70"

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Printed 11/20/2024

Page 17

Summary for Link DP-2: DP-2

Inflow Area = 2.671 ac, 18.20% Impervious, Inflow Depth > 1.20" for 5-Year event

Inflow = 2.67 cfs @ 12.29 hrs, Volume= 0.267 af

Primary = 2.67 cfs @ 12.29 hrs, Volume= 0.267 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Prepared by Woodard & Curran, Inc

Printed 11/20/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 18

Summary for Subcatchment EWA-1: EWA-1

Runoff = 2.35 cfs @ 12.23 hrs, Volume= 0.214 af, Depth> 1.60"

Routed to Link DP-1: DP-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs Type III 24-hr 10-Year Rainfall=4.30"

_	Area	(ac) C	N Des	cription						
	0.	078	98 Roo	Roofs, HSG B						
	0.	244 6	59 50-7	50-75% Grass cover, Fair, HSG B						
	0.	063	58 Mea	dow, non-	grazed, HS	GB				
	0.	083	56 Brus	sh, Fair, H	SG B					
	0.	354 6	30 Woo	ds, Fair, F	ISG B					
	0.	081 9	98 Unc	onnected r	oofs, HSG	D				
	0.	074 8	34 50-7	'5% Grass	cover, Fair	r, HSG D				
_	0.	627	79 Woo	ods, Fair, F	ISG D					
	1.	604	73 Wei	ghted Aver	age					
	1.	445	90.0	9% Pervio	us Area					
	0.	159	9.91	% Impervi	ous Area					
	0.	081	50.9	4% Uncon	inected					
	Tc	Length	Slope	Velocity	Capacity	Description				
_	(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)					
	8.1	100	0.0880	0.20		Sheet Flow,				
						Grass: Dense n= 0.240 P2= 3.00"				
	0.7	103	0.2340	2.42		Shallow Concentrated Flow,				
						Woodland Kv= 5.0 fps				
	1.7	123	0.0310	1.23		Shallow Concentrated Flow,				
						Short Grass Pasture Kv= 7.0 fps				
	5.5	105	0.0040	0.32		Shallow Concentrated Flow,				
_						Woodland Kv= 5.0 fps				
	16.0	431	Total							

Printed 11/20/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 19

Summary for Subcatchment EWA-2: EWA-2

Runoff = 3.62 cfs @ 12.28 hrs, Volume= 0.356 af, Depth> 1.60"

Routed to Pond ED-1: EXISTING DRAINAGE DITCH

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs Type III 24-hr 10-Year Rainfall=4.30"

	Area	(ac) C	N Desc	cription				
	0.011 98 Paved parking, HSG B							
	0.058 98 Unconnected roofs, HSG B							
	0.062 69 50-75% Grass cover, Fair, HSG B							
	0.218 56 Brush, Fair, HSG B							
	0.	597 5	8 Mea	dow, non-	grazed, HS	G B		
	0.	291 6	30 Woo	ds, Fair, F	ISG B			
	0.	326	8 Pave	ed parking	, HSG D			
	0.	091 9	98 Unco	onnected r	oofs, HSG	D		
	0.	089 8	34 50-7	5% Grass	cover, Fair	r, HSG D		
				h, Fair, HS				
					grazed, HS	G D		
_	0.	548 7	79 Woo	ds, Fair, F	ISG D			
			73 Weig	ghted Aver	age			
		185		0% Pervio				
	_	486			/ious Area			
	0.	149	30.6	6% Uncon	nected			
	_							
	Tc	Length	Slope	Velocity	Capacity	Description		
_	(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)			
	12.5	100	0.0840	0.13		Sheet Flow,		
						Woods: Light underbrush n= 0.400 P2= 3.00"		
	1.0	126	0.1880	2.17		Shallow Concentrated Flow,		
						Woodland Kv= 5.0 fps		
	2.7	213	0.0360	1.33		Shallow Concentrated Flow,		
						Short Grass Pasture Kv= 7.0 fps		
	3.3	212	0.0240	1.08		Shallow Concentrated Flow,		
_						Short Grass Pasture Kv= 7.0 fps		
	19.5	651	Total					

Invert

Volume

Printed 11/20/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 20

Summary for Pond ED-1: EXISTING DRAINAGE DITCH

Inflow Area = 2.671 ac, 18.20% Impervious, Inflow Depth > 1.60" for 10-Year event Inflow 3.62 cfs @ 12.28 hrs, Volume= 0.356 af 3.62 cfs @ 12.29 hrs, Volume= Outflow 0.356 af, Atten= 0%, Lag= 0.3 min Primary = 3.62 cfs @ 12.29 hrs, Volume= 0.356 af Routed to Link DP-2: DP-2 Secondary = 0.00 cfs @ 5.00 hrs, Volume= 0.000 af Routed to Link DP-2: DP-2 5.00 hrs, Volume= Tertiary 0.00 cfs @ 0.000 af Routed to Link DP-2: DP-2

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs / 3 Peak Elev= 252.40' @ 12.29 hrs Surf.Area= 109 sf Storage= 48 cf

Plug-Flow detention time= 0.4 min calculated for 0.356 af (100% of inflow) Center-of-Mass det. time= 0.2 min (818.2 - 818.0)

Avail.Storage Storage Description

VOIGITIE	IIIVOIT	7 (Vall.Oto	ago otorago	Decomplian	
#1	251.40'	15,18	36 cf Custom	Stage Data (Pi	rismatic)Listed below (Recalc)
Elevation		ırf.Area	Inc.Store	Cum.Store	
(fee	et)	(sq-ft)	(cubic-feet)	(cubic-feet)	
251.4	10	20	0	0	
252.0	00	41	18	18	
253.0	00	212	127	145	
254.0	00	550	381	526	
255.0	00	1,071	811	1,336	
256.0	00	5,591	3,331	4,667	
257.0	00	15,446	10,519	15,186	
Device	Routing	Invert	Outlet Device	S	
#1	Primary	251.40'	32.0" Round	Culvert	
	•		L= 55.0' CMI	P, end-section c	onforming to fill, Ke= 0.500
			Inlet / Outlet In	nvert= 251.40' /	251.09' S= 0.0056 '/' Cc= 0.900
			n= 0.025 Cor	rugated metal,	Flow Area= 5.59 sf
#2	Secondary	256.75'			ate X 5.00 columns
					24.0" Grate (56% open area)
				r flow at low hea	
#3	Tertiary	256.95'			oad-Crested Rectangular Weir
				.20 0.40 0.60	0.80 1.00 1.20 1.40 1.60 1.80 2.00
			2.50 3.00		
			Coef. (English 3.30 3.31 3.3		75 2.85 2.98 3.08 3.20 3.28 3.31
			3.30 3.31 3.3) <u>_</u>	

Auburn E2 Existing Conditions_RJAPrepared by Woodard & Curran, Inc

Type III 24-hr 10-Year Rainfall=4.30" Printed 11/20/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 21

Primary OutFlow Max=3.59 cfs @ 12.29 hrs HW=252.40' (Free Discharge)
—1=Culvert (Barrel Controls 3.59 cfs @ 2.80 fps)

Secondary OutFlow Max=0.00 cfs @ 5.00 hrs HW=251.40' (Free Discharge) 2=Orifice/Grate (Controls 0.00 cfs)

Tertiary OutFlow Max=0.00 cfs @ 5.00 hrs HW=251.40' (Free Discharge)

3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Type III 24-hr 10-Year Rainfall=4.30"

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Printed 11/20/2024

Page 22

Summary for Link DP-1: DP-1

Inflow Area = 1.604 ac, 9.91% Impervious, Inflow Depth > 1.60" for 10-Year event

Inflow = 2.35 cfs @ 12.23 hrs, Volume= 0.214 af

Primary = 2.35 cfs @ 12.23 hrs, Volume= 0.214 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Type III 24-hr 10-Year Rainfall=4.30"

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Printed 11/20/2024

Page 23

Summary for Link DP-2: DP-2

Inflow Area = 2.671 ac, 18.20% Impervious, Inflow Depth > 1.60" for 10-Year event

Inflow = 3.62 cfs @ 12.29 hrs, Volume= 0.356 af

Primary = 3.62 cfs @ 12.29 hrs, Volume= 0.356 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Printed 11/20/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 24

Summary for Subcatchment EWA-1: EWA-1

Runoff = 3.56 cfs @ 12.23 hrs, Volume= 0.321 af, Depth> 2.40"

Routed to Link DP-1 : DP-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs Type III 24-hr 25-Year Rainfall=5.40"

Area	(ac)	CN De	scription		
0.	078	98 Ro	ofs, HSG B		
0.:	244	69 50-	75% Grass	cover, Fair	r, HSG B
0.	063				SG B
				,	
	_			•	r, HSG D
			•		
0.	081	50.	94% Uncor	inected	
То	Longth	Clana	Valacity	Canacity	Description
	•				Description
		, ,		(CIS)	Oh a of Elass
8.1	100	0.0880	0.20		Sheet Flow,
0.7	103	0 2240	2 42		Grass: Dense n= 0.240 P2= 3.00"
0.7	103	0.2340	2.42		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
17	123	0.0310	1 22		Shallow Concentrated Flow,
1.7	120	0.0310	1.23		Short Grass Pasture Kv= 7.0 fps
5.5	105	0 0040	0 32		Shallow Concentrated Flow,
0.0	100	0.0040	0.02		Woodland Kv= 5.0 fps
16.0	431	Total			Trocalaina III olo ipo
	0. 0. 0. 0. 0. 0. 0.	0.078 0.244 0.063 0.083 0.354 0.081 0.074 0.627 1.604 1.445 0.159 0.081 Tc Length (min) (feet) 8.1 100 0.7 103 1.7 123 5.5 105	0.078 98 Roc 0.244 69 50- 0.063 58 Me 0.083 56 Bru 0.354 60 Wo 0.081 98 Und 0.074 84 50- 0.627 79 Wo 1.604 73 We 1.445 90. 0.159 9.9 0.081 50. Tc Length Slope (min) (feet) (ft/ft) 8.1 100 0.0880 0.7 103 0.2340 1.7 123 0.0310 5.5 105 0.0040	0.078 98 Roofs, HSG B 0.244 69 50-75% Grass 0.063 58 Meadow, non- 0.083 56 Brush, Fair, HS 0.354 60 Woods, Fair, HS 0.081 98 Unconnected r 0.074 84 50-75% Grass 0.627 79 Woods, Fair, HS 1.604 73 Weighted Aver 1.445 90.09% Pervict 0.159 9.91% Impervict 0.081 50.94% Uncon Tc Length Slope Velocity (min) (feet) (ft/ft) (ft/sec) 8.1 100 0.0880 0.20 0.7 103 0.2340 2.42 1.7 123 0.0310 1.23 5.5 105 0.0040 0.32	0.078 98 Roofs, HSG B 0.244 69 50-75% Grass cover, Fai 0.063 58 Meadow, non-grazed, HS 0.083 56 Brush, Fair, HSG B 0.354 60 Woods, Fair, HSG B 0.081 98 Unconnected roofs, HSG 0.074 84 50-75% Grass cover, Fai 0.627 79 Woods, Fair, HSG D 1.604 73 Weighted Average 1.445 90.09% Pervious Area 0.159 9.91% Impervious Area 0.081 50.94% Unconnected Tc Length Slope Velocity Capacity (min) (feet) (ft/ft) (ft/sec) (cfs) 8.1 100 0.0880 0.20 0.7 103 0.2340 2.42 1.7 123 0.0310 1.23 5.5 105 0.0040 0.32

Prepared by Woodard & Curran, Inc

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 25

Summary for Subcatchment EWA-2: EWA-2

Runoff = 5.48 cfs @ 12.28 hrs, Volume= 0.534 af, Depth> 2.40"

Routed to Pond ED-1: EXISTING DRAINAGE DITCH

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs Type III 24-hr 25-Year Rainfall=5.40"

_	Area	(ac) C	N Des	cription		
	0.	011 9	98 Pave	ed parking	, HSG B	
	0.	058	98 Unc	onnected r	oofs, HSG	В
	0.	062	39 50 - 7	5% Grass	cover, Fair	r, HSG B
	0.			sh, Fair, HS	SG B	
					grazed, HS	GB
	_			ds, Fair, H		
				ed parking		
					oofs, HSG	
					cover, Fair	, HSG D
				sh, Fair, HS		
					grazed, HS	G D
_	0.	548	79 Woo	ds, Fair, F	ISG D	
				ghted Aver		
		185		0% Pervio		
		486			∕ious Area	
	0.	149	30.6	6% Uncon	nected	
	_		٥.			
	Tc	Length	Slope	Velocity	Capacity	Description
_	(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
	12.5	100	0.0840	0.13		Sheet Flow,
						Woods: Light underbrush n= 0.400 P2= 3.00"
	1.0	126	0.1880	2.17		Shallow Concentrated Flow,
						Woodland Kv= 5.0 fps
	2.7	213	0.0360	1.33		Shallow Concentrated Flow,
						Short Grass Pasture Kv= 7.0 fps
	3.3	212	0.0240	1.08		Shallow Concentrated Flow,
_						Short Grass Pasture Kv= 7.0 fps
	19.5	651	Total			

Printed 11/20/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 26

Summary for Pond ED-1: EXISTING DRAINAGE DITCH

Inflow Area = 2.671 ac, 18.20% Impervious, Inflow Depth > 2.40" for 25-Year event Inflow 5.48 cfs @ 12.28 hrs, Volume= 0.534 af 5.47 cfs @ 12.28 hrs, Volume= Outflow 0.533 af, Atten= 0%, Lag= 0.4 min Primary = 5.47 cfs @ 12.28 hrs, Volume= 0.533 af Routed to Link DP-2: DP-2 Secondary = 0.00 cfs @ 5.00 hrs, Volume= 0.000 af Routed to Link DP-2: DP-2 5.00 hrs, Volume= Tertiary 0.00 cfs @ 0.000 af Routed to Link DP-2: DP-2

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs / 3 Peak Elev= 252.63' @ 12.28 hrs Surf.Area= 149 sf Storage= 79 cf

Plug-Flow detention time= 0.4 min calculated for 0.533 af (100% of inflow) Center-of-Mass det. time= 0.2 min (809.3 - 809.1)

Volume	Invert	Avail.Sto	rage Storage	Description	
#1	251.40'	15,18	36 cf Custom	Stage Data (P	rismatic)Listed below (Recalc)
□ 14:	0.		In a Otama	O Ot	
Elevation		urf.Area	Inc.Store	Cum.Store	
(fee		(sq-ft)	(cubic-feet)	(cubic-feet)	
251.4	10	20	0	0	
252.0	00	41	18	18	
253.0	00	212	127	145	
254.0	00	550	381	526	
255.0	00	1,071	811	1,336	
256.0	00	5,591	3,331	4,667	
257.0		15,446	10,519	15,186	
		-, -	- ,	-,	
Device	Routing	Invert	Outlet Device	S	
#1	Primary	251.40'	32.0" Round	Culvert	
	,		L= 55.0' CMI	P, end-section o	conforming to fill, Ke= 0.500
					251.09' S= 0.0056 '/' Cc= 0.900
					Flow Area= 5.59 sf
#2	Secondary	256.75'			ate X 5.00 columns
	o o o o i i dai y	2000			24.0" Grate (56% open area)
				r flow at low hea	,
#3	Tertiary	256.95'			oad-Crested Rectangular Weir
πΟ	1 Citial y	200.00			0.80 1.00 1.20 1.40 1.60 1.80 2.00
			2.50 3.00	.20 0.40 0.00	0.00 1.00 1.20 1.40 1.00 1.00 2.00
				.) 260 272 2	75 0 05 0 00 0 00 0 00 0 00 0 04
					75 2.85 2.98 3.08 3.20 3.28 3.31
			3.30 3.31 3.3	32	

Type III 24-hr 25-Year Rainfall=5.40" Printed 11/20/2024

Prepared by Woodard & Curran, Inc HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 27

Primary OutFlow Max=5.43 cfs @ 12.28 hrs HW=252.63' (Free Discharge)
—1=Culvert (Barrel Controls 5.43 cfs @ 3.17 fps)

Secondary OutFlow Max=0.00 cfs @ 5.00 hrs HW=251.40' (Free Discharge) 2=Orifice/Grate (Controls 0.00 cfs)

Tertiary OutFlow Max=0.00 cfs @ 5.00 hrs HW=251.40' (Free Discharge)

3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Type III 24-hr 25-Year Rainfall=5.40" Printed 11/20/2024

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 28

Summary for Link DP-1: DP-1

Inflow Area = 1.604 ac, 9.91% Impervious, Inflow Depth > 2.40" for 25-Year event

Inflow = 3.56 cfs @ 12.23 hrs, Volume= 0.321 af

Primary = 3.56 cfs @ 12.23 hrs, Volume= 0.321 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Type III 24-hr 25-Year Rainfall=5.40"

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Printed 11/20/2024

Page 29


Summary for Link DP-2: DP-2

Inflow Area = 2.671 ac, 18.20% Impervious, Inflow Depth > 2.40" for 25-Year event

Inflow = 5.47 cfs @ 12.28 hrs, Volume= 0.533 af

Primary = 5.47 cfs @ 12.28 hrs, Volume= 0.533 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

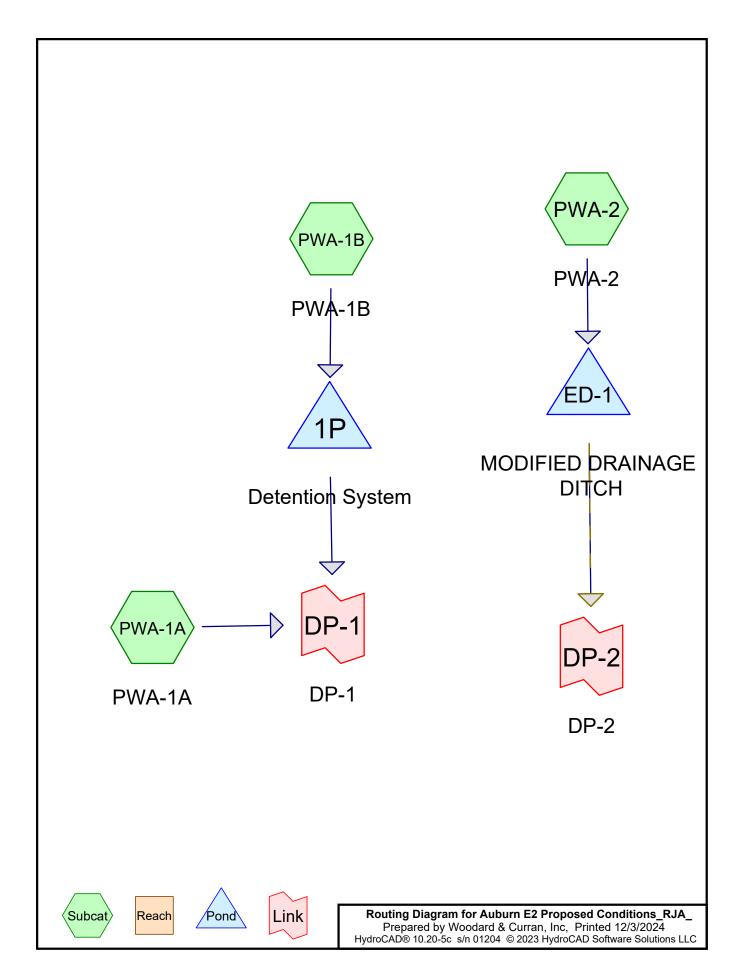

Auburn E2 Proposed Conditions_RJA_
Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Area Listing (all nodes)

Area	n CN	Description
(acres)	(subcatchment-numbers)
0.479	69	50-75% Grass cover, Fair, HSG B (PWA-1A, PWA-1B, PWA-2)
0.212	2 84	50-75% Grass cover, Fair, HSG D (PWA-1A, PWA-2)
0.214	56	Brush, Fair, HSG B (PWA-1A, PWA-2)
0.283	3 77	Brush, Fair, HSG D (PWA-2)
0.025	96	Gravel surface, HSG B (PWA-1A, PWA-2)
0.006	96	Gravel surface, HSG D (PWA-1A, PWA-2)
0.235	5 58	Meadow, non-grazed, HSG B (PWA-1A, PWA-2)
0.267	98	Paved parking, HSG B (PWA-1B, PWA-2)
0.327	98	Paved parking, HSG D (PWA-1B, PWA-2)
0.246	98	Unconnected roofs, HSG B (PWA-1A, PWA-1B, PWA-2)
0.215	98	Unconnected roofs, HSG D (PWA-1A, PWA-1B, PWA-2)
0.595	60	Woods, Fair, HSG B (PWA-1A, PWA-2)
1.175	79	Woods, Fair, HSG D (PWA-1A, PWA-2)
4.279	78	TOTAL AREA

Printed 12/3/2024 Page 2

Prepared by Woodard & Curran, Inc

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 3

Summary for Subcatchment PWA-1A: PWA-1A

Runoff = 1.01 cfs @ 12.25 hrs, Volume= 0.107 af, Depth= 0.86"

Routed to Link DP-1: DP-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr 2-Year Rainfall=3.00"

_	Α	rea (sf)	CN /	Adj Desc	cription						
		2,081	98	Unco	onnected ro	oofs, HSG B					
		13,042	69	50-7	5% Grass	cover, Fair, HSG B					
		940	58	Mea	dow, non-g	razed, HSG B					
		1,275	56	Brus	h, Fair, HS	GB					
		13,166	60	Woo	oods, Fair, HSG B						
		3,526	98	Unco	onnected ro	oofs, HSG D					
		3,597	84	50-7	5% Grass	cover, Fair, HSG D					
		27,316	79	Woo	ds, Fair, H	SG D					
		460	96	Grav	el surface,	HSG B					
		103	96	Grav	el surface,	HSG D					
		65,506	74	73 Weig	hted Avera	age, UI Adjusted					
		59,899		91.4	4% Pervioι	us Area					
		5,607		8.56	% Impervio	ous Area					
		5,607		100.	00% Uncor	nnected					
	Tc	Length	Slope	Velocity	Capacity	Description					
	(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)						
	8.1	100	0.0880	0.20		Sheet Flow,					
						Grass: Dense n= 0.240 P2= 3.00"					
	0.7	103	0.2340	2.42		Shallow Concentrated Flow,					
						Woodland Kv= 5.0 fps					
	1.7	123	0.0310	1.23		Shallow Concentrated Flow,					
						Short Grass Pasture Kv= 7.0 fps					
	5.5	105	0.0040	0.32		Shallow Concentrated Flow,					
						Woodland Kv= 5.0 fps					
	16.0	431	Total			·					

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 4

Summary for Subcatchment PWA-1B: PWA-1B

Runoff = 1.25 cfs @ 12.09 hrs, Volume= 0.094 af, Depth= 2.25"

Routed to Pond 1P : Detention System

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr 2-Year Rainfall=3.00"

 Are	ea (sf)	CN	Description					
;	3,994	98	98 Unconnected roofs, HSG B					
;	3,437	69	50-75% Gra	ass cover, l	Fair, HSG B			
1	1,073	98	Paved park	ing, HSG E	3			
	105	98	Unconnecte	ed roofs, H	SG D			
 ;	3,130	98	Paved park	ing, HSG [)			
2	1,739	93	Weighted A	verage				
;	3,437		15.81% Per	vious Area	1			
1	8,302		84.19% Imp	ervious Ar	ea			
	4,099		22.40% Un	connected				
Tc I	Length	Slope	•	Capacity	Description			
(min)	(feet)	(ft/ft) (ft/sec)	(cfs)				_
6.0					Direct Entry			

6.0

Direct Entry,

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 5

Summary for Subcatchment PWA-2: PWA-2

Runoff = 1.60 cfs @ 12.31 hrs, Volume= 0.182 af, Depth= 0.96"

Routed to Pond ED-1: MODIFIED DRAINAGE DITCH

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr 2-Year Rainfall=3.00"

A	rea (sf)	CN A	Adj Desc	ription					
	567	98	Pave	d parking,	HSG B				
	4,630	98		nconnected roofs, HSG B					
	4,366	69		-75% Grass cover, Fair, HSG B					
	8,044	56		ush, Fair, HSG B					
	9,309	58		eadow, non-grazed, HSG B					
	12,736	60		/oods, Fair, HSG B					
	11,099	98		d parking,					
	5,731	98			oofs, HSG D				
	5,659	84			cover, Fair, HSG D				
	12,326	77		h, Fair, HS					
	23,886	79		ds, Fair, H					
	634	96		el surface,					
	166	96		el surface,					
	99,153	77	75 Weig	hted Avera	age, UI Adjusted				
	77,126			3% Perviou					
	22,027		22.2	2% Impervi	ious Area				
	10,361			1% Unconr					
	,								
Tc	Length	Slope	Velocity	Capacity	Description				
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)					
12.5	100	0.0840	0.13		Sheet Flow,				
					Woods: Light underbrush n= 0.400 P2= 3.00"				
1.0	126	0.1880	2.17		Shallow Concentrated Flow,				
					Woodland Kv= 5.0 fps				
0.4	48	0.0870	2.06		Shallow Concentrated Flow,				
					Short Grass Pasture Kv= 7.0 fps				
2.4	136	0.0180	0.94		Shallow Concentrated Flow,				
					Short Grass Pasture Kv= 7.0 fps				
4.4	277	0.0220	1.04		Shallow Concentrated Flow,				
					Short Grass Pasture Kv= 7.0 fps				
20.7	687	Total							

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 6

Summary for Pond 1P: Detention System

Inflow Area = 0.499 ac, 84.19% Impervious, Inflow Depth = 2.25" for 2-Year event

Inflow = 1.25 cfs @ 12.09 hrs, Volume= 0.094 af

Outflow = 0.03 cfs @ 17.06 hrs, Volume= 0.059 af, Atten= 98%, Lag= 298.3 min

Primary = 0.03 cfs @ 17.06 hrs, Volume= 0.059 af

Routed to Link DP-1: DP-1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Peak Elev= 255.1654' @ 17.06 hrs Surf.Area= 0.054 ac Storage= 0.071 af

Plug-Flow detention time= 893.9 min calculated for 0.059 af (63% of inflow)

Center-of-Mass det. time= 795.3 min (1,590.2 - 794.9)

Volume	Invert	Avail.Storage	Storage Description
#1A	253.4700'	0.041 af	34.75'W x 67.82'L x 3.25'H Field A
			0.176 af Overall - 0.074 af Embedded = 0.102 af x 40.0% Voids
#2A	253.4700'	0.074 af	ADS_StormTech SC-800 +Capx 63 Inside #1
			Effective Size= 45.0"W x 33.0"H => 7.11 sf x 7.12'L = 50.6 cf
			Overall Size= 51.0"W x 33.0"H x 7.55'L with 0.43' Overlap
			63 Chambers in 7 Rows
			Cap Storage= 3.4 cf x 2 x 7 rows = 47.9 cf
		0.115 of	Total Available Storage

0.115 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	253.4700'	12.0" Round Culvert
			L= 13.5' CPP, end-section conforming to fill, Ke= 0.500
			Inlet / Outlet Invert= 253.4700' / 253.3300' S= 0.0104 '/' Cc=
			0.900
			n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Primary	256.2500'	5.0' long x 0.5' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.2000 0.4000 0.6000 0.8000 1.0000
			Coef. (English) 2.80 2.92 3.08 3.30 3.32
#3	Device 1	256.7000'	5.0' long Sharp-Crested Rectangular Weir 2 End Contraction(s)
#4	Primary	253.4700'	Asymmetrical Weir, C= 3.27
			Offset (feet) 0.0000 0.1000 0.1000 0.1042 0.1042 0.2100
			Height (feet) 3.23 3.23 0.00 0.00 3.23 3.23

Primary OutFlow Max=0.03 cfs @ 17.06 hrs HW=255.1654' TW=0.0000' (Dynamic Tailwater)

_1=Culvert (Passes 0.00 cfs of 4.13 cfs potential flow)

1 1 1 2 3=Sharp-Crested Rectangular Weir (Controls 0.00 cfs)

-2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

-4=Asymmetrical Weir (Weir Controls 0.03 cfs @ 4.26 fps)

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 7

Pond 1P: Detention System - Chamber Wizard Field A

Chamber Model = ADS_StormTechSC-800 +Cap (ADS StormTech®SC-800 with cap volume)

Effective Size= 45.0"W x 33.0"H => 7.11 sf x 7.12'L = 50.6 cf Overall Size= 51.0"W x 33.0"H x 7.55'L with 0.43' Overlap Cap Storage= 3.4 cf x 2 x 7 rows = 47.9 cf

51.0" Wide + 6.0" Spacing = 57.0" C-C Row Spacing

9 Chambers/Row x 7.12' Long +0.88' Cap Length x 2 = 65.82' Row Length +12.0" End Stone x 2 = 67.82' Base Length


7 Rows x 51.0" Wide + 6.0" Spacing x 6 + 12.0" Side Stone x 2 = 34.75' Base Width 33.0" Chamber Height + 6.0" Stone Cover = 3.25' Field Height

63 Chambers x 50.6 cf + 3.4 cf Cap Volume x 2 x 7 Rows = 3,235.2 cf Chamber Storage

7,659.0 cf Field - 3,235.2 cf Chambers = 4,423.9 cf Stone x 40.0% Voids = 1,769.5 cf Stone Storage

Chamber Storage + Stone Storage = 5,004.7 cf = 0.115 af Overall Storage Efficiency = 65.3% Overall System Size = 67.82' x 34.75' x 3.25'

63 Chambers 283.7 cy Field 163.8 cy Stone

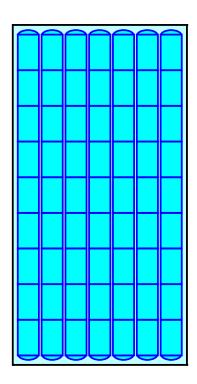



Invert

Volume

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 8

Summary for Pond ED-1: MODIFIED DRAINAGE DITCH

Inflow Area = 2.276 ac, 22.22% Impervious, Inflow Depth = 0.96" for 2-Year event Inflow 1.60 cfs @ 12.31 hrs, Volume= 0.182 af 1.60 cfs @ 12.32 hrs, Volume= Outflow 0.182 af, Atten= 0%, Lag= 0.2 min Primary = 1.60 cfs @ 12.32 hrs, Volume= 0.182 af Routed to Link DP-2: DP-2 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af Routed to Link DP-2: DP-2 0.000 af 0.00 hrs, Volume= Tertiary 0.00 cfs @ Routed to Link DP-2: DP-2

Avail.Storage Storage Description

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Peak Elev= 252.0693' @ 12.32 hrs Surf.Area= 53 sf Storage= 22 cf

Plug-Flow detention time= 0.5 min calculated for 0.182 af (100% of inflow) Center-of-Mass det. time= 0.5 min (877.0 - 876.5)

VOIGITIO	11110	rt /tvaii.Otoi	age clorage	Dooonphon	
#1	251.400	0' 13,49	8 cf Custom	Stage Data (Pri	smatic)Listed below (Recalc)
Eleva		Surf.Area	Inc.Store	Cum.Store	
	feet)	(sq-ft)	(cubic-feet)	(cubic-feet)	
251.4	4000	20	0	0	
252.0		41	18	18	
253.0	0000	212	127	145	
254.0	0000	550	381	526	
255.0		1,071	811	1,336	
256.0	0000	5,565	3,318	4,654	
257.0	0000	12,122	8,844	13,498	
Device	Routing	Invert	Outlet Device	S	
#1	Primary	251.4000'	32.0" Round	l Culvert	
			L= 55.0' CM	P, end-section co	nforming to fill, Ke= 0.500
			Inlet / Outlet I	nvert= 251.4000'	/ 251.0900' S= 0.0056 '/' Cc=
			0.900 n= 0.0)25 Corrugated m	netal, Flow Area= 5.59 sf
#2	Secondary	256.7500'			e X 5.00 columns
					4.0" Grate (56% open area)
				ir flow at low head	
#3	Tertiary	256.9500'			ad-Crested Rectangular Weir
					6000 0.8000 1.0000 1.2000 1.4000
				0 2.0000 2.5000	
					5 2.85 2.98 3.08 3.20 3.28 3.31
			3.30 3.31 3.3	32	

Type III 24-hr 2-Year Rainfall=3.00"
Printed 12/3/2024

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 9

Primary OutFlow Max=1.59 cfs @ 12.32 hrs HW=252.0671' TW=0.0000' (Dynamic Tailwater) 1=Culvert (Barrel Controls 1.59 cfs @ 2.19 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=251.4000' TW=0.0000' (Dynamic Tailwater) 2=Orifice/Grate (Controls 0.00 cfs)

Tertiary OutFlow Max=0.00 cfs @ 0.00 hrs HW=251.4000' TW=0.0000' (Dynamic Tailwater) 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Type III 24-hr 2-Year Rainfall=3.00"

Prepared by Woodard & Curran, Inc

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 10

Summary for Link DP-1: DP-1

Inflow Area = 2.003 ac, 27.40% Impervious, Inflow Depth > 1.00" for 2-Year event

Inflow = 1.03 cfs @ 12.25 hrs, Volume= 0.167 af

Primary = 1.03 cfs @ 12.25 hrs, Volume= 0.167 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

Type III 24-hr 2-Year Rainfall=3.00"

Prepared by Woodard & Curran, Inc

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 11

Summary for Link DP-2: DP-2

Inflow Area = 2.276 ac, 22.22% Impervious, Inflow Depth = 0.96" for 2-Year event

Inflow = 1.60 cfs @ 12.32 hrs, Volume= 0.182 af

Primary = 1.60 cfs @ 12.32 hrs, Volume= 0.182 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 12

Summary for Subcatchment PWA-1A: PWA-1A

Runoff = 1.63 cfs @ 12.24 hrs, Volume= 0.165 af, Depth= 1.32"

Routed to Link DP-1: DP-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr 5-Year Rainfall=3.70"

Are	ea (sf)	CN A	Adj Desc	ription							
	2,081	98	98 Unconnected roofs, HSG B								
1	3,042	69	50-7	0-75% Grass cover, Fair, HSG B							
	940	58	Mea	eadow, non-grazed, HSG B							
	1,275	56	Brus	ush, Fair, HSG B							
1	3,166	60	Woo	/oods, Fair, HSG B							
	3,526	98	Unco	nnected ro	oofs, HSG D						
	3,597	84	50-7	5% Grass o	cover, Fair, HSG D						
2	7,316	79	Woo	ds, Fair, H	SG D						
	460	96	Grav	el surface,	HSG B						
	103	96	Grav	el surface,	HSG D						
6	5,506	74	73 Weig	hted Avera	age, UI Adjusted						
5	9,899			4% Pervioυ							
	5,607		8.56	% Impervio	ous Area						
	5,607		100.0	00% Uncor	nnected						
Tc I	Length	Slope	Velocity	Capacity	Description						
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)							
8.1	100	0.0880	0.20		Sheet Flow,						
					Grass: Dense n= 0.240 P2= 3.00"						
0.7	103	0.2340	2.42		Shallow Concentrated Flow,						
					Woodland Kv= 5.0 fps						
1.7	123	0.0310	1.23		Shallow Concentrated Flow,						
					Short Grass Pasture Kv= 7.0 fps						
5.5	105	0.0040	0.32		Shallow Concentrated Flow,						
					Woodland Kv= 5.0 fps						
16.0	431	Total									

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 13

Summary for Subcatchment PWA-1B: PWA-1B

Runoff = 1.61 cfs @ 12.09 hrs, Volume= 0.122 af, Depth= 2.93"

Routed to Pond 1P : Detention System

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr 5-Year Rainfall=3.70"

A	rea (sf)	CN I	Description						
	3,994	98	Unconnected roofs, HSG B						
	3,437	69	50-75% Gra	ass cover, I	Fair, HSG B				
	11,073	98 I	Paved park	ing, HSG E	3				
	105	98	Jnconnecte	ed roofs, H	SG D				
	3,130	98	Paved park	ing, HSG D)				
	21,739	93 Weighted Average							
	3,437		15.81% Per	vious Area					
	18,302	;	34.19% Imp	ervious Ar	ea				
	4,099	:	22.40% Un	connected					
Tc	Length	Slope	•	Capacity	Description				
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)					
6.0					Direct Entry				

6.0 Direct Entry,

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 14

Summary for Subcatchment PWA-2: PWA-2

2.49 cfs @ 12.30 hrs, Volume= 0.274 af, Depth= 1.45" Runoff

Routed to Pond ED-1: MODIFIED DRAINAGE DITCH

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr 5-Year Rainfall=3.70"

A	rea (sf)	CN A	Adj Desc	ription			
	567	98	Pave	d parking,	HSG B		
	4,630	98			oofs, HSG B		
	4,366	69			cover, Fair, HSG B		
	8,044	56		h, Fair, HS			
	9,309	58			razed, HSG B		
	12,736	60		ds, Éair, H			
	11,099	98		d parking,			
	5,731	98			oofs, HSG D		
	5,659	84			cover, Fair, HSG D		
	12,326	77		h, Fair, HS			
	23,886	79		ds, Fair, H			
	634	96		el surface,			
	166	96		Gravel surface, HSG D			
	99,153	77	75 Weig	hted Avera	age, UI Adjusted		
	77,126			3% Perviou			
	22,027		22.2	22.22% Impervious Area			
	10,361			4% Unconr			
	,						
Tc	Length	Slope	Velocity	Capacity	Description		
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)			
12.5	100	0.0840	0.13		Sheet Flow,		
					Woods: Light underbrush n= 0.400 P2= 3.00"		
1.0	126	0.1880	2.17		Shallow Concentrated Flow,		
					Woodland Kv= 5.0 fps		
0.4	48	0.0870	2.06		Shallow Concentrated Flow,		
					Short Grass Pasture Kv= 7.0 fps		
2.4	136	0.0180	0.94		Shallow Concentrated Flow,		
					Short Grass Pasture Kv= 7.0 fps		
4.4	277	0.0220	1.04		Shallow Concentrated Flow,		
					Short Grass Pasture Kv= 7.0 fps		
20.7	687	Total					

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 15

Summary for Pond 1P: Detention System

Inflow Area = 0.499 ac, 84.19% Impervious, Inflow Depth = 2.93" for 5-Year event

Inflow = 1.61 cfs @ 12.09 hrs, Volume= 0.122 af

Outflow = 0.05 cfs @ 16.15 hrs, Volume= 0.083 af, Atten= 97%, Lag= 243.7 min

Primary = 0.05 cfs @ 16.15 hrs, Volume= 0.083 af

Routed to Link DP-1: DP-1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Peak Elev= 255.7133' @ 16.15 hrs Surf.Area= 0.054 ac Storage= 0.091 af

Plug-Flow detention time= 850.7 min calculated for 0.083 af (68% of inflow)

Center-of-Mass det. time= 757.5 min (1,545.3 - 787.8)

Volume	Invert	Avail.Storage	Storage Description
#1A	253.4700'	0.041 af	34.75'W x 67.82'L x 3.25'H Field A
			0.176 af Overall - 0.074 af Embedded = 0.102 af x 40.0% Voids
#2A	253.4700'	0.074 af	ADS_StormTech SC-800 +Cap x 63 Inside #1
			Effective Size= 45.0"W x 33.0"H => 7.11 sf x 7.12'L = 50.6 cf
			Overall Size= 51.0"W x 33.0"H x 7.55'L with 0.43' Overlap
			63 Chambers in 7 Rows
			Cap Storage= 3.4 cf x 2 x 7 rows = 47.9 cf
		0.115 af	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	253.4700'	12.0" Round Culvert
			L= 13.5' CPP, end-section conforming to fill, Ke= 0.500
			Inlet / Outlet Invert= 253.4700' / 253.3300' S= 0.0104 '/' Cc=
			0.900
			n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Primary	256.2500'	5.0' long x 0.5' breadth Broad-Crested Rectangular Weir
	-		Head (feet) 0.2000 0.4000 0.6000 0.8000 1.0000
			Coef. (English) 2.80 2.92 3.08 3.30 3.32
#3	Device 1	256.7000'	5.0' long Sharp-Crested Rectangular Weir 2 End Contraction(s)
#4	Primary	253.4700'	Asymmetrical Weir, C= 3.27
	•		Offset (feet) 0.0000 0.1000 0.1000 0.1042 0.1042 0.2100
			Height (feet) 3.23 3.23 0.00 0.00 3.23 3.23

Primary OutFlow Max=0.05 cfs @ 16.15 hrs HW=255.7133' TW=0.0000' (Dynamic Tailwater)

1=Culvert (Passes 0.00 cfs of 4.99 cfs potential flow)

1 1 3=Sharp-Crested Rectangular Weir (Controls 0.00 cfs)

-2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

-4=Asymmetrical Weir (Weir Controls 0.05 cfs @ 4.90 fps)

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 16

Pond 1P: Detention System - Chamber Wizard Field A

Chamber Model = ADS_StormTechSC-800 +Cap (ADS StormTech®SC-800 with cap volume)

Effective Size= 45.0"W x 33.0"H => 7.11 sf x 7.12'L = 50.6 cf Overall Size= 51.0"W x 33.0"H x 7.55'L with 0.43' Overlap Cap Storage= 3.4 cf x 2 x 7 rows = 47.9 cf

51.0" Wide + 6.0" Spacing = 57.0" C-C Row Spacing

9 Chambers/Row x 7.12' Long +0.88' Cap Length x 2 = 65.82' Row Length +12.0" End Stone x 2 = 67.82' Base Length


7 Rows x 51.0" Wide + 6.0" Spacing x 6 + 12.0" Side Stone x 2 = 34.75' Base Width 33.0" Chamber Height + 6.0" Stone Cover = 3.25' Field Height

63 Chambers x 50.6 cf + 3.4 cf Cap Volume x 2 x 7 Rows = 3,235.2 cf Chamber Storage

7,659.0 cf Field - 3,235.2 cf Chambers = 4,423.9 cf Stone x 40.0% Voids = 1,769.5 cf Stone Storage

Chamber Storage + Stone Storage = 5,004.7 cf = 0.115 af Overall Storage Efficiency = 65.3% Overall System Size = 67.82' x 34.75' x 3.25'

63 Chambers 283.7 cy Field 163.8 cy Stone

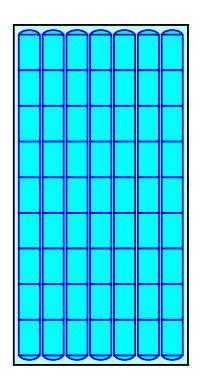



Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

<u>Page 17</u>

Summary for Pond ED-1: MODIFIED DRAINAGE DITCH

Inflow Area = 2.276 ac, 22.22% Impervious, Inflow Depth = 1.45" for 5-Year event Inflow 2.49 cfs @ 12.30 hrs, Volume= 0.274 af Outflow 2.49 cfs @ 12.31 hrs, Volume= 0.274 af, Atten= 0%, Lag= 0.2 min Primary 2.49 cfs @ 12.31 hrs, Volume= 0.274 af Routed to Link DP-2: DP-2 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af Routed to Link DP-2: DP-2 0.00 cfs @ 0.00 hrs, Volume= 0.000 af Tertiary

Routed to Link DP-2: DP-2

#3

Tertiary

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Peak Elev= 252.2304' @ 12.31 hrs Surf.Area= 80 sf Storage= 32 cf

Plug-Flow detention time= 0.4 min calculated for 0.274 af (100% of inflow) Center-of-Mass det. time= 0.4 min (864.4 - 864.0)

Volume	Inv	ert Avail.Sto	rage Storage	Description	
#1	251.400	00' 13,49	98 cf Custon	n Stage Data (P	rismatic)Listed below (Recalc)
Eleva	ation feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	
251.4		20	0	0	
252.0		41	18	18	
253.0	0000	212	127	145	
254.0	0000	550	381	526	
255.0	0000	1,071	811	1,336	
256.0		5,565	3,318	4,654	
257.0	0000	12,122	8,844	13,498	
Device	Routing	Invert	Outlet Device	es	
#1	Primary	251.4000'	32.0" Round	d Culvert	
			L= 55.0' CM	IP, end-section o	conforming to fill, Ke= 0.500
					0' / 251.0900' S= 0.0056 '/' Cc=
					metal, Flow Area= 5.59 sf
#2	Secondary	256.7500'	4.0" x 4.0" H	oriz. Orifice/Gr	ate X 5.00 columns

Limited to weir flow at low heads
256.9500' **55.0' long x 1.0' breadth Broad-Crested Rectangular Weir**Head (feet) 0.2000 0.4000 0.6000 0.8000 1.0000 1.2000 1.4000
1.6000 1.8000 2.0000 2.5000 3.0000

Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31

X 4 rows C= 0.600 in 24.0" x 24.0" Grate (56% open area)

3.30 3.31 3.32

Type III 24-hr 5-Year Rainfall=3.70"
Printed 12/3/2024

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 18

Primary OutFlow Max=2.48 cfs @ 12.31 hrs HW=252.2289' TW=0.0000' (Dynamic Tailwater) 1=Culvert (Barrel Controls 2.48 cfs @ 2.50 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=251.4000' TW=0.0000' (Dynamic Tailwater) 2=Orifice/Grate (Controls 0.00 cfs)

Tertiary OutFlow Max=0.00 cfs @ 0.00 hrs HW=251.4000' TW=0.0000' (Dynamic Tailwater) 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Type III 24-hr 5-Year Rainfall=3.70"

Prepared by Woodard & Curran, Inc

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Printed 12/3/2024

Page 19

Summary for Link DP-1: DP-1

Inflow Area = 2.003 ac, 27.40% Impervious, Inflow Depth > 1.48" for 5-Year event

Inflow = 1.65 cfs @ 12.24 hrs, Volume= 0.248 af

Primary = 1.65 cfs @ 12.24 hrs, Volume= 0.248 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

Type III 24-hr 5-Year Rainfall=3.70"

Prepared by Woodard & Curran, Inc

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 20

Summary for Link DP-2: DP-2

Inflow Area = 2.276 ac, 22.22% Impervious, Inflow Depth = 1.45" for 5-Year event

Inflow = 2.49 cfs @ 12.31 hrs, Volume= 0.274 af

Primary = 2.49 cfs @ 12.31 hrs, Volume= 0.274 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 21

Summary for Subcatchment PWA-1A: PWA-1A

Runoff = 2.20 cfs @ 12.23 hrs, Volume= 0.219 af, Depth= 1.75"

Routed to Link DP-1: DP-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr 10-Year Rainfall=4.30"

Are	ea (sf)	CN A	Adj Desc	ription				
	2,081	98	Unco	nnected ro	oofs, HSG B			
1	3,042	69	50-7	5% Grass o	cover, Fair, HSG B			
	940	58	Mea	dow, non-g	razed, HSG B			
	1,275	56	Brus	h, Fair, HS	G B			
1	3,166	60	Woo	ds, Fair, H	SG B			
	3,526	98	Unco	nnected ro	oofs, HSG D			
	3,597	84	50-7	5% Grass o	cover, Fair, HSG D			
2	7,316	79	Woo	ds, Fair, H	SG D			
	460	96	Grav	el surface,	HSG B			
	103	96	Grav	el surface,	HSG D			
6	5,506	74	73 Weig	hted Avera	age, UI Adjusted			
5	9,899			4% Perviou				
	5,607		8.56	% Impervio	ous Area			
	5,607		100.0	100.00% Unconnected				
Tc I	Length	Slope	Velocity	Capacity	Description			
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)				
8.1	100	0.0880	0.20		Sheet Flow,			
					Grass: Dense n= 0.240 P2= 3.00"			
0.7	103	0.2340	2.42		Shallow Concentrated Flow,			
					Woodland Kv= 5.0 fps			
1.7	123	0.0310	1.23		Shallow Concentrated Flow,			
					Short Grass Pasture Kv= 7.0 fps			
5.5	105	0.0040	0.32		Shallow Concentrated Flow,			
					Woodland Kv= 5.0 fps			
16.0	431	Total						

Type III 24-hr 10-Year Rainfall=4.30"

Prepared by Woodard & Curran, Inc HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC Printed 12/3/2024

Page 22

Summary for Subcatchment PWA-1B: PWA-1B

Runoff 1.91 cfs @ 12.09 hrs, Volume= 0.146 af, Depth= 3.51"

Routed to Pond 1P : Detention System

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr 10-Year Rainfall=4.30"

Area (st	f) CN	Description						
3,99	4 98	Unconnected ro	ofs, HS	SG B				
3,43	7 69	50-75% Grass of	cover, F	Fair, HSG B				
11,07	3 98	Paved parking,	HSG B					
10	5 98	Unconnected ro	ofs, HS	SG D				
3,13	0 98	Paved parking,	HSG D					
21,73	9 93	Weighted Avera	ige					
3,43	7	15.81% Perviou	is Area					
18,30	2	84.19% Impervi	84.19% Impervious Area					
4,09	9	22.40% Unconn	ected					
Tc Leng	•		pacity	Description				
(min) (fee	et) (ft/	ft) (ft/sec)	(cfs)				_	
6.0				Direct Entry				

6.0

Direct Entry,

Prepared by Woodard & Curran, Inc

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 23

Summary for Subcatchment PWA-2: PWA-2

Runoff = 3.31 cfs @ 12.30 hrs, Volume= 0.359 af, Depth= 1.89"

Routed to Pond ED-1: MODIFIED DRAINAGE DITCH

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr 10-Year Rainfall=4.30"

A	rea (sf)	CN A	Adj Desc	ription				
	567	98	Pave	Paved parking, HSG B				
	4,630	98			oofs, HSG B			
	4,366	69	50-7	5% Grass	cover, Fair, HSG B			
	8,044	56		h, Fair, HS				
	9,309	58	Mead	dow, non-g	razed, HSG B			
	12,736	60	Woo	ds, Fair, H	SG B			
	11,099	98	Pave	d parking,	HSG D			
	5,731	98	Unco	nnected ro	oofs, HSG D			
	5,659	84	50-7	5% Grass	cover, Fair, HSG D			
	12,326	77	Brus	h, Fair, HS	G D			
	23,886	79	Woo	ds, Fair, H	SG D			
	634	96	Grav	Gravel surface, HSG B				
	166	96	Grav	Gravel surface, HSG D				
	99,153	77	75 Weig	Weighted Average, UI Adjusted				
	77,126		77.78	3% Perviou	us Area			
	22,027		22.22	2% Impervi	ious Area			
	10,361		47.04	4% Unconr	nected			
Tc	Length	Slope	Velocity		Description			
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)				
12.5	100	0.0840	0.13		Sheet Flow,			
					Woods: Light underbrush n= 0.400 P2= 3.00"			
1.0	126	0.1880	2.17		Shallow Concentrated Flow,			
					Woodland Kv= 5.0 fps			
0.4	48	0.0870	2.06		Shallow Concentrated Flow,			
					Short Grass Pasture Kv= 7.0 fps			
2.4	136	0.0180	0.94		Shallow Concentrated Flow,			
					Short Grass Pasture Kv= 7.0 fps			
4.4	277	0.0220	1.04		Shallow Concentrated Flow,			
					Short Grass Pasture Kv= 7.0 fps			
20.7	687	Total						

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 24

Summary for Pond 1P: Detention System

Inflow Area = 0.499 ac, 84.19% Impervious, Inflow Depth = 3.51" for 10-Year event

Inflow = 1.91 cfs @ 12.09 hrs, Volume= 0.146 af

Outflow = 0.09 cfs @ 14.81 hrs, Volume= 0.104 af, Atten= 96%, Lag= 163.1 min

Primary = 0.09 cfs @ 14.81 hrs, Volume= 0.104 af

Routed to Link DP-1: DP-1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Peak Elev= 256.2633' @ 14.81 hrs Surf.Area= 0.054 ac Storage= 0.105 af

Plug-Flow detention time= 798.8 min calculated for 0.104 af (71% of inflow)

Center-of-Mass det. time= 710.1 min (1,493.0 - 782.9)

Volume	Invert	Avail.Storage	Storage Description
#1A	253.4700'	0.041 af	34.75'W x 67.82'L x 3.25'H Field A
			0.176 af Overall - 0.074 af Embedded = 0.102 af x 40.0% Voids
#2A	253.4700'	0.074 af	ADS_StormTech SC-800 +Capx 63 Inside #1
			Effective Size= 45.0"W x 33.0"H => 7.11 sf x 7.12'L = 50.6 cf
			Overall Size= 51.0"W x 33.0"H x 7.55'L with 0.43' Overlap
			63 Chambers in 7 Rows
			Cap Storage= 3.4 cf x 2 x 7 rows = 47.9 cf
		0 115 of	Total Available Storage

0.115 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	253.4700'	12.0" Round Culvert
			L= 13.5' CPP, end-section conforming to fill, Ke= 0.500
			Inlet / Outlet Invert= 253.4700' / 253.3300' S= 0.0104 '/' Cc=
			0.900
			n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Primary	256.2500'	5.0' long x 0.5' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.2000 0.4000 0.6000 0.8000 1.0000
			Coef. (English) 2.80 2.92 3.08 3.30 3.32
#3	Device 1	256.7000'	5.0' long Sharp-Crested Rectangular Weir 2 End Contraction(s)
#4	Primary	253.4700'	Asymmetrical Weir, C= 3.27
	•		Offset (feet) 0.0000 0.1000 0.1000 0.1042 0.1042 0.2100
			Height (feet) 3.23 3.23 0.00 0.00 3.23 3.23

Primary OutFlow Max=0.09 cfs @ 14.81 hrs HW=256.2633' TW=0.0000' (Dynamic Tailwater)

-1=Culvert (Passes 0.00 cfs of 5.73 cfs potential flow)

1 3=Sharp-Crested Rectangular Weir (Controls 0.00 cfs)

-2=Broad-Crested Rectangular Weir (Weir Controls 0.02 cfs @ 0.32 fps)

-4=Asymmetrical Weir (Weir Controls 0.06 cfs @ 5.47 fps)

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Printed 12/3/2024 Page 25

Pond 1P: Detention System - Chamber Wizard Field A

Chamber Model = ADS_StormTechSC-800 +Cap (ADS StormTech®SC-800 with cap volume)

Effective Size= 45.0"W x 33.0"H => 7.11 sf x 7.12'L = 50.6 cf Overall Size= 51.0"W x 33.0"H x 7.55'L with 0.43' Overlap Cap Storage= 3.4 cf x 2 x 7 rows = 47.9 cf

51.0" Wide + 6.0" Spacing = 57.0" C-C Row Spacing

9 Chambers/Row x 7.12' Long +0.88' Cap Length x 2 = 65.82' Row Length +12.0" End Stone x 2 = 67.82' Base Length


7 Rows x 51.0" Wide + 6.0" Spacing x 6 + 12.0" Side Stone x 2 = 34.75' Base Width 33.0" Chamber Height + 6.0" Stone Cover = 3.25' Field Height

63 Chambers x 50.6 cf + 3.4 cf Cap Volume x 2 x 7 Rows = 3,235.2 cf Chamber Storage

7,659.0 cf Field - 3,235.2 cf Chambers = 4,423.9 cf Stone x 40.0% Voids = 1,769.5 cf Stone Storage

Chamber Storage + Stone Storage = 5,004.7 cf = 0.115 af Overall Storage Efficiency = 65.3% Overall System Size = 67.82' x 34.75' x 3.25'

63 Chambers 283.7 cy Field 163.8 cy Stone

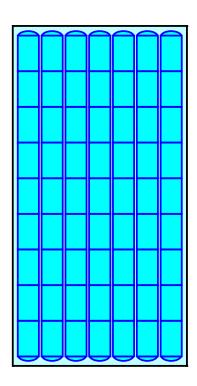



Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 26

Summary for Pond ED-1: MODIFIED DRAINAGE DITCH

Inflow Area = 2.276 ac, 22.22% Impervious, Inflow Depth = 1.89" for 10-Year event Inflow 3.31 cfs @ 12.30 hrs, Volume= 0.359 af 3.31 cfs @ 12.30 hrs, Volume= Outflow 0.359 af, Atten= 0%, Lag= 0.2 min Primary = 3.31 cfs @ 12.30 hrs, Volume= 0.359 af Routed to Link DP-2: DP-2 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af Routed to Link DP-2: DP-2 0.00 hrs, Volume= 0.000 af Tertiary = 0.00 cfs @ Routed to Link DP-2: DP-2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Peak Elev= 252.3564' @ 12.30 hrs Surf.Area= 102 sf Storage= 44 cf

Plug-Flow detention time= 1.1 min calculated for 0.359 af (100% of inflow) Center-of-Mass det. time= 0.4 min (856.4 - 856.0)

Volume	Inv	ert Avail.Sto	rage Storage	Description	
#1	251.40	00' 13,4	98 cf Custom	Stage Data (P	rismatic)Listed below (Recalc)
Eleva	ation	Surf.Area	Inc.Store	Cum.Store	
(1	feet)	(sq-ft)	(cubic-feet)	(cubic-feet)	
251.4	1000	20	0	0	
252.0	0000	41	18	18	
253.0	0000	212	127	145	
254.0	0000	550	381	526	
255.0	0000	1,071	811	1,336	
256.0	0000	5,565	3,318	4,654	
257.0	0000	12,122	8,844 13,498		
Device	Routing	Invert	Outlet Device	S	
#1	Primary	251.4000'	32.0" Round	l Culvert	
			L= 55.0' CM	P, end-section of	conforming to fill, Ke= 0.500
			Inlet / Outlet I	nvert= 251.4000	0' / 251.0900' S= 0.0056 '/' Cc=
			0.900 n= 0.0	25 Corrugated	metal, Flow Area= 5.59 sf
#2	Secondary	256.7500'	4.0" x 4.0" H	oriz. Orifice/Gr	ate X 5.00 columns
			X 4 rows C= (0.600 in 24.0" x	24.0" Grate (56% open area)
				ir flow at low hea	
#3	Tertiary	256.9500'			oad-Crested Rectangular Weir
			Head (feet) 0	.2000 0.4000 (0.6000 0.8000 1.0000 1.2000 1.4000

1.6000 1.8000 2.0000 2.5000 3.0000

3.30 3.31 3.32

Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31

Type III 24-hr 10-Year Rainfall=4.30" Printed 12/3/2024

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 27

Primary OutFlow Max=3.30 cfs @ 12.30 hrs HW=252.3557' TW=0.0000' (Dynamic Tailwater) 1=Culvert (Barrel Controls 3.30 cfs @ 2.73 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=251.4000' TW=0.0000' (Dynamic Tailwater) 2=Orifice/Grate (Controls 0.00 cfs)

Tertiary OutFlow Max=0.00 cfs @ 0.00 hrs HW=251.4000' TW=0.0000' (Dynamic Tailwater) 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Type III 24-hr 10-Year Rainfall=4.30"

Prepared by Woodard & Curran, Inc

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 28

Summary for Link DP-1: DP-1

Inflow Area = 2.003 ac, 27.40% Impervious, Inflow Depth > 1.94" for 10-Year event

Inflow = 2.24 cfs @ 12.23 hrs, Volume= 0.323 af

Primary = 2.24 cfs @ 12.23 hrs, Volume= 0.323 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

Type III 24-hr 10-Year Rainfall=4.30"

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Printed 12/3/2024

Page 29

Summary for Link DP-2: DP-2

Inflow Area = 2.276 ac, 22.22% Impervious, Inflow Depth = 1.89" for 10-Year event

Inflow = 3.31 cfs @ 12.30 hrs, Volume= 0.359 af

Primary = 3.31 cfs @ 12.30 hrs, Volume= 0.359 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

Prepared by Woodard & Curran, Inc

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 30

Summary for Subcatchment PWA-1A: PWA-1A

Runoff = 3.33 cfs @ 12.23 hrs, Volume= 0.326 af, Depth= 2.60"

Routed to Link DP-1: DP-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr 25-Year Rainfall=5.40"

Are	ea (sf)	CN A	Adj Desc	ription					
	2,081	98	Unco	Unconnected roofs, HSG B					
1	3,042	69	50-7	5% Grass o	cover, Fair, HSG B				
	940	58	Mea	dow, non-g	razed, HSG B				
	1,275	56	Brus	h, Fair, HS	G B				
1	3,166	60	Woo	ds, Fair, H	SG B				
	3,526	98	Unco	nnected ro	oofs, HSG D				
	3,597	84	50-7	5% Grass o	cover, Fair, HSG D				
2	7,316	79	Woo	ds, Fair, H	SG D				
	460	96	Grav	el surface,	HSG B				
	103	96	Grav	el surface,	HSG D				
6	5,506	74	73 Weig	hted Avera	age, UI Adjusted				
5	9,899			4% Pervioυ					
	5,607		8.56	% Impervio	ous Area				
	5,607		100.0	00% Uncor	nnected				
Tc I	Length	Slope	Velocity	Capacity	Description				
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)					
8.1	100	0.0880	0.20		Sheet Flow,				
					Grass: Dense n= 0.240 P2= 3.00"				
0.7	103	0.2340	2.42		Shallow Concentrated Flow,				
					Woodland Kv= 5.0 fps				
1.7	123	0.0310	1.23		Shallow Concentrated Flow,				
					Short Grass Pasture Kv= 7.0 fps				
5.5	105	0.0040	0.32		Shallow Concentrated Flow,				
					Woodland Kv= 5.0 fps				
16.0	431	Total							

Type III 24-hr 25-Year Rainfall=5.40"

Prepared by Woodard & Curran, Inc

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 31

Summary for Subcatchment PWA-1B: PWA-1B

Runoff = 2.45 cfs @ 12.09 hrs, Volume= 0.191 af, Depth= 4.59"

Routed to Pond 1P : Detention System

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr 25-Year Rainfall=5.40"

	Α	rea (sf)	CN	Description					
,		3,994	98	Unconnecte	ed roofs, H	SG B			
		3,437	69	50-75% Gra	ass cover, l	Fair, HSG B			
		11,073	98	Paved park	ing, HSG E	3			
		105	98	Unconnecte	ed roofs, H	SG D			
		3,130	98	Paved park	ing, HSG [)			
		21,739	93	Weighted Average					
		3,437		15.81% Pei	rvious Area	l			
		18,302		84.19% Imp	pervious Ar	ea			
		4,099		22.40% Unconnected					
	Тс	Length	Slope	•	Capacity	Description			
(r	min)	(feet)	(ft/ft)	(ft/sec)	(cfs)				
	6.0					Direct Entry			

6.0

Direct Entry,

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 32

Summary for Subcatchment PWA-2: PWA-2

Runoff = 4.90 cfs @ 12.29 hrs, Volume= 0.527 af, Depth= 2.78"

Routed to Pond ED-1: MODIFIED DRAINAGE DITCH

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr 25-Year Rainfall=5.40"

A	rea (sf)	CN A	Adj Desc	ription				
	567	98	Pave	d parking,	HSG B			
	4,630	98			oofs, HSG B			
	4,366	69			cover, Fair, HSG B			
	8,044	56		h, Fair, HS				
	9,309	58			razed, HSG B			
	12,736	60		ds, Fair, H				
	11,099	98		d parking,				
	5,731	98			oofs, HSG D			
	5,659	84			cover, Fair, HSG D			
	12,326	77		h, Fair, HS				
	23,886	79		ds, Fair, H				
	634	96		el surface,				
	166	96		Gravel surface, HSG D				
	99,153	77	75 Weig	hted Avera	age, UI Adjusted			
	77,126			3% Perviou				
	22,027		22.2	2% Impervi	ious Area			
	10,361			1% Unconr				
	,							
Tc	Length	Slope	Velocity	Capacity	Description			
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)				
12.5	100	0.0840	0.13		Sheet Flow,			
					Woods: Light underbrush n= 0.400 P2= 3.00"			
1.0	126	0.1880	2.17		Shallow Concentrated Flow,			
					Woodland Kv= 5.0 fps			
0.4	48	0.0870	2.06		Shallow Concentrated Flow,			
					Short Grass Pasture Kv= 7.0 fps			
2.4	136	0.0180	0.94		Shallow Concentrated Flow,			
					Short Grass Pasture Kv= 7.0 fps			
4.4	277	0.0220	1.04		Shallow Concentrated Flow,			
					Short Grass Pasture Kv= 7.0 fps			
20.7	687	Total						

Prepared by Woodard & Curran, Inc

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 33

Summary for Pond 1P: Detention System

Inflow Area = 0.499 ac, 84.19% Impervious, Inflow Depth = 4.59" for 25-Year event

Inflow = 2.45 cfs @ 12.09 hrs, Volume= 0.191 af

Outflow = 0.82 cfs @ 12.39 hrs, Volume= 0.148 af, Atten= 67%, Lag= 17.9 min

Primary = 0.82 cfs @ 12.39 hrs, Volume= 0.148 af

Routed to Link DP-1: DP-1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Peak Elev= 256.3922' @ 12.39 hrs Surf.Area= 0.054 ac Storage= 0.108 af

Plug-Flow detention time= 610.4 min calculated for 0.148 af (78% of inflow)

Center-of-Mass det. time= 531.9 min (1,307.9 - 776.0)

Volume	Invert	Avail.Storage	Storage Description
#1A	253.4700'	0.041 af	34.75'W x 67.82'L x 3.25'H Field A
			0.176 af Overall - 0.074 af Embedded = 0.102 af x 40.0% Voids
#2A	253.4700'	0.074 af	ADS_StormTech SC-800 +Cap x 63 Inside #1
			Effective Size= 45.0"W x 33.0"H => 7.11 sf x 7.12'L = 50.6 cf
			Overall Size= 51.0"W x 33.0"H x 7.55'L with 0.43' Overlap
			63 Chambers in 7 Rows
			Cap Storage= 3.4 cf x 2 x 7 rows = 47.9 cf
		0.115 af	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	253.4700'	12.0" Round Culvert
			L= 13.5' CPP, end-section conforming to fill, Ke= 0.500
			Inlet / Outlet Invert= 253.4700' / 253.3300' S= 0.0104 '/' Cc=
			0.900
			n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Primary	256.2500'	5.0' long x 0.5' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.2000 0.4000 0.6000 0.8000 1.0000
			Coef. (English) 2.80 2.92 3.08 3.30 3.32
#3	Device 1	256.7000'	5.0' long Sharp-Crested Rectangular Weir 2 End Contraction(s)
#4	Primary	253.4700'	Asymmetrical Weir, C= 3.27
			Offset (feet) 0.0000 0.1000 0.1000 0.1042 0.1042 0.2100
			Height (feet) 3.23 3.23 0.00 0.00 3.23 3.23

Primary OutFlow Max=0.81 cfs @ 12.39 hrs HW=256.3906' TW=0.0000' (Dynamic Tailwater)

-1=Culvert (Passes 0.00 cfs of 5.88 cfs potential flow)

1 3=Sharp-Crested Rectangular Weir (Controls 0.00 cfs)

-2=Broad-Crested Rectangular Weir (Weir Controls 0.74 cfs @ 1.05 fps)

-4=Asymmetrical Weir (Weir Controls 0.07 cfs @ 5.59 fps)

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 34

Pond 1P: Detention System - Chamber Wizard Field A

Chamber Model = ADS_StormTechSC-800 +Cap (ADS StormTech®SC-800 with cap volume)

Effective Size= 45.0"W x 33.0"H => 7.11 sf x 7.12'L = 50.6 cf Overall Size= 51.0"W x 33.0"H x 7.55'L with 0.43' Overlap Cap Storage= 3.4 cf x 2 x 7 rows = 47.9 cf

51.0" Wide + 6.0" Spacing = 57.0" C-C Row Spacing

9 Chambers/Row x 7.12' Long +0.88' Cap Length x 2 = 65.82' Row Length +12.0" End Stone x 2 = 67.82' Base Length


7 Rows x 51.0" Wide + 6.0" Spacing x 6 + 12.0" Side Stone x 2 = 34.75' Base Width 33.0" Chamber Height + 6.0" Stone Cover = 3.25' Field Height

63 Chambers x 50.6 cf + 3.4 cf Cap Volume x 2 x 7 Rows = 3,235.2 cf Chamber Storage

7,659.0 cf Field - 3,235.2 cf Chambers = 4,423.9 cf Stone x 40.0% Voids = 1,769.5 cf Stone Storage

Chamber Storage + Stone Storage = 5,004.7 cf = 0.115 af Overall Storage Efficiency = 65.3% Overall System Size = 67.82' x 34.75' x 3.25'

63 Chambers 283.7 cy Field 163.8 cy Stone

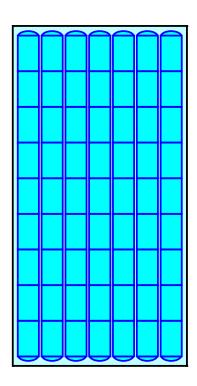



Prepared by Woodard & Curran, Inc

Volume

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 35

Summary for Pond ED-1: MODIFIED DRAINAGE DITCH

Inflow Area = 2.276 ac, 22.22% Impervious, Inflow Depth = 2.78" for 25-Year event Inflow 4.90 cfs @ 12.29 hrs, Volume= 0.527 af 4.90 cfs @ 12.30 hrs, Volume= Outflow 0.527 af, Atten= 0%, Lag= 0.3 min Primary = 4.90 cfs @ 12.30 hrs, Volume= 0.527 af Routed to Link DP-2: DP-2 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af Routed to Link DP-2: DP-2 0.00 hrs, Volume= 0.000 af Tertiary 0.00 cfs @ Routed to Link DP-2: DP-2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Peak Elev= 252.5664' @ 12.30 hrs Surf.Area= 138 sf Storage= 69 cf

Plug-Flow detention time= 1.1 min calculated for 0.527 af (100% of inflow) Center-of-Mass det. time= 0.3 min (845.2 - 844.9)

Invert Avail.Storage Storage Description

				9				
#1	251.4000)' 13,49	98 cf Custo	om Stage Data (Prismatic)Listed below (Recalc)				
Eleva	ation S	Surf.Area	Inc.Store	Cum.Store				
(feet)	(sq-ft)	(cubic-feet)	(cubic-feet)				
251.4	4000	20	0	0				
252.0	0000	41	18	18				
253.0	0000	212	127	145				
254.0	0000	550	381	526				
255.0		1,071	811	1,336				
256.0		5,565	3,318	· · · · · · · · · · · · · · · · · · ·				
257.0	0000	12,122	8,844	13,498				
Device	Routing	Invert	Outlet Devi	ces				
#1	Primary	251.4000'	32.0" Rou	nd Culvert				
			L= 55.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 251.4000' / 251.0900' S= 0.0056 '/' Cc= 0.900 n= 0.025 Corrugated metal, Flow Area= 5.59 sf					
#2	Secondary	256.7500'		Horiz. Orifice/Grate X 5.00 columns				
	•		X 4 rows C= 0.600 in 24.0" x 24.0" Grate (56% open area)					
			Limited to v	veir flow at low heads				
#3	Tertiary	256.9500'	55.0' long x 1.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.2000 0.4000 0.6000 0.8000 1.0000 1.2000 1.4000 1.6000 1.8000 2.0000 2.5000 3.0000 Coef. (English) 2.69 2.72 2.75 2.85 2.98 3.08 3.20 3.28 3.31 3.30 3.31 3.32					

Type III 24-hr 25-Year Rainfall=5.40" Printed 12/3/2024

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 36

Primary OutFlow Max=4.89 cfs @ 12.30 hrs HW=252.5653' TW=0.0000' (Dynamic Tailwater) 1=Culvert (Barrel Controls 4.89 cfs @ 3.07 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=251.4000' TW=0.0000' (Dynamic Tailwater) 2=Orifice/Grate (Controls 0.00 cfs)

Tertiary OutFlow Max=0.00 cfs @ 0.00 hrs HW=251.4000' TW=0.0000' (Dynamic Tailwater) 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Type III 24-hr 25-Year Rainfall=5.40"

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Printed 12/3/2024

Page 37

Summary for Link DP-1: DP-1

Inflow Area = 2.003 ac, 27.40% Impervious, Inflow Depth > 2.84" for 25-Year event

Inflow = 3.51 cfs @ 12.35 hrs, Volume= 0.474 af

Primary = 3.51 cfs @ 12.35 hrs, Volume= 0.474 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

Type III 24-hr 25-Year Rainfall=5.40"

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Printed 12/3/2024 Page 38

... f. III DD 0 DD 0

Summary for Link DP-2: DP-2

Inflow Area = 2.276 ac, 22.22% Impervious, Inflow Depth = 2.78" for 25-Year event

Inflow = 4.90 cfs @ 12.30 hrs, Volume= 0.527 af

Primary = 4.90 cfs @ 12.30 hrs, Volume= 0.527 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 39

Summary for Subcatchment PWA-1A: PWA-1A

Runoff = 4.63 cfs @ 12.22 hrs, Volume= 0.447 af, Depth= 3.57"

Routed to Link DP-1: DP-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr Custom Rainfall=6.57"

Aı	rea (sf)	CN A	Adj Desc	ription				
	2,081	98	Unco	Unconnected roofs, HSG B				
	13,042	69	50-7	5% Grass	cover, Fair, HSG B			
	940	58	Mea	dow, non-g	razed, HSG B			
	1,275	56	Brus	h, Fair, HS	G B			
	13,166	60	Woo	ds, Fair, H	SG B			
	3,526	98	Unco	onnected ro	oofs, HSG D			
	3,597	84	50-7	5% Grass o	cover, Fair, HSG D			
	27,316	79	Woo	ds, Fair, H	SG D			
	460	96	Grav	el surface,	HSG B			
	103	96	Grav	el surface,	HSG D			
	65,506	74	73 Weig	hted Avera	age, UI Adjusted			
	59,899		91.4	4% Perviou	us Area			
	5,607		8.56	% Impervio	ous Area			
	5,607		100.0	00% Uncor	nnected			
Tc	Length	Slope	Velocity	Capacity	Description			
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)				
8.1	100	0.0880	0.20		Sheet Flow,			
					Grass: Dense n= 0.240 P2= 3.00"			
0.7	103	0.2340	2.42		Shallow Concentrated Flow,			
					Woodland Kv= 5.0 fps			
1.7	123	0.0310	1.23		Shallow Concentrated Flow,			
					Short Grass Pasture Kv= 7.0 fps			
5.5	105	0.0040	0.32		Shallow Concentrated Flow,			
					Woodland Kv= 5.0 fps			
16.0	431	Total						

Type III 24-hr Custom Rainfall=6.57"

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Printed 12/3/2024

Page 40

Summary for Subcatchment PWA-1B: PWA-1B

Runoff = 3.03 cfs @ 12.09 hrs, Volume= 0.239 af, Depth= 5.75"

Routed to Pond 1P : Detention System

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr Custom Rainfall=6.57"

	Α	rea (sf)	CN	Description					
,		3,994	98	Unconnecte	ed roofs, H	SG B			
		3,437	69	50-75% Gra	ass cover, l	Fair, HSG B			
		11,073	98	Paved park	ing, HSG E	3			
		105	98	Unconnecte	ed roofs, H	SG D			
		3,130	98	Paved park	ing, HSG [)			
		21,739	93	Weighted Average					
		3,437		15.81% Pei	rvious Area	l			
		18,302		84.19% Imp	pervious Ar	ea			
		4,099		22.40% Unconnected					
	Тс	Length	Slope	•	Capacity	Description			
(r	min)	(feet)	(ft/ft)	(ft/sec)	(cfs)				
	6.0					Direct Entry			

6.0

Direct Entry,

Prepared by Woodard & Curran, Inc

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 41

Summary for Subcatchment PWA-2: PWA-2

Runoff = 6.67 cfs @ 12.29 hrs, Volume= 0.716 af, Depth= 3.77"

Routed to Pond ED-1: MODIFIED DRAINAGE DITCH

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Type III 24-hr Custom Rainfall=6.57"

A	rea (sf)	CN A	Adj Desc	ription				
	567	98	Pave	d parking,	HSG B			
	4,630	98			oofs, HSG B			
	4,366	69			cover, Fair, HSG B			
	8,044	56		h, Fair, HS				
	9,309	58			razed, HSG B			
	12,736	60		ds, Fair, H				
	11,099	98		d parking,				
	5,731	98			oofs, HSG D			
	5,659	84			cover, Fair, HSG D			
	12,326	77		h, Fair, HS				
	23,886	79		ds, Fair, H				
	634	96		el surface,				
	166	96		Gravel surface, HSG D				
	99,153	77	75 Weig	hted Avera	age, UI Adjusted			
	77,126			3% Perviou				
	22,027		22.2	2% Impervi	ious Area			
	10,361			1% Unconr				
	,							
Tc	Length	Slope	Velocity	Capacity	Description			
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)				
12.5	100	0.0840	0.13		Sheet Flow,			
					Woods: Light underbrush n= 0.400 P2= 3.00"			
1.0	126	0.1880	2.17		Shallow Concentrated Flow,			
					Woodland Kv= 5.0 fps			
0.4	48	0.0870	2.06		Shallow Concentrated Flow,			
					Short Grass Pasture Kv= 7.0 fps			
2.4	136	0.0180	0.94		Shallow Concentrated Flow,			
					Short Grass Pasture Kv= 7.0 fps			
4.4	277	0.0220	1.04		Shallow Concentrated Flow,			
					Short Grass Pasture Kv= 7.0 fps			
20.7	687	Total						

Prepared by Woodard & Curran, Inc

Printed 12/3/2024

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 42

Summary for Pond 1P: Detention System

Inflow Area = 0.499 ac, 84.19% Impervious, Inflow Depth = 5.75" for Custom event

Inflow = 3.03 cfs @ 12.09 hrs, Volume= 0.239 af

Outflow = 2.35 cfs @ 12.17 hrs, Volume= 0.195 af, Atten= 23%, Lag= 5.2 min

Primary = 2.35 cfs @ 12.17 hrs, Volume= 0.195 af

Routed to Link DP-1: DP-1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Peak Elev= 256.5604' @ 12.17 hrs Surf.Area= 0.054 ac Storage= 0.111 af

Plug-Flow detention time= 494.3 min calculated for 0.195 af (82% of inflow)

Center-of-Mass det. time= 422.6 min (1,193.0 - 770.5)

Volume	Invert	Avail.Storage	Storage Description
#1A	253.4700'	0.041 af	34.75'W x 67.82'L x 3.25'H Field A
			0.176 af Overall - 0.074 af Embedded = 0.102 af x 40.0% Voids
#2A	253.4700'	0.074 af	ADS_StormTech SC-800 +Capx 63 Inside #1
			Effective Size= 45.0"W x 33.0"H => 7.11 sf x 7.12'L = 50.6 cf
			Overall Size= 51.0"W x 33.0"H x 7.55'L with 0.43' Overlap
			63 Chambers in 7 Rows
			Cap Storage= 3.4 cf x 2 x 7 rows = 47.9 cf
·		0.445 (T 1 1 A 3 1 1 1 O1

0.115 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	253.4700'	12.0" Round Culvert
			L= 13.5' CPP, end-section conforming to fill, Ke= 0.500
			Inlet / Outlet Invert= 253.4700' / 253.3300' S= 0.0104 '/' Cc=
			0.900
			n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Primary	256.2500'	5.0' long x 0.5' breadth Broad-Crested Rectangular Weir
			Head (feet) 0.2000 0.4000 0.6000 0.8000 1.0000
			Coef. (English) 2.80 2.92 3.08 3.30 3.32
#3	Device 1	256.7000'	5.0' long Sharp-Crested Rectangular Weir 2 End Contraction(s)
#4	Primary	253.4700'	Asymmetrical Weir, C= 3.27
			Offset (feet) 0.0000 0.1000 0.1000 0.1042 0.1042 0.2100
			Height (feet) 3.23 3.23 0.00 0.00 3.23 3.23

Primary OutFlow Max=2.09 cfs @ 12.17 hrs HW=256.5216' TW=0.0000' (Dynamic Tailwater)

—1=Culvert (Passes 0.00 cfs of 6.04 cfs potential flow)

1 1 3=Sharp-Crested Rectangular Weir (Controls 0.00 cfs)

-2=Broad-Crested Rectangular Weir (Weir Controls 2.01 cfs @ 1.48 fps)

-4=Asymmetrical Weir (Weir Controls 0.07 cfs @ 5.71 fps)

Prepared by Woodard & Curran, Inc HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 43

Pond 1P: Detention System - Chamber Wizard Field A

Chamber Model = ADS_StormTechSC-800 +Cap (ADS StormTech®SC-800 with cap volume)

Effective Size= 45.0"W x 33.0"H => 7.11 sf x 7.12'L = 50.6 cf Overall Size= 51.0"W x 33.0"H x 7.55'L with 0.43' Overlap Cap Storage= 3.4 cf x 2 x 7 rows = 47.9 cf

51.0" Wide + 6.0" Spacing = 57.0" C-C Row Spacing

9 Chambers/Row x 7.12' Long +0.88' Cap Length x 2 = 65.82' Row Length +12.0" End Stone x 2 = 67.82' Base Length


7 Rows x 51.0" Wide + 6.0" Spacing x 6 + 12.0" Side Stone x 2 = 34.75' Base Width 33.0" Chamber Height + 6.0" Stone Cover = 3.25' Field Height

63 Chambers x 50.6 cf + 3.4 cf Cap Volume x 2 x 7 Rows = 3,235.2 cf Chamber Storage

7,659.0 cf Field - 3,235.2 cf Chambers = 4,423.9 cf Stone x 40.0% Voids = 1,769.5 cf Stone Storage

Chamber Storage + Stone Storage = 5,004.7 cf = 0.115 af Overall Storage Efficiency = 65.3% Overall System Size = 67.82' x 34.75' x 3.25'

63 Chambers 283.7 cy Field 163.8 cy Stone

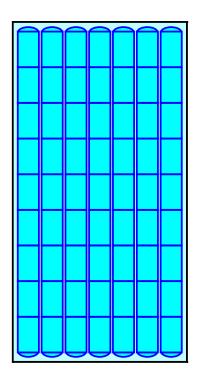



Prepared by Woodard & Curran, Inc

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 44

Summary for Pond ED-1: MODIFIED DRAINAGE DITCH

Inflow Area = 2.276 ac, 22.22% Impervious, Inflow Depth = 3.77" for Custom event Inflow 6.67 cfs @ 12.29 hrs, Volume= 0.716 af 6.67 cfs @ 12.29 hrs, Volume= Outflow 0.716 af, Atten= 0%, Lag= 0.3 min Primary = 6.67 cfs @ 12.29 hrs, Volume= 0.716 af Routed to Link DP-2: DP-2 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af Routed to Link DP-2: DP-2 0.00 hrs, Volume= Tertiary 0.00 cfs @ 0.000 af Routed to Link DP-2: DP-2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs Peak Elev= 252.7686' @ 12.29 hrs Surf.Area= 172 sf Storage= 100 cf

Plug-Flow detention time= 0.3 min calculated for 0.715 af (100% of inflow) Center-of-Mass det. time= 0.3 min (836.4 - 836.1)

Volume	Inve	ert Avail.Sto	rage Storage	Description	
#1	251.400	00' 13,49	98 cf Custom	Stage Data (F	Prismatic)Listed below (Recalc)
		0.14	. 01	0 01	
Eleva		Surf.Area	Inc.Store	Cum.Store	
	feet)	(sq-ft)	(cubic-feet)	(cubic-feet)	
251.4	1000	20	0	0	
252.0	0000	41	18	18	
253.0	0000	212	127	145	
254.0	0000	550	381	526	
255.0	0000	1,071	811	1,336	
256.0	0000	5,565	3,318	4,654	
257.0	0000	12,122	8,844	13,498	
		,	-,-	-,	
Device	Routing	Invert	Outlet Device	s	
#1	Primary	251.4000'	32.0" Round	d Culvert	
	,		L= 55.0' CM	P, end-section	conforming to fill, Ke= 0.500
					0' / 251.0900' S= 0.0056 '/' Cc=
			0.900 n= 0.0	25 Corrugated	I metal, Flow Area= 5.59 sf
#2	Secondary	256.7500'			rate X 5.00 columns
	· · · · · · · · · · · · · · · ·				24.0" Grate (56% open area)
				ir flow at low he	• • • • • • • • • • • • • • • • • • • •
#3	Tertiary	256.9500'			road-Crested Rectangular Weir
110	rordary	200.0000			0.6000 0.8000 1.0000 1.2000 1.4000
			` ,	0 2.0000 2.50	
					.75 2.85 2.98 3.08 3.20 3.28 3.31
			3.30 3.31 3.3		2.00 2.90 3.00 3.20 3.20 3.31
			5.50 5.51 5.	J <u>Z</u>	

Type III 24-hr Custom Rainfall=6.57"
Printed 12/3/2024

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 45

Primary OutFlow Max=6.65 cfs @ 12.29 hrs HW=252.7659' TW=0.0000' (Dynamic Tailwater) 1=Culvert (Barrel Controls 6.65 cfs @ 3.36 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=251.4000' TW=0.0000' (Dynamic Tailwater) 2=Orifice/Grate (Controls 0.00 cfs)

Tertiary OutFlow Max=0.00 cfs @ 0.00 hrs HW=251.4000' TW=0.0000' (Dynamic Tailwater) 3=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Type III 24-hr Custom Rainfall=6.57"
Printed 12/3/2024

Prepared by Woodard & Curran, Inc

HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 46

Summary for Link DP-1: DP-1

Inflow Area = 2.003 ac, 27.40% Impervious, Inflow Depth > 3.85" for Custom event

Inflow = 6.63 cfs @ 12.20 hrs, Volume= 0.642 af

Primary = 6.63 cfs @ 12.20 hrs, Volume= 0.642 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

Type III 24-hr Custom Rainfall=6.57"
Printed 12/3/2024

Prepared by Woodard & Curran, Inc
HydroCAD® 10.20-5c s/n 01204 © 2023 HydroCAD Software Solutions LLC

Page 47

Summary for Link DP-2: DP-2

Inflow Area = 2.276 ac, 22.22% Impervious, Inflow Depth = 3.77" for Custom event

Inflow = 6.67 cfs @ 12.29 hrs, Volume= 0.716 af

Primary = 6.67 cfs (a) 12.29 hrs, Volume= 0.716 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

APPENDIX H. 24-hour duration rainfalls for various return periods

COUNTY	Storm Type	1-YR	2- YR	5- YR	10- YR	25- YR	50- YR	100- YR	500- YR
ANDROSCOGGIN	III	2.5	3.0	3.7	4.3	5.4	6.4	7.6	11.1
AROOSTOOK C (Presque Isle Area)	II	1.9	2.3	2.8	3.2	3.9	4.6	5.3	7.6
AROOSTOOK N (Fort Kent Area)	II	1.9	2.2	2.7	3.1	3.7	4.3	5.0	7.0
AROOSTOOK S (Houlton Area)	II	2.1	2.5	3.0	3.4	4.1	4.7	5.4	7.5
CUMBERLAND NW	III	2.5	3.0	3.7	4.3	5.4	6.3	7.5	10.9
(Bridgton Area) CUMBERLAND									
SE (N Windham Area)	III	2.6	3.1	3.9	4.6	5.8	6.9	8.1	12.1
FRANKLIN	II	2.0	2.4	2.9	3.4	4.2	4.9	5.7	8.2
HANCOCK KENNEBEC	III III	2.5 2.4	2.9 2.8	3.6 3.5	4.2 4.2	5.2 5.2	6.1 6.1	7.2 7.2	10.5 10.6
KNOX	III	2.6	3.2	3.9	4.6	5.7	6.7	7.9	11.5
LINCOLN	III	2.5	3.1	3.8	4.5	5.5	6.5	7.6	11.1
OXFORD E (Rumford Area)	Π^1	2.3	2.7	3.3	3.9	4.8	5.7	6.7	9.7
OXFORD W (Gilead Area)	II	2.2	2.7	3.4	4.0	4.9	5.8	6.9	10.1
PENOBSCOT N (Millinocket Area)	II	2.2	2.6	3.2	3.8	4.7	5.6	6.5	9.5
PENOBSCOT S (Hudson Area)	II	2.3	2.7	3.4	3.9	4.9	5.7	6.7	9.7
PISCATAQUIS N (Chesuncook Area)	II	2.0	2.4	2.9	3.4	4.2	5.0	5.8	8.5
PISCATAQUIS S (Monson Area)	II	2.2	2.7	3.3	3.9	4.8	5.7	6.8	10.0
SAGADAHOC	III	2.6	3.2	3.9	4.6	5.7	6.7	7.8	11.4
SOMERSET N (Pittston Farm Area)	II	2.0	2.3	2.8	3.3	4.0	4.7	5.4	7.8
SOMERSET S (Solon Area)	II	2.3	2.7	3.4	3.9	4.9	5.7	6.7	9.8
WALDO WASHINGTON	III III	2.4 2.5	2.9 2.8	3.6 3.4	4.2 3.9	5.2 4.8	6.1 5.5	7.2 6.4	10.5 9.0
YORK	III	2.6	3.3	4.1	4.9	6.2	7.3	8.7	13.2

¹ Use Type III rainfall for the towns of Brownfield, Buckfield, Denmark, Hartford, Hebron, Hiram, Oxford, and Porter.

Source: Data extracted by the Maine Department of Environmental Protection from the Northeast Regional Climate Center website (http://precip.eas.cornell.edu), Extreme Precipitation Tables. Data from this website was obtained from the National Oceanic and Atmospheric Administration's Regional Climate Center Program.

June 2014



woodardcurran.com

ATTACHMENT 09: PROOF OF FINANCIAL CAPACITY





City of Auburn, Maine

Financial Services

60 Court Street | Auburn, Maine 04210 www.auburnmaine.gov | 207.333.6601

December 3, 2024

To whom it may concern,

The City of Auburn has the financial capacity to manage the Engine 2 Station Reconstruction project as a result of successful bonding in fiscal year 2025, and approved Capital Improvement Plan to bond the additional funds to complete the project in fiscal year 2026.

Sincerely,

Kelsey L. D. Earle

Finance Director, City of Auburn

ATTACHMENT 10: AWSD UTILITY CAPACITY CONFIRMATION



Robert Angelo

From: Mike Broadbent <mbr/>broadbent@awsd.org>

Sent:
Wednesday, December 4, 2024 12:44 PM

To:
Robert Angelo; Matthew Waite; Greg Jalbert

Caitlin Suhr; Ross Tsantoulis; Julia Tate; Kenneth Coley; Dan Goyette; Kris Bennett

(Auburn)

Subject: RE: Auburn Engine 2 - Water and Sewer Capacity

Attachments: 0706.JPG

Thanks Robert, we have sufficient capacity to meet you request. Attached is the physical record for the water service at 180 S. Main Street. The District's water main was replaced in 2014 with 12" pipe. The sewer main was re-lined at the same time however we do not have a service record for the station.

Mike

From: Robert Angelo < RAngelo @woodardcurran.com>

Sent: Wednesday, December 4, 2024 12:27 PM

To: Matthew Waite <mwaite@awsd.org>; Greg Jalbert <gjalbert@awsd.org>; Mike Broadbent

<mbroadbent@awsd.org>

Cc: Caitlin Suhr <CSuhr@woodardcurran.com>; Ross Tsantoulis <RTsantoulis@woodardcurran.com>; Julia Tate

<julia@simonsarchitects.com>; Kenneth Coley <Kenneth.Coley@salasobrien.com>; Dan Goyette

<dgoyette@auburnmaine.gov>; Kris Bennett (Auburn) <kbennett@auburnmaine.gov>

Subject: Auburn Engine 2 - Water and Sewer Capacity

Matt,

We're working with the City on the design for a new firestation at 180 S Main St and were hoping you could verify the existing watermain and sewer main have sufficient capacity for the proposed building's demand.

Peak estimated domestic water demand is 35 gpm without a truck fill. With a 2" truck fill at an assumed domestic water pressure of 60 psi, the peak demand could be as high as \approx 330 gpm. The estimated sewer discharge is \approx 580 gallons per day.

Also – Please let us know if there are any record documents available for the existing sewer service to the existing Engine 2 station (180 S Maint St).

Let us know if you have any questions or need any additional information.

Thank you!

Robert Angelo, PE (MA)

Project Engineer





ATTACHMENT 11: NATURAL RESOURCE DELINEATIONS MEMO





TO: Caitlin Glass, Woodard & Curran

FROM: Elliott Boardman & Kevin Ryan, FBE

SUBJECT: Auburn, Maine Wetland Delineation

DATE: April 10, 2023

CC: Forrest Bell, FB Environmental Associates

Attachments: 1) Cowardin Wetland Classification System 2) Wetland Delineation Map; 3) Site

Photographs; 4) Natural Resource Agency Correspondence; 4) Completed USACE

MEMORANDUN

Wetland Determination Data Forms

On March 31, 2023, FB Environmental Associates (FBE) delineated wetlands at the Engine 2 Fire Station in Auburn, Maine at the request of Woodard & Curran. The Survey Area is an approximately 2-acre parcel, located at 180 South Main Street.

Prior to the field investigation, FBE reviewed existing information relevant to wetlands on the site: aerial photographs, National Wetlands Inventory (NWI) maps, and soil maps. FBE also corresponded with the Maine Natural Areas Program (MNAP) regarding the presence of rare or unique botanical features, and the Maine Department of Inland Fisheries and Wildlife (MDIFW) to inquire about known locations of Endangered, Threatened, and Special Concern species; designated Essential and Significant Wildlife Habitats; and fisheries habitat concerns within the vicinity of the Survey Area.

WETLAND DELINEATION METHODOLOGY

Wetlands were identified and delineated in accordance with the 1987 US Army Corps of Engineers (USACE) Wetland Delineation Manual¹ using the methods described in the Regional Supplement to the Corps of Engineers Wetland Delineation Manual: Northcentral and Northeast Region, Version 2.0. ² (Copies of completed wetland determination data forms are available upon request.) All wetlands and watercourses were classified using the US Fish and Wildlife Service (USFWS) Classification of Wetlands and Deepwater Habitats of the United States. ³

Wetland boundaries were marked in the field using pink flagging emblazoned with the words "WETLAND DELINEATION." Boundaries of wetlands delineated during the field survey were geo-located using a sub-meter accuracy GPS unit (EOS Arrow-100). The collected GPS data were used to create the attached wetland delineation map.

¹ Environmental Laboratory. (1987). Corps of Engineers Wetlands Delineation Manual. Wetlands Research Program Technical Report Y-87-1. Vicksburg, MS: US Army Engineer Waterways Experiment Station.

² U.S. Army Corps of Engineers. 2012. Regional Supplement to the Corps of Engineers Wetland Delineation Manual: Northcentral and Northeast Region (Version 2.0), ed. J. S. Wakeley, R. W. Lichvar, C. V. Noble, and J. F. Berkowitz. ERDC/EL TR-12-1. Vicksburg, MS: U.S. Army Engineer Research and Development Center.

³ Cowardin, L. M., V. Carter, F. C. Golet, E. T. LaRoe. 1979. *Classification of wetlands and deepwater habitats of the United States*. U.S. Department of the Interior, Fish and Wildlife Service, Washington, D.C. 131pp.

WETLANDS OF SPECIAL SIGNIFICANCE

In Maine, Wetlands of Special Significance (WoSS) are regulated by the Maine Department of Environmental Protection under Chapter 310 of the Maine Natural Resources Protection Act. All coastal wetlands and great ponds (inland bodies of water >10 acres in size) are classified as WoSS. In addition, a freshwater wetland may be considered one of special significance if it: (1) contains a natural community that is critically imperiled or imperiled as defined by the Maine Natural Areas Program; (2) contains significant wildlife habitat; (3) is located within 250 feet of a coastal wetland; (4) is located within 250 feet of a great pond; (5) contains at least 20,000 square feet of aquatic vegetation, emergent marsh vegetation, or open water; (6) is inundated with floodwater during a 100-year flood event based on flood insurance maps; (7) is or contains peatlands; or (8) is located within 25 feet of a river, stream or brook. FBE assessed the Survey Area for the presence of WoSS.

RESULTS – NATURAL RESOURCE AGENCY CORRESPONDENCE

Reply correspondence to FBE's data inquiry letters to Maine natural resource agencies is attached to this memo.

Maine Natural Areas Program

MNAP correspondence states that according to the information currently in their Biological and Conservation Data System files, there are no rare botanical features documented specifically within the project area. Note however that the lack of data may indicate minimal survey efforts rather than confirm the absence of rare botanical features.

Maine Department of Inland Fisheries and Wildlife

MDIFW correspondence states that available information indicates that no locations of State-listed Endangered, Threatened, or Special Concern species within the project area would be affected by the project. MDIFW has not mapped any Essential or Significant Wildlife Habitats or inland fisheries habitats that would be directly affected by the project. Note that this review is only for known MDIFW jurisdictional features and should not be interpreted as a comprehensive review for the presence of other regulated features that may occur in this area.

RESULTS - GENERAL SITE DESCRIPTION

Fieldwork was conducted on 31 March 2023, by FBE's Ecological Services Lead and Senior Wetland Scientist Kevin Ryan and Wetland Scientist Elliott Boardman. The Survey Area is comprised of predominantly mowed field, most of which meets the criteria to be considered wetland. Small areas of scrub-shrub wetland are present along the northern and southern edges of the Survey Area. The northeastern portion of the Survey Area contains the fire station and its associated driveway.

Two wetlands and one ditch channel were identified and mapped within the Survey Area.

RESULTS - WETLANDS, WATERCOURSES, AND VERNAL POOLS

Wetland A

Wetland A comprises the majority of the Survey Area. The wetland has a seasonally flooded/saturated hydrologic regime and meets the classification of palustrine scrub-shrub/emergent marsh wetland (PSSI/PEMIE). The unmowed portion of the wetland complex, located along the south edge of the Survey Area contains scrub-shrub vegetation. The remainder of the wetland is maintained as field.

At the first USACE plot location, box elder (*Acer negundo*) is dominant in the canopy, with red-osier dogwood (*Cornus sericea*) and pussy willow (*Salix discolor*) dominant the shrub layer. Invasive purple loosestrife (*Lythrum salicaria*) is dominant in the herb stratum. Reed canary grass (*Phalaris arundinacea*) and sedges (*Carex* spp.) are also present.

Soils at the USACE plot location meet the criteria of All – *Depleted Below Dark Surface* and F3 – *Depleted Matrix* as the soil profile consists of a 2-inch layer of silt loam underlain by 14+ inches of depleted silty clay loam. The observed primary indicator of hydrology was Al – *Surface Water*.

The remainder of Wetland A is mowed field that meets the criteria to be considered wetland. At USACE plot within this location, soft rush (*Juncus effusus*) and reed canary grass dominate the herb stratum. Soils at the plot location meet the criteria of All – *Depleted Below Dark Surface* and F3 – *Depleted Matrix* as the soil consists of 2-inches of silt loam underlain by 14+ inches of silty clay loam with prominent redoximorphic features. The observed primary indicators of hydrology were Al – *Surface Water* and *A3 - Saturation*

Wetland A meets the technical criteria for being considered WoSS, with over 20,000 square feet of emergent vegetation present. However, it is important to note that much of the wetland is maintained as a field through seasonal mowing and is not a naturally occurring marsh.

To determine if Wetland A should be classified as a WoSS wetland, a field visit by the DEP may be required to assess the amount of emergent vegetation. If NRPA permitting is triggered by proposed activities at the site, a waiver to a lower tier may be warranted/necessary.


Wetland B


Wetland B encompasses a small area along the northwestern edge of the Survey Area. The wetland is seasonally flooded/saturated containing predominantly scrub-shrub vegetation with emergent vegetation present in mowed areas (PSSI/PEMIE). Purple loosestrife is dominant with nannyberry (*Viburnum lentago*) and small patches of sensitive fern (*Onoclea sensibilis*) present to a lesser extent.

Ditch 1


Ditch I is a linear ditch that runs parallel to the southern border of the Survey Area. Water flows west through the ditch and eventually meets a culvert running under the access road of an adjacent property. Water from the two culverts then flows north where it flows under South Main Street via a culvert and drains into a stream on the west side of South Main Street.

ATTACHMENT 1. COWARDIN WETLAND CLASSIFICATION SYSTEM

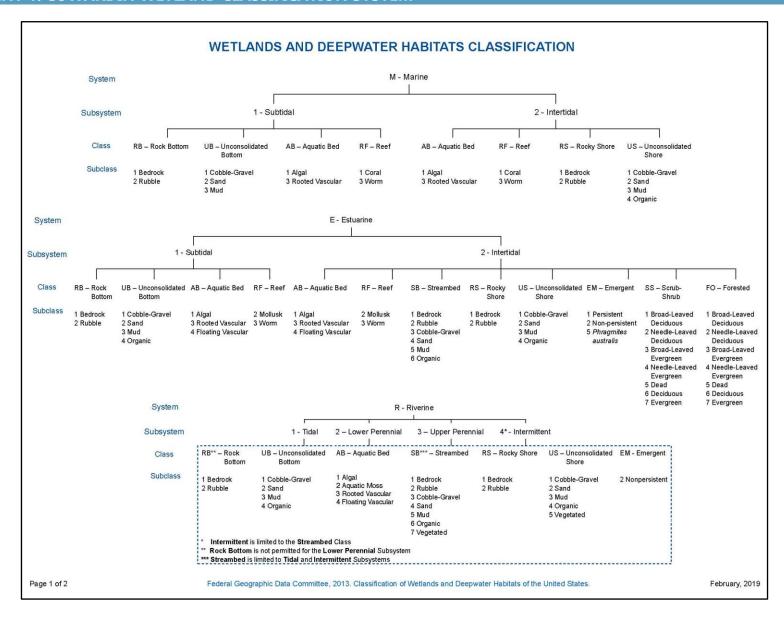

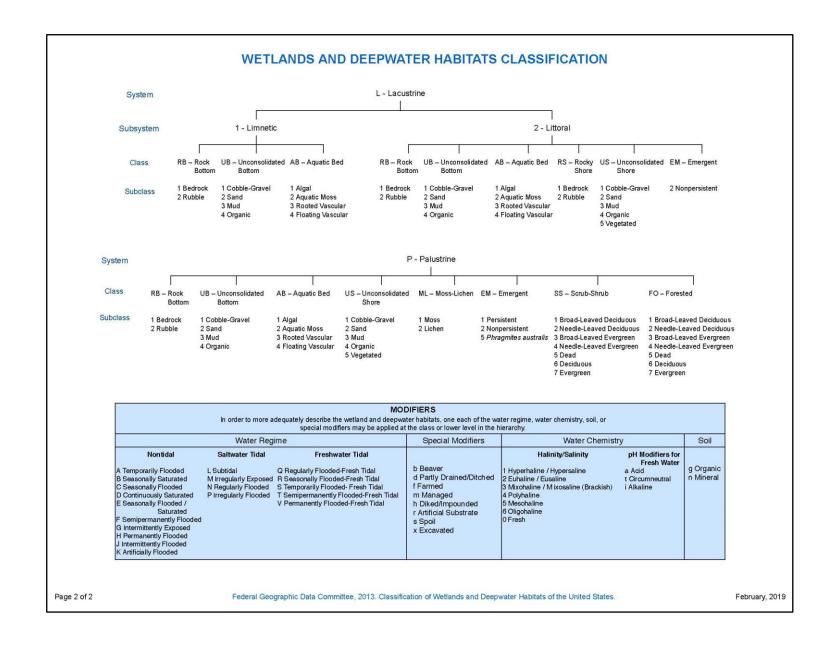

ATTACHMENT 2. WETLAND DELINEATION MAP

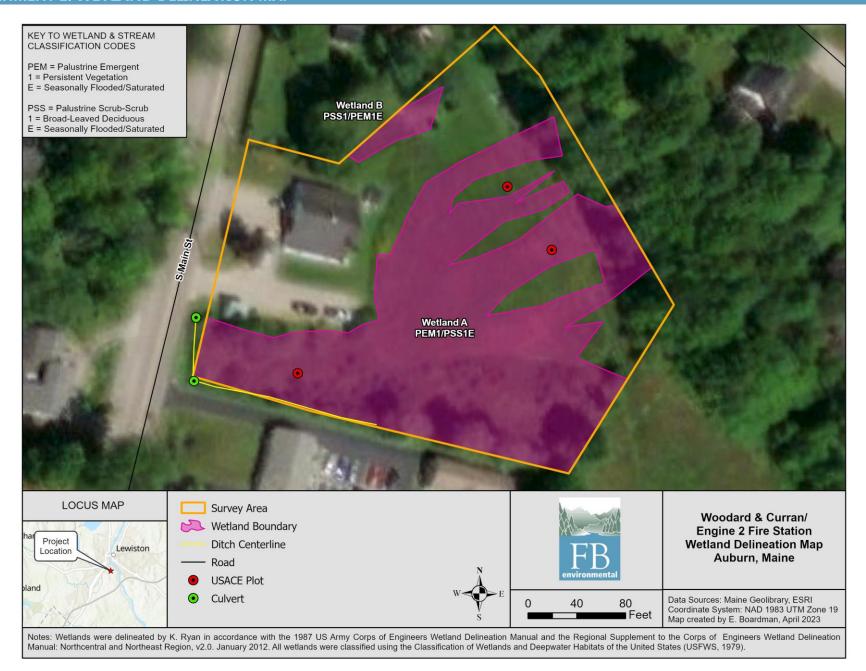

ATTACHMENT 3. SITE PHOTOGRAPHS



Photo 1. The seasonally flooded/saturated scrub-shrub (PSSIE) portion of wetland A from the USACE plot.



Photo 3. Wetland A from the USACE plot location (A-2 wet).



Photo 2. The majority of Wetland A is mowed seasonally flooded/saturated wetland with emergent vegetation (PEM1E).



Photo 4. A representative soil sample, showing prominent redoximorphic features, from the mowed portion of Wetland A



Photo 5. View of the mowed portion of Wetland A.



Photo 6. Wetland B is a seasonally flooded/saturated system with areas of scrub-shrub and emergent marsh vegetation (PSSI/PEMIE).



Photo 7. A representative view of mowed upland within the Survey Area.



Photo 8. Ditch I runs parallel to the southern border of the Survey Area

FB Environmental Associates | Auburn, Maine Wetland Delineation



Photo 9. Ditch 1 flows through a culvert under South Main Street.



Photo 10. View north of Ditch 1 where it enters the culvert under South Main Street.

ATTACHMENT 4. NATURAL RESOURCE AGENCY CORRESPONDENCE



STATE OF MAINE DEPARTMENT OF AGRICULTURE, CONSERVATION & FORESTRY

177 STATE HOUSE STATION AUGUSTA, MAINE 04333

AMANDA E, BEAL COMMISSIONER

JANET T. MILLS GOVERNOR

February 21, 2023

Elliott Boardman FB Environmental 97A Exchange Street, Suite 305 Portland, ME 04101

Via email: elliottb@fbenvironmental.com

Re: Rare and exemplary botanical features in proximity to: Engine 2 Fire Station, 180 South Main Street, Auburn, Maine

Dear Mr. Boardman:

I have searched the Maine Natural Areas Program's Biological and Conservation Data System files in response to your request received February 20, 2023 for information on the presence of rare or unique botanical features documented from the vicinity of the project in Auburn, Maine. Rare and unique botanical features include the habitat of rare, threatened, or endangered plant species and unique or exemplary natural communities. Our review involves examining maps, manual and computerized records, other sources of information such as scientific articles or published references, and the personal knowledge of staff or cooperating experts.

Our official response covers only botanical features. For authoritative information and official response for zoological features you must make a similar request to the Maine Department of Inland Fisheries and Wildlife, 284 State Street, Augusta, Maine 04333.

According to the information currently in our Biological and Conservation Data System files, there are no rare botanical features documented specifically within the project area. Based on the information in our files and the landscape context of this project, there is a low probability that rare or significant botanical features occur at this project location.

This finding is available and appropriate for preparation and review of environmental assessments, but it is not a substitute for on-site surveys. Comprehensive field surveys do not exist for all natural areas in Maine, and in the absence of a specific field investigation, the Maine Natural Areas Program cannot provide a definitive statement on the presence or absence of unusual natural features at this site.

The Maine Natural Areas Program (MNAP) is continuously working to achieve a more comprehensive database of exemplary natural features in Maine. We would appreciate the contribution of any information obtained should you decide to do field work. MNAP welcomes coordination with individuals or organizations proposing environmental alteration or conducting environmental assessments. If, however, data provided by MNAP are to be published in any form, the Program should be informed at the outset and credited as the source.

MOLLY DOCHERTY, DIRECTOR MAINE NATURAL AREAS PROGRAM BLOSSOM LANE, DEERING BUILDING



PHONE: (207) 287-8044 WWW.MAINE.GOV/DACF/MNAP Letter to FB Environmental Comments RE: Engine 2 Fire Sta, Auburn February 21, 2023 Page 2 of 2

The Maine Natural Areas Program has instituted a fee structure of \$75.00 an hour to recover the actual cost of processing your request for information. You will receive an invoice for \$150.00 for two hours of our services.

Thank you for using MNAP in the environmental review process. Please do not hesitate to contact me if you have further questions about the Natural Areas Program or about rare or unique botanical features on this site.

Sincerely,

Lisa St. Hilaire

Lisa St. Hilaire | Information Manager | Maine Natural Areas Program 207-287-8044 | lisa.st.hilaire@maine.gov



STATE OF MAINE DEPARTMENT OF INLAND FISHERIES & WILDLIFE 353 WATER STREET 41 STATE HOUSE STATION AUGUSTA ME 04333-0041



April 4, 2023

Elliott Boardman FB Environmental 97A Exchange Street, Suite 305 Portland, ME 04101

RE: Information Request - Engine 2 Fire Station Project, Auburn

Dear Elliott:

Per your request received on February 21, 2023, we have reviewed current Maine Department of Inland Fisheries and Wildlife (MDIFW) information for known locations of Endangered, Threatened, and Special Concern species; designated Essential and Significant Wildlife Habitats; and inland fisheries habitat concerns within the vicinity of the *Engine 2 Fire Station* project in *Auburn*. For purposes of this review, we are assuming tree clearing will not be part of your project.

Our information indicates no locations of State-listed Endangered, Threatened, or Special Concern species within the project area that would be affected by your project. Additionally, our Department has not mapped any Essential or Significant Wildlife Habitats or inland fisheries habitats that would be directly affected by your project.

This consultation review has been conducted specifically for known MDIFW jurisdictional features and should not be interpreted as a comprehensive review for the presence of other regulated features that may occur in this area. Prior to the start of any future site disturbance, we recommend additional consultation with the municipality, and other state resource agencies including the Maine Natural Areas Program, Maine Department of Marine Resources, and Maine Department of Environmental Protection in order to avoid unintended protected resource disturbance.

Please feel free to contact my office if you have any questions regarding this information, or if I can be of any further assistance.


Best regards,

John Perry

PHONE: (207) 287-5254

Environmental Review Coordinator

FISH AND WILDLIFE ON THE WEB: EMAIL ADDRESS: www.maine.gov/ifw IFWEnvironmentalReview@maine.gov

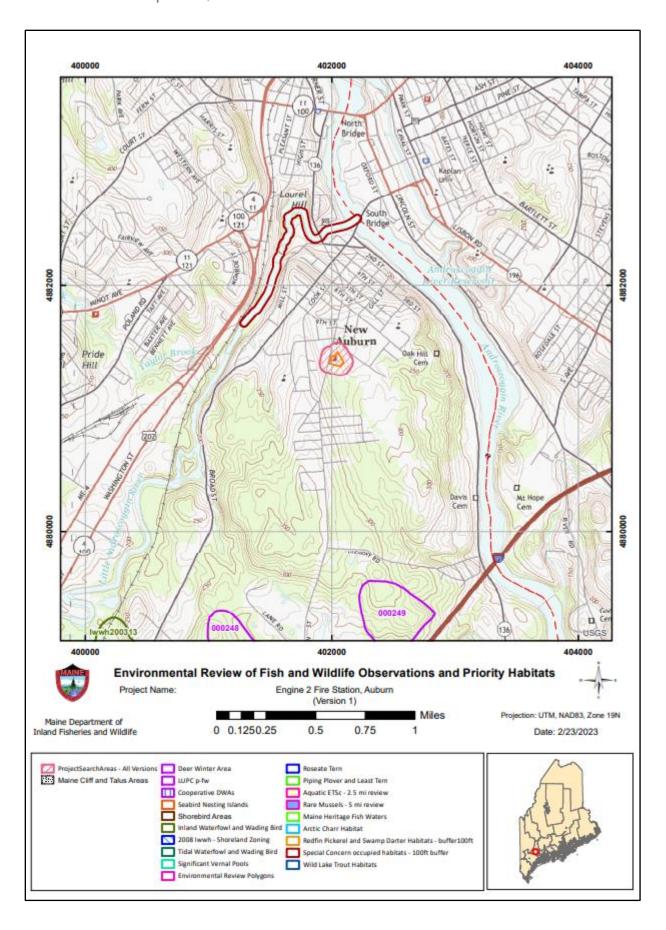

ATTACHMENT 5. COMPLETED USACE WETLAND DETERMINATION DATA FORMS

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Auburn Engine #2 Fire Station	City/County: Auburn/Androscoggin Sampling Date: 31 March 23
Applicant/Owner: Woodard & Curran / City of Auburn	State: ME Sampling Point: A-1 (wet)
Investigator(s): Kevin Ryan, Elliott Boardman	Section, Township, Range:
Landform (hillside, terrace, etc.):	relief (concave, convex, none): Concave Slope %: 2
Subregion (LRR or MLRA): LRR R Lat:	Long: Datum:
Soil Map Unit Name: Scantic Silt Loam	NWI classification:
Are climatic / hydrologic conditions on the site typical for this time of year?	Yes X No (If no, explain in Remarks.)
Are Vegetation, Soil, or Hydrology significantly distur	
Are Vegetation, Soil, or Hydrology naturally problems	
SUMMARY OF FINDINGS – Attach site map showing sam	
Hydrophytic Vegetation Present? Yes X No	Is the Sampled Area
Hydric Soil Present? Yes X No	within a Wetland? Yes X No
Wetland Hydrology Present? Yes X No	If yes, optional Wetland Site ID:
HYDROLOGY	
Wetland Hydrology Indicators:	Secondary Indicators (minimum of two required)
Primary Indicators (minimum of one is required; check all that apply)	Surface Soil Cracks (B6)
X Surface Water (A1) Water-Stained Leaves (· · · · · · · · · · · · · · · · · · ·
High Water Table (A2) Aquatic Fauna (B13)	Moss Trim Lines (B16)
X Saturation (A3) — Marl Deposits (B15)	Dry-Season Water Table (C2)
Water Marks (B1) Hydrogen Sulfide Odor (· · · · · · · · · · · · · · · · · · ·
Sediment Deposits (B2) Oxidized Rhizospheres	——————————————————————————————————————
Drift Deposits (B3) Presence of Reduced In	
Algal Mat or Crust (B4) Recent Iron Reduction in This Made Surface (G7)	
Iron Deposits (B5) — Thin Muck Surface (C7)	
Inundation Visible on Aerial Imagery (B7) Other (Explain in Remar	
Sparsely Vegetated Concave Surface (B8)	X FAC-Neutral Test (D5)
Field Observations:	
Surface Water Present? Yes X No Depth (inches).	
Water Table Present? Yes No _X Depth (inches)	
Saturation Present? Yes X No Depth (inches)	:0 Wetland Hydrology Present? Yes _X No
(includes capillary fringe)	
Describe Recorded Data (stream gauge, monitoring well, aerial photos, pre	evious inspections), if available:
Remarks:	
Remarks:	

VEGETATION – Use scientific names of plants.

Tree Stratum (Plot size:30')	Absolute % Cover	Dominant Species?	Indicator Status	Dominance Test worksheet:
. Acer negundo	5	Yes	FAC	
				Number of Dominant Species That Are OBL, FACW, or FAC:4(A)
· .				Total Number of Dominant
				Species Across All Strata: 4 (B)
				Percent of Dominant Species
				That Are OBL, FACW, or FAC: 100.0% (A/B)
				Prevalence Index worksheet:
	5	=Total Cover		Total % Cover of: Multiply by:
apling/Shrub Stratum (Plot size:15')			OBL species x 1 =
. Salix discolor	25	Yes	FACW	FACW species x 2 =
. Swida sericea	25	Yes	FACW	FAC species x 3 =
. Spiraea alba	10	No	FACW	FACU species x 4 =
				UPL species x 5 =
	_			Column Totals: (A)(B
·	_			Prevalence Index = B/A =
·				Hydrophytic Vegetation Indicators:
	60	=Total Cover		1 - Rapid Test for Hydrophytic Vegetation
lerb Stratum (Plot size:5')				X 2 - Dominance Test is >50%
. Lythrum salicaria	30	Yes	OBL	3 - Prevalence Index is ≤3.0 ¹
<u> </u>				4 - Morphological Adaptations ¹ (Provide supportindata in Remarks or on a separate sheet)
3				
l				Problematic Hydrophytic Vegetation ¹ (Explain)
i i				¹ Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.
·				Definitions of Vegetation Strata:
i				Tree – Woody plants 3 in. (7.6 cm) or more in
				diameter at breast height (DBH), regardless of height.
0 1				Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.
2.				
	30	=Total Cover		Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.
Voody Vine Stratum (Plot size:)			Woody vines – All woody vines greater than 3.28 ft in
ı				height.
2				Hydrophytic Vegetation
				Present? Yes X No
	_			rieseitt: ies 🔨 NO

SOIL Sampling Point A-1 (wet)

Profile Desc Depth	ription: (Describe to Matrix	o the de	•	i ment tl c Featur		ator or co	confirm the absence of indicators.)	
(inches)	Color (moist)	%	Color (moist)	%	Type ¹	Loc ²	Texture Remarks	
0-2	10YR 3/2	100					Loamy/Clayey Silt Loam	
2-6	2.5YR 4/2	95	7.5YR 5/6	5	С	М	Loamy/Clayey Silty Clay Loam	
6-16	2.5YR 4/2	85	7.5YR 5/6	15		<u>—</u>	Loamy/Clayey Silty Clay Loam	
								_
								—
								—
								_
							·	
¹ Type: C=Co	oncentration, D=Deple	etion, RN	 /I=Reduced Matrix, М	S=Mas	ked Sand	d Grains.	² Location: PL=Pore Lining, M=Matrix.	
Hydric Soil	Indicators:						Indicators for Problematic Hydric Soils ³ :	
Histosol			Polyvalue Belov		ce (S8) (LRR R,	2 cm Muck (A10) (LRR K, L, MLRA 149B)	
	oipedon (A2)		MLRA 149B)		\		Coast Prairie Redox (A16) (LRR K, L, R)	
Black Hi	` ,		Thin Dark Surfa High Chroma S					.)
	n Sulfide (A4) I Layers (A5)		Loamy Mucky N				Polyvalue Below Surface (S8) (LRR K, L) Thin Dark Surface (S9) (LRR K, L)	
	Below Dark Surface	(A11)	Loamy Gleyed			ix ix, =)	Iron-Manganese Masses (F12) (LRR K, L, I	?)
	ark Surface (A12)	,	X Depleted Matrix		,		Piedmont Floodplain Soils (F19) (MLRA 14	
Sandy M	lucky Mineral (S1)		Redox Dark Su	rface (F	6)		Mesic Spodic (TA6) (MLRA 144A, 145, 149	B)
Sandy G	leyed Matrix (S4)		Depleted Dark	Surface	(F7)		Red Parent Material (F21)	
	edox (S5)		Redox Depress		8)		Very Shallow Dark Surface (F22)	
	Matrix (S6)		Marl (F10) (LRI	₹ K, L)			Other (Explain in Remarks)	
— Dark Sui	face (S7)							
³ Indicators of	f hydrophytic vegetati	on and v	vetland hvdrologv mu	st be pr	resent. ui	nless dist	turbed or problematic.	
	_ayer (if observed):		, 0,		,		· ·	
Type:								
Depth (ir	nches):						Hydric Soil Present? Yes X No	
Remarks:								
							n 2.0 to include the NRCS Field Indicators of Hydric Soils,	
version 7.0,	2015 Errata. (http://w	ww.nics.	usua.gov/mlemei/FS	,E_DOC	JUMENI	S/IIICS 14	42p2_051293.docx)	

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Auburn Engine #2 Fire Station	City/County: Auburn/Androscoggin Sampling Date: 31 March 23					
Applicant/Owner: Woodard & Curran / City of Auburn	State: ME Sampling Point: A-2 (wet)					
Investigator(s): Kevin Ryan, Elliott Boardman	Section, Township, Range:					
Landform (hillside, terrace, etc.):	relief (concave, convex, none): Concave Slope %: 3					
Subregion (LRR or MLRA): LRR R Lat:	Long: Datum:					
Soil Map Unit Name: Hartand Very Fine Sandy Loam	NWI classification:					
Are climatic / hydrologic conditions on the site typical for this time of year?	Yes X No (If no, explain in Remarks.)					
Are Vegetation, Soil, or Hydrology significantly distur						
Are Vegetation, Soil, or Hydrology naturally problems						
SUMMARY OF FINDINGS – Attach site map showing sam						
Hydrophytic Vegetation Present? Yes X No	Is the Sampled Area					
Hydric Soil Present? Yes X No	within a Wetland? Yes X No					
Wetland Hydrology Present? Yes X No	If yes, optional Wetland Site ID:					
HYDROLOGY						
Wetland Hydrology Indicators:	Secondary Indicators (minimum of two required)					
Primary Indicators (minimum of one is required; check all that apply)	Surface Soil Cracks (B6)					
X Surface Water (A1) Water-Stained Leaves (
High Water Table (A2) Aquatic Fauna (B13)	Moss Trim Lines (B16)					
Saturation (A3) — Marl Deposits (B15)	Dry-Season Water Table (C2)					
Water Marks (B1) Hydrogen Sulfide Odor (
Sediment Deposits (B2) Oxidized Rhizospheres Deposits (R2)	——————————————————————————————————————					
Drift Deposits (B3) Presence of Reduced In						
Algal Mat or Crust (B4) Recent Iron Reduction in This Made Surface (G7)						
Iron Deposits (B5) — Thin Muck Surface (C7)						
Inundation Visible on Aerial Imagery (B7) Other (Explain in Remar						
Sparsely Vegetated Concave Surface (B8)	X FAC-Neutral Test (D5)					
Field Observations:						
Surface Water Present? Yes X No Depth (inches).						
Water Table Present? Yes No _X Depth (inches)						
Saturation Present? Yes X No Depth (inches)	:0 Wetland Hydrology Present? Yes X No					
(includes capillary fringe)						
Describe Recorded Data (stream gauge, monitoring well, aerial photos, pre	evious inspections), if available:					
Remarks:						
Remarks.						

VEGETATION – Use scientific names of plants. Sampling Point: A-2 (wet) Absolute Indicator Dominant <u>Tree Stratum</u> (Plot size: 30') % Cover Species? Status **Dominance Test worksheet:** 1. **Number of Dominant Species** 2. That Are OBL, FACW, or FAC: (A) 3. Total Number of Dominant 4. Species Across All Strata: (B) 5. Percent of Dominant Species 6. That Are OBL, FACW, or FAC: (A/B) Prevalence Index worksheet: =Total Cover Total % Cover of: Multiply by: Sapling/Shrub Stratum (Plot size: 15') OBL species __ x1=_ FACW species x 2 = ____ x 3 = ___ 2. FAC species 3. FACU species x 4 = 4. UPL species x 5 = 5. Column Totals: (A) 6. Prevalence Index = B/A = **Hydrophytic Vegetation Indicators:** 7. X 1 - Rapid Test for Hydrophytic Vegetation 2 - Dominance Test is >50% Herb Stratum (Plot size: 5') Juncus effusus Yes OBL 3 - Prevalence Index is ≤3.01 4 - Morphological Adaptations¹ (Provide supporting 2. Phalaris arundinacea Yes **FACW** data in Remarks or on a separate sheet) 3. 4. Problematic Hydrophytic Vegetation¹ (Explain) 5. ¹Indicators of hydric soil and wetland hydrology must 6. be present, unless disturbed or problematic. 7. **Definitions of Vegetation Strata:** 8. Tree - Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height. Sapling/shrub - Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall. Herb - All herbaceous (non-woody) plants, regardless 40 =Total Cover of size, and woody plants less than 3.28 ft tall. Woody Vine Stratum (Plot size: Woody vines - All woody vines greater than 3.28 ft in 1. height. 2. Hydrophytic 3. Vegetation No ____ Present? Yes X =Total Cover Remarks: (Include photo numbers here or on a separate sheet.)

SOIL Sampling Point A-2 (wet)

Profile Desc Depth	cription: (Describe t Matrix	o the de		ıment tl k Featur		ator or co	onfirm the absence of in	dicators.)
(inches)	Color (moist)	%	Color (moist)	%	Type ¹	Loc ²	Texture	Remarks
0-2	2.5YR 3/2	100					Loamy/Clayey	Texture: Silt loam
2-16	2.5Y 5/2	75	7.5YR 5/6	25	С	М	Loamy/Clayey	Silty Clay Loam
2-10	2.31 3/2		7.31K 3/0				Loamy/Glayey	Silty Clay Loans
1Type: C=C	oncentration, D=Depl	etion RN	——————————————————————————————————————	 acM=21	kad Sand		² Location: PL =	Pore Lining, M=Matrix.
Hydric Soil Histosol Histic Ep Black Hi Hydroge Stratified X Depleted Thick Da Sandy M Sandy R Stripped Dark Su Restrictive I	Indicators: (A1) Dipedon (A2) Stic (A3) In Sulfide (A4) Id Layers (A5) Id Below Dark Surface Bark Surface (A12) Iducky Mineral (S1) Bleyed Matrix (S4) Bledox (S5) Matrix (S6) Indicators:	· (A11)	Polyvalue Belo MLRA 149B Thin Dark Surfa High Chroma S Loamy Mucky I Loamy Gleyed X Depleted Matrix Redox Dark Su Depleted Dark Redox Depress Marl (F10) (LR	w Surfar) ace (S9) Sands (S Mineral Matrix (x (F3) Irface (F Surface sions (Fa	ce (S8) () (LRR R S11) (LRI (F1) (LRI F2) (F6) (F7)	LRR R, , MLRA 1 R K, L) R K, L)	Indicators for P 2 cm Muck (Coast Prairi 5 cm Mucky Polyvalue B Thin Dark S Iron-Mangar Piedmont Fl Mesic Spodi Red Parent Very Shallov	roblematic Hydric Soils ³ : (A10) (LRR K, L, MLRA 149B) e Redox (A16) (LRR K, L, R) Peat or Peat (S3) (LRR K, L, R) elow Surface (S8) (LRR K, L) urface (S9) (LRR K, L) nese Masses (F12) (LRR K, L, R) oodplain Soils (F19) (MLRA 149B) ic (TA6) (MLRA 144A, 145, 149B) Material (F21) w Dark Surface (F22) ain in Remarks)
Type: Depth (ii	nches):						Hydric Soil Present?	Yes <u>X</u> No
	m is revised from No 2015 Errata. (http://w							Field Indicators of Hydric Soils,

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Auburn Engine #2 Fire Station	City/County: Auburn/Androscoggin Sampling Date: 31 March 23
Applicant/Owner: Woodard & Curran / City of Auburn	State: ME Sampling Point: A-3 (up)
Investigator(s): Kevin Ryan, Elliott Boardman	Section, Township, Range:
Landform (hillside, terrace, etc.):	relief (concave, convex, none): Convex Slope %: 3
	Long: Datum:
Soil Map Unit Name: Hartand Very Fine Sandy Loam	NWI classification:
Are climatic / hydrologic conditions on the site typical for this time of year?	Yes X No (If no, explain in Remarks.)
Are Vegetation, Soil, or Hydrology significantly distur	
Are Vegetation, Soil, or Hydrology naturally problems	
SUMMARY OF FINDINGS – Attach site map showing sam	
· · · ·	T
Hydrophytic Vegetation Present? Yes No _X	Is the Sampled Area
Hydric Soil Present? Yes No X	within a Wetland? Yes No X
Wetland Hydrology Present? Yes No X	If yes, optional Wetland Site ID:
Remarks: (Explain alternative procedures here or in a separate report.)	
HYDROLOGY	
Wetland Hydrology Indicators:	Secondary Indicators (minimum of two required)
Primary Indicators (minimum of one is required; check all that apply)	Surface Soil Cracks (B6)
Surface Water (A1) Water-Stained Leaves (I	B9) Drainage Patterns (B10)
High Water Table (A2) Aquatic Fauna (B13)	Moss Trim Lines (B16)
Saturation (A3) Marl Deposits (B15)	Dry-Season Water Table (C2)
Water Marks (B1) Hydrogen Sulfide Odor (
Sediment Deposits (B2) Oxidized Rhizospheres of	i i i i i i i i i i i i i i i i i i i
Drift Deposits (B3) Presence of Reduced Ire	— · · · · —
l <u> </u>	<u>—</u>
l —	. , , ,
Iron Deposits (B5) Thin Muck Surface (C7) Other (F7)	
Inundation Visible on Aerial Imagery (B7) Other (Explain in Remar	<u> </u>
Sparsely Vegetated Concave Surface (B8)	FAC-Neutral Test (D5)
Field Observations:	
Surface Water Present? Yes No _X Depth (inches):	
Water Table Present? Yes No X Depth (inches):	: <u> </u>
Saturation Present? Yes No X Depth (inches):	: Wetland Hydrology Present? Yes No _X
(includes capillary fringe)	
Describe Recorded Data (stream gauge, monitoring well, aerial photos, pre	evious inspections), if available:
Remarks:	

VEGETATION – Use scientific names of plants. Sampling Point: A-3 (up) Absolute Indicator Dominant Tree Stratum (Plot size: 30') % Cover Species? Status **Dominance Test worksheet:** 1. **Number of Dominant Species** 2. That Are OBL, FACW, or FAC: 0 (A) 3. Total Number of Dominant 4. Species Across All Strata: 1 (B) 5. Percent of Dominant Species 6. That Are OBL, FACW, or FAC: 0.0% (A/B) Prevalence Index worksheet: =Total Cover Total % Cover of: Multiply by: Sapling/Shrub Stratum (Plot size: 15') OBL species x 1 = **FACW** species 0 x 2 = 0 2. FAC species x 3 = 0 x 4 = 3. FACU species 0 x 5 = 4. UPL species Column Totals: 0 5. (A) Prevalence Index = B/A = 6. **Hydrophytic Vegetation Indicators:** 7. 1 - Rapid Test for Hydrophytic Vegetation 2 - Dominance Test is >50% Herb Stratum (Plot size: 5') Yes Graminoid spp. 100 3 - Prevalence Index is ≤3.01 4 - Morphological Adaptations¹ (Provide supporting 2. data in Remarks or on a separate sheet) 3. 4. Problematic Hydrophytic Vegetation¹ (Explain) 5. ¹Indicators of hydric soil and wetland hydrology must 6. be present, unless disturbed or problematic. 7. **Definitions of Vegetation Strata:** 8. Tree - Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height. Sapling/shrub - Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall. Herb - All herbaceous (non-woody) plants, regardless 100 =Total Cover of size, and woody plants less than 3.28 ft tall. Woody Vine Stratum (Plot size: Woody vines - All woody vines greater than 3.28 ft in 1. height. 2. Hydrophytic 3. Vegetation Yes ___ Present? No X =Total Cover Remarks: (Include photo numbers here or on a separate sheet.)

SOIL Sampling Point A-3 (up)

		o the de				ator or co	onfirm the absence of in	dicators.)
Depth (inches)	Color (moist)	%	Color (moist)	x Featur %	Type ¹	Loc ²	Texture	Remarks
0-2	2.5Y 4/3	100	Color (moist)		Туре		Loamy/Clayey	Silty Clay Loam
2-12	2.5Y 4/3	99	2.5Y 5/6	1	<u>C</u>	M	Loamy/Clayey	Silty Clay Loam
			_			<u> </u>		
	ncentration, D=Deple	etion, RM	1=Reduced Matrix, N	/IS=Mas	ked Sand	d Grains.		Pore Lining, M=Matrix.
Hydric Soil In			5 5.	0 ((00) (roblematic Hydric Soils ³ :
— Histosol (•		Polyvalue Belo MLRA 149B		ce (S8) (LKK K,		(A10) (LRR K, L, MLRA 149B)
Black His	ipedon (A2)		Thin Dark Surfa	•) (I RR R	MIRA 1		e Redox (A16) (LRR K, L, R) Peat or Peat (S3) (LRR K, L, R)
	n Sulfide (A4)		High Chroma S				· —	elow Surface (S8) (LRR K, L)
	Layers (A5)		Loamy Mucky					urface (S9) (LRR K, L)
	Below Dark Surface	(A11)	Loamy Gleyed					nese Masses (F12) (LRR K, L, R)
Thick Dar	rk Surface (A12)		Depleted Matri	x (F3)			Piedmont FI	oodplain Soils (F19) (MLRA 149B)
Sandy Mu	ucky Mineral (S1)		Redox Dark Su	ırface (F	6)		Mesic Spodi	c (TA6) (MLRA 144A, 145, 149B)
	eyed Matrix (S4)		Depleted Dark					Material (F21)
Sandy Re			Redox Depress		8)			v Dark Surface (F22)
Dark Surf	Matrix (S6)		Marl (F10) (LR	KK,L)			Other (Expla	in in Remarks)
— Dark Suri	lace (OT)							
³ Indicators of	hydrophytic vegetation	on and w	etland hydrology mu	ıst be pr	resent, ui	nless dist	urbed or problematic.	
	ayer (if observed):							
Type: _								
Depth (in	ches):						Hydric Soil Present?	Yes No _X_
Remarks:								
								Field Indicators of Hydric Soils,
version 7.0, 2	2015 Errata. (http://w	ww.nrcs.	usaa.gov/internet/F	SE_DO(JUMENT	S/nrcs14	2p2_051293.docx)	

ATTACHMENT 12: SIGNIFICANT SAND AND GRAVEL AQUIFER MAP



Significant Sand and Gravel Aquifers boundaries compiled by U.S. Geological Survey, Water on Augusta, Maine, with funding from the Maine Low-Level CONTOUR INTERVAL 10 FEET SIGNIFICANT SAND AND GRAVEL AQUIFERS (yields greater than 10 gallons per minute) GEOLOGIC AND WELL INFORMATION SEISMIC-LINE INFORMATION

OTHER SOURCES OF INFORMATION

Surficial deposits with moderate to good potential ground-water yield, yields generally greater than 10 gallons per minute to a properly constructed well. Deposits consist primarily of glocal and and garget, but can include areas of sandy till and allowium; yields may exceed 50 gallons per minute in deposits by dramlically connected with surfaces water bodies, or in extensive deposits where subsurface data are available.

- Locke, D. B., 1999, Surficial materials of the Lewiston quadrangle, Maine: Maine Geological Survey Open-File Map 99-60.
- Smith, G. W., and Thompson, W. B., 1980, Reconnaissance surficial geology of the Lewiston 15' quadrangle, Maine: Maine Geological Survey, Open-File Map 80-24.
- Caswell, W. B., 1987, Ground water handbook for the state of Maine, Second Edition Maine Geological Survey, Bulletin 39, 135 p.

Depth to water level, in feet below land surface

Twelve-channel seismic line, with depth to bedrock and depth to water shown at the midpoint of the line, in feet below land surface

- Thompson, W. B., 1979, Surficial geology handbook for coastal Maine: Maine Geological Survey, 68 p. (out of print)
- Kendall, D. L., 1987. Glaciers and granite: A guide to Maine's landscape and geology Down East Books, Camden, Maine, 240 p.
- Thompson, W. B., and Borns, H. W., Jr., 1985, Surficial geologic map of Maine: Maine Geological Survey, scale 1:500,000.

Depth to water level in feet below land surface (observed in well, spring, test boring, pit, or seismic line)

Lewiston Quadrangle, Maine

Compiled by Craig D. Neil Preliminary aquifer boundaries mapped by Daniel B. Locke

Robert G. Marvinney State Geologist

Cartographic design and editing by:

Robert D. Tucker


Bennett J. Wilson, Jr.



WHAT IS AN AQUIFER?

Digital cartography by:

augum etch, or fice and not soll how one settlements from in the command to the relief and the soll how one settlement is down to act the soll and before rise and the soll and the soll and the soll and the Another type of well common in Mains in the shift of behavior well. This well is dettill and the endorshy nege shat store classing to solested well from potential surface-water communitation. In this type of well, the solested of the solested well are the solested and the water table. The well casing solates the bedseck would from the overlying administra, the weater level in the water when the water to the the threat the solested with the solested with the well casing solates the bedseck. Notice then he went level in the model by surfar pressure in the fractions in the bedook and is not related to the source table in the overlying mediance.




POROSITY AND PERMEABILITY

HOW ARE AQUIFERS MAPPED?



GROUND-WATER FLOW AND CONTAMINATION





ATTACHMENT 13: LIGHTING PLAN & INFORMATION





Page 1 of 1

ENGINI

ME

AUBURN,

Revisions

ARCHITECTURAL



LED WATTAGE CHART							
	16L	32L	48L				
700 milliamps	36w (4385-4720 Lumens)	71w (8770-9439 Lumens)	104w (13154-14159 Lumens)				
1050 milliamps	56w (6022-6482 Lumens)	106w (11797-12698 Lumens)	156w (17360-18686 Lumens)				

FORM

- Elegant Rectilinear Extruded Aluminum Housing
- Corrosion Resistant Stainless Steel External Hardware
- · Sleek, Low Profile Housing
- Spec Grade Performance
- Engineered For Optimum Thermal Management
- Anchor Base Plate For Easy Installation
- 8 Architectural Finishes Standard, RAL Colors Available

FUNCTION

- Micro Optics IES Distributions T2, T3, T4, T5
- 0-10V Dimming Drivers THD @ Max Load
 15% Power factor @ Max Load < 0.95
- Amber, 2700K, 3000K, 3500K, 4000K, Or 5000K
- 16L to 48L LED Configuration
- 36-156 Watts (Single Head Wattage)
- CRI 70, 80, or 90
- Extruded Aluminum Heat Sink
- · 5 Mils Powder Coat
- Aluminum Pole .250 Wall

RELIABILITY

- · Silicone Micro Optics
- · 5 Year Standard Warranty
- IP67 Optics
- Reduces Energy Consumption And Costs Up To 65%
- · Dark Sky Approved

BUY AMERICAN

To ensure the latest BAA/TAA/BABA Standards are being met, please select BAA, TAA, or BABA in the options section. Please contact the factory before placing an order for any NLS products requesting BAA (Buy American Act), TAA (Trade American Act), or BABA (Build America, Buy America).



Type:

TRC-3 ORDERING GUIDE

Cat#	Light Dist.	# of LEDs	Miliamps	Kelvin	Volts
Trac 3 (TRC-3)	Type 2 (T2)	16 (16L)	700 (7)	Amber 585-600nM (AMBER) 5 , 8 , 10 , 11	120-277 (UNV)
	Туре 3 (Т3)	32 (32L)	1050 (1)	2700K, 70 CRI (27K7) 5	347-480 (HV)
	Type 4 (T4)	48 (48L)		2700K, 80 CRI (27K8) 1, 5	
	Type 5 (T5)	, ,		3000K, 70 CRI (30K7)⁵	
	(13)			3000K, 80 CRI (30K8) 1, 5	
				3500K, 80 CRI (35K8)	
				4000K, 70 CRI (40K7)	
				4000K, 80 CRI	
				(40K8) ¹ 5000K, 70 CRI	
				(50K7) 5000K, 80 CRI	
Config.	Color	Controls Options	Options	(50K8)1 Pole Height	
Single (SGL)	Bronze Textured (BRZ)	Nema 7-Pin Receptacle (PE7) ³	Marine Grade Finish (MGF)	16' (16)	
٦	White Textured (WHT)	Button Photocell (PC) ⁴	House Side Shield (HSS)	18′ (18)	
Double (D-180)	Smooth White Gloss (SWT)	FSP-211 with Motion Sensor/Photocell	Rotated Optic Left (ROL)	20' (20)	
T	Silver Metallic (SVR)	9'-20' Heights (FSP211-20) ^{4, 12}	Rotated Optic Right (ROR)	22' (22)	
MPF Triple (TRI) ²	Black Textured (BLK)	21'-40' Heights (FSP211-40) 4, 12	Buy American Act (BAA) 9	No Pole (NO)	
Ŧ	Smooth Black Gloss (SBK)	FSP-221 with Motion Sensor/Photocell	Trade Agreement Act (TAA)9	Aluminum Pole .250 Wall	
MPF Quad (QD) ²	Graphite Textured (GPH)	9'-20' Heights (FSP221-20) ¹³ 21'-40' Heights (FSP221-40) ¹³	Build America Buy American (BABA) ⁹	Comes With 12" Anchor Base 1" Thick, 1" Anchor Bolts	
Ŧ	Grey Textured (GRY)	Custom Controls	No Options (NO)		
MPF (MPF) ²	Green Textured (GRN)	Integration (CCI) 7	()		
Ì	Hunter Green Textured (HGN)	No Options (NO)			
Wall Mount (WM)	Custom (CS)				

- Consult Factory For Lead Time. Consult
 MPF Mid Pole Fixture. Consult Factory
- 3. Only Available When Ordering NLS Pole
- 4. Universal Voltage 120-277
- 3000k or lower must be selected to meet International Dark-Sky Association certification.
- 6. Consult Factory for 26' or above requests.
- Please contact Factory for Custom Control Integration requests (nLight, NX, WaveLinx, Crestron, DMX/RDM, Synapse, Casambi, Dali II, Avi-On, or other control systems)
- 8. Turtle Safe
- 9. Consult factory for all BAA/TAA/BABA requests

- 9. Consult Factory for Lead Time
 10. Consult Factory for Lead Time
 11. Not Available above 700mA
 12. FSP-211, 120V/277V, 230-240VAC (single phase), 50/60Hz
 13. FSP-221, 100–347VAC (single phase) or 208/230/480VAC (phase-to-phase)



ELECTRICAL

- · 120-277 Volts (UNV) or 347-480 Volts (HV)
- · 0-10V dimming driver
- Driver power factor at maximum load is ≥ .95, THD maximum load is 15%
- LED Drivers Ambient Temp. Min is -40°C and Ambient Temp. Max ranges from 50°C to 55°C and, in some cases, even higher. Consult the factory for revalidation by providing the fixture catalog string before quoting and specifying it.
- · All drivers, controls, and sensors housed in enclosed compartment
- · CRI 70, 80, or 90
- Color temperatures: Amber, 2700K, 3000K, 3500K, 4000K, 5000K
- · Surge Protection: 20KA supplied as standard.

CONSTRUCTION

- · Extruded Aluminum
- Internal cooling fins
- · Corrosion resistant external hardware
- One-piece silicone gasket ensures water tight seal for electronics compartment
- Two-piece silicone Micro Optic system ensures IP67 seal around each PCB

OPTIONS

- NEMA 7-Pin Receptacle (PE7). Only available when ordering NLS pole.
- · PHOTO CELL (PC)
- · DIMMING CONTROL (FSP-20) (FSP-40)
- MARINE GRADE FINISH (MGF)—A multi-step process creating protective finishing coat against harsh environments. Chemically washed in a 5 stage cleaning system. Pre-baked, Powder coated 3-5 mils of Zinc Rich Super Durable Polyester Primer. Oven Baked. Finished Powder Coating of Super Durable Polyester Powder Coat 3-5 mil thickness.
- · SHIELD (HSS)—House Side Shield is designed for full property line cut-off.
- · ROTATED OPTICS (ROL) (ROR)

CONTROL OPTIONS

- FSP-211 with Motion Sensor (FSP-XX)—Passive infrared (PIR) sensor providing multi-level control based on motion/daylight contribution.
 - All control parameters adjustable via wireless configuration remote storing and transmitting sensor profiles.
 - · FSP-20 mounting heights 9-20 feet.
 - FSP-40 mounting heights 21-40 feet.
 - Includes 5 dimming event cycles, 0-10V dimming with motion sensing, re-programmable in the field.
 - Motion sensor mounted to access cover
 - FSIR-100 commissioning remote is required to change sensor settings. Please contact factory for ordering.
- NEMA 7-PIN RECEPTACLE (PE7)—An ANSI C136.41-2013 receptacle provides electrical and mechanical interconnection between photo control cell and luminaire. Dimming receptacle available two or four dimming contacts supports 0-10 VDC dimming methods or Digital Addressable Lighting Interface (DALI), providing reliable power interconnect.
- Controls Agnostic: Please contact factory for your preferred controls option. (nLight, NX, WaveLinx, Crestron, DMX/RDM, Synapse, Casambi, DALI II, Avi-On, or other control systems)

FINISH

- · 3-5 mils electrostatic powder coat.
- NLS Lighting standard high-quality finishes prevent corrosion and protects against extreme environmental conditions

WARRANTY

Five-year limited warranty for drivers and LEDs.

OPTICS

Silicone optics high thermal stability and light output provide higher powered LEDs with minimized lumen depreciation. UV stability with scratch resistance increases exterior application durability. Silicone optics do not yellow, crack or brittle over time.

LISTINGS

- · Certified to UL 1598
- UL 8750
- CSA C22.2 No. 250.0
- · IP65/ IP67 Rated
- IK10 Rated

BUY AMERICAN OPTION

While all of the NLS Lighting products listed in this document qualify for the Buy America(n) Act of 1933, we reserve the right to change our listings without notice.

The information provided above is for general informational purposes only. We encourage you to consult legal professionals for advice particular to your projects concerning BAA, TAA, BABA or Buy America.

Additional NLS Products that meet BAA, TAA standards can be found at the following link:

https://nlslighting.com/buy-american/

























The information and specifications on this document are subject to change without any notification. All values are design, nominal, typical or prorated values when measured under internal and external laboratory conditions.



701 Kingshill Place, Carson, CA 90746 **Call Us Today** (310) 341-2037

nlslighting.com

TRAC 3 LUMEN CHART

	TRAC LUMEN CHART												
PART NUMBER	T2	LM/W	BUG	Т3	LM/W	BUG	T4	LM/W	BUG	T5	LM/W	BUG	WATTS
TRC-3-16L-7-30K7	4,385	122	B1-U0-G1	4,409	122	B1-U0-G1	4,409	122	B1-U0-G1	4,495	125	B3-U0-G1	36
TRC-3-16L-7-40K7	4,604	128	B1-U0-G1	4,630	129	B1-U0-G1	4,630	129	B1-U0-G1	4,720	131	B3-U0-G1	36
TRC-3-16L-7-50K7	4,604	128	B1-U0-G1	4,630	129	B1-U0-G1	4,630	129	B1-U0-G1	4,720	131	B3-U0-G1	36
TRC-3-16L-1-30K7	6,022	108	B1-U0-G1	6,056	108	B1-U0-G1	6,056	108	B1-U0-G1	6,174	110	B3-U0-G1	56
TRC-3-16L-1-40K7	6,323	113	B1-U0-G1	6,359	114	B1-U0-G1	6,359	114	B1-U0-G1	6,482	116	B3-U0-G1	56
TRC-3-16L-1-50K7	6,323	113	B1-U0-G1	6,359	114	B1-U0-G1	6,359	114	B1-U0-G2	6,482	116	B3-U0-G1	56
TRC-3-32L-7-30K7	8,770	124	B2-U0-G2	8,819	124	B2-U0-G2	8,819	124	B2-U0-G2	8,990	127	B3-U0-G2	71
TRC-3-32L-7-40K7	9,208	130	B2-U0-G2	9,259	130	B2-U0-G2	9,259	130	B2-U0-G2	9,439	133	B3-U0-G2	71
TRC-3-32L-7-50K7	9,208	130	B2-U0-G2	9,259	130	B2-U0-G2	9,259	130	B2-U0-G2	9,439	133	B3-U0-G2	71
TRC-3-32L-1-30K7	11,797	111	B2-U0-G2	11,863	112	B2-U0-G2	11,863	112	B2-U0-G2	12,094	114	B4-U0-G2	106
TRC-3-32L-1-40K7	12,387	117	B2-U0-G2	12,456	118	B2-U0-G2	12,456	118	B2-U0-G2	12,698	120	B4-U0-G2	106
TRC-3-32L-1-50K7	12,387	117	B2-U0-G2	12,456	118	B2-U0-G2	12,456	118	B2-U0-G2	12,698	120	B4-U0-G2	106
TRC-3-48L-7-30K7	13,154	126	B2-U0-G2	13,228	127	B3-U0-G3	13,228	127	B3-U0-G3	13,485	130	B4-U0-G2	104
TRC-3-48L-7-40K7	13,812	133	B2-U0-G2	13,889	134	B3-U0-G3	13,889	134	B3-U0-G3	14,159	136	B4-U0-G2	104
TRC-3-48L-7-50K7	13,812	133	B2-U0-G2	13,889	134	B3-U0-G3	13,889	134	B3-U0-G3	14,159	136	B4-U0-G2	104
TRC-3-48L-1-30K7	17,360	111	B3-U0-G3	17,457	112	B3-U0-G3	17,457	112	B3-U0-G3	17,796	114	B4-U0-G2	156
TRC-3-48L-1-40K7	18,228	117	B3-U0-G3	18,330	117	B3-U0-G3	18,330	117	B3-U0-G3	18,686	120	B4-U0-G2	156
TRC-3-48L-1-50K7	18,228	117	B3-U0-G3	18,330	117	B3-U0-G3	18,330	117	B3-U0-G3	18,686	120	B4-U0-G2	156

3000k or lower must be selected to meet International Dark-Sky Association certification.

Lumen Maintenance Data								
Ambient Temperature	Drive Current	L90 Hours*	L70 Hours**	30,000 Hours*	50,000 Hours*	60,00 Hours*	100,000 Hours**	
25°C	Up to 700mA	58,000	173,000	95.7%	91.6%	89.6%	82.1%	
	1050mA	48,000	143,000	94.3%	89.5%	87.2%	78.5%	
*Reported extrapolations per IESNA TM-21 **Projected extrapolations per IESNA TM-21								

LED KELVIN RANGE



Color	Domir Peak Waveleng	nant or gth Range (nm)
	Minimum	Maximum
Amber	585	600


TRAC 3 LUMEN CHART HSS

PART NUMBER	T2 HSS	LM/W	BUG	T3 HSS	LM/W	BUG	T4 HSS	LM/W	BUG	WATTS
TRC-3-16L-7-30K7	3,227	90	B1-U0-G1	3,120	87	B0-U0-G1	3,018	84	B0-U0-G1	36
TRC-3-16L-7-40K7	3,389	94	B1-U0-G1	3,276	91	B0-U0-G1	3,169	88	B0-U0-G1	36
TRC-3-16L-7-50K7	3,389	94	B1-U0-G1	3,276	91	B0-U0-G1	3,169	88	B0-U0-G1	36
TRC-3-16L-1-30K7	4,433	79	B1-U0-G1	4,285	77	B0-U0-G1	4,145	74	B1-U0-G1	56
TRC-3-16L-1-40K7	4,654	83	B1-U0-G1	4,499	80	B1-U0-G1	4,353	78	B1-U0-G1	56
TRC-3-16L-1-50K7	4,654	83	B1-U0-G1	4,499	80	B1-U0-G1	4,353	78	B1-U0-G1	56
TRC-3-32L-7-30K7	6,454	91	B1-U0-G1	6,239	88	B1-U0-G2	6,036	85	B1-U0-G2	71
TRC-3-32L-7-40K7	6,777	95	B1-U0-G2	6,551	92	B1-U0-G2	6,338	89	B1-U0-G2	71
TRC-3-32L-7-50K7	6,777	95	B1-U0-G2	6,551	92	B1-U0-G2	6,338	89	B1-U0-G2	71
TRC-3-32L-1-30K7	8,683	82	B1-U0-G2	8,394	79	B1-U0-G2	8,120	77	B1-U0-G2	106
TRC-3-32L-1-40K7	9,117	86	B1-U0-G2	8,813	83	B1-U0-G2	8,526	80	B1-U0-G2	106
TRC-3-32L-1-50K7	9,117	86	B1-U0-G2	8,813	83	B1-U0-G2	8,526	80	B1-U0-G2	106
TRC-3-48L-7-30K7	9,682	93	B1-U0-G2	9,359	90	B1-U0-G2	9,054	87	B1-U0-G2	104
TRC-3-48L-7-40K7	10,166	98	B1-U0-G2	9,827	94	B1-U0-G2	9,507	91	B1-U0-G2	104
TRC-3-48L-7-50K7	10,166	98	B1-U0-G2	9,827	94	B1-U0-G2	9,507	91	B1-U0-G2	104
TRC-3-48L-1-30K7	12,777	82	B1-U0-G2	12,352	79	B1-U0-G2	11,949	77	B1-U0-G2	156
TRC-3-48L-1-40K7	13,416	86	B1-U0-G2	12,969	83	B1-U0-G2	12,547	80	B1-U0-G2	156
TRC-3-48L-1-50K7	13,416	86	B1-U0-G2	12,969	83	B1-U0-G2	12,547	80	B1-U0-G2	156

MODEL	WIDTH	DEPTH	LENGTH	WEIGHT
TRAC - 3	6"	4"	30"	21


EPA	SGL	DBL
	1.0	2.0

DIMENSIONS

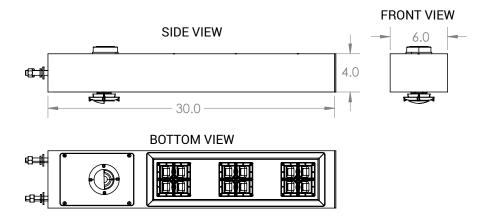

OPTICAL CONFIGURATIONS


Rotatable Optics (ROR) Rotated Right, (ROL) Rotated Left options available. Optics field and factory rotatable.

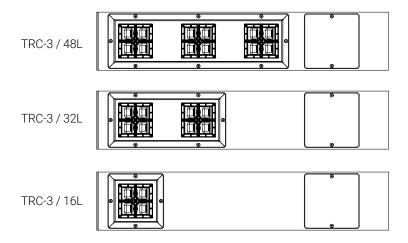


POLE EPA DATA

Catalog Number	Shaft Length, ft	Wall thick- ness, in.	Shaft dim., in.	Base Plate, in.	Bolt Circle, in.	Bolts	80 mph	Max. wt. (lb)	90 mph	Max. wt. (lb)	100 mph	Max. wt. (lb)	110 mph	Max. wt. (lb)	115 mph		120 mph		130 mph					Max. wt., lb			170 mph			Max. wt., lb
TRAC-16-250-12BC-136	16	0.250	4x6	12" sq.	12	1"x36"	20.0	500	20.0	500	16.6	415	12.9	323	11.4	285	10.0	250	7.8	195	6.0	150	4.4	110	3.5	88	2.4	60	1.8	<u> </u>
TRAC-18-250-12BC-136	18	0.250	4x6	12" sq.	12	1"x36"	20.0	500	18.0	450	13.5	338	10.2	255	8.8	220	7.5	188	5.5	138	3.9	98	2.9	73	1.8	-	0.8	-	·	
TRAC-20-250-12BC-136	20	0.250	4x6	12" sq.	12	1"x36"	20.0	500	15.7	393	11.5	288	8.3	208	6.8	170	5.9	148	3.8	95	2.4	60	1.2	-	0.3	-	-	-	-	
TRAC-22-250-12BC-136	22	0.250	4x6	12" sq.	12	1"x36"	16.8	420	11.7	293	8.2	205	5.5	138	4.3	108	3.6	90	2.0	-	0.9	-	-	-	-	-	-	-	-	


IES DISTRIBUTIONS





T2 OPTIC

The Type II distribution is used for narrow pathways and trails, narrow entrances of shopping centers, parking lots and office complex's.







T3 OPTIC

The type III distribution is meant for roadway lighting, general parking areas and other areas where a larger area of lighting is required. Type III lighting needs to be placed to the side of the area, allowing the light to project outward and fill the area. This produces a filling light flow.

Type III light distributions have a preferred lateral width of 40 degrees. This distribution is intended for luminaires mounted at or near the side of medium width roadways or areas, where the width of the roadway or area does not exceed 2.75 times the mounting height.







T4 OPTIC

The type IV distribution produces a semicircular light meant for mounting on the sides of buildings and walls. It's best for illuminating the perimeter of parking areas and businesses. The intensity of the Type IV lighting has the same intensity at angles from 90 degrees to 270 degrees.

Type IV light distributions have a preferred lateral width of 60 degrees. This distribution is intended for side-of-road mounting and is generally used on wide roadways where the roadway width does not exceed 3.7 times the mounting height.






T5 OPTIC - SYMMETRICAL

Type V produces a symmetrical distribution that has the same intensity at all angles. This distribution has a uniform symmetry of candlepower that is essentially the same at all lateral angles. It is meant for large, commercial parking lot lighting as well as areas where sufficient, evenly distributed light is necessary.

SILICONE OPTICS

NLS Lighting Silicone Micro Optical System technology takes quality and performance to the highest level. Vandal resistant, superior clarity—Micro Optics have become the best and lasting solution in the industry. BENEFITS

- · Produces superior 96% clarity
- Heat resistant to 150° C, 50% higher than acrylic
- Ecologically friendly—no glare
- · Vandal-resistant
- Does not brittle, crack, or yellow over time







701 Kingshill Place, Carson, CA 90746 **Call Us Today** (310) 341-2037

nlslighting.com


HOUSE SIDE SHIELD

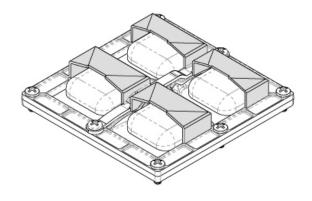


AUTOMOTIVE HOUSE SIDE SHIELD



FSP-211



MOTION SENSOR PLACEMENT



TRAC POLE

RECTANGULAR ALUMINUM POLE

SHAFT

Rectangular Aluminum Pole (RAP) shaft (.250 Wall) is 6061 T6 Extruded Aluminum, 4 X 6 inch to provide a seamless transition into the Trac fixture. Poles have ground lug welded inside hand-hole opposite side of the pole extrusion. Pole Extrusion is conjoined to Anchor Base by welding internal and external to pole shaft. For custom configuration consult Factory.

ANCHOR BOLTS

All anchor bolts are fully hot dipped galvanized and come with two galvanized nuts and washers per bolt. Anchor bolts are not included for Custom Bolt Circle. Anchor Bolts are "J" style, with a 4" hook at the end for added strength.1" Anchor Bolts are 1" diameter x 36" long with a 4" long "J" hook.

ANCHOR BASE

Base plates are machined from 6061 Aluminum, 12" square, 1" thick with 1" anchor bolts.


HAND HOLE COVER AND POLE CAP

All poles come with removable machined aluminum pole cap. All poles caps are powder coated to match the pole. All base covers are made of aluminum and powder coated to match the pole. Hand Hole is constructed of 3"x 5" rectangular aluminum tubing which is welded to pole shaft for added strength. Hand Hole covers are provided with internal bridge support and also powder coated to match pole finish.

FINISH

All poles have minimum 3 to 5 mils powder coat finish. All poles are sandblasted prior to powder coat application.


B C TRAC PRITURE



12" Base
*Consult Factory for Bolt Circle Template

DIMEN- SION	RAP
A	16-22 ft. or Custom Height
В	6 in.
С	4 in.

RECTANGULAR ALUMINUM POLE DETAIL

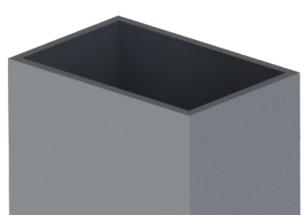

^{*}Anchor Bolts are NOT included with Custom Bolt Circle.


^{*}Do NOT pour concrete referencing this drawing. Consult Factory.

^{*}Must Specify 4-Bolt Pattern.





DIMENSIONS




Type: Project: REP/Agent: Order #:



FEATURES

- 2', 3', 4', 6' and 8' individual units
- Fixtures can be linked together for continuous rows
- Efficacy up to 125 lm/W
- ★ Soft diffused direct lighting
- Outdoor powder coat finishes available in white, black silver and bronze
- Premium finishes also available
- ★ 0-10V dimming is standard**
- ★ Dim to 10% of output current is standard
- ★ 90 CRI (R9 50min) available
- CA Title 24 / JA8 installation compatible
- Wet Location rated
- IP66
- Impact Protection Rating (IK08)

DISTRIBUTION



SD= SatinIce Diffuse

LUMEN PACKAGES Based on 3500K CCT, Other CCT available.

MODEL	LUMENS	INPUT WATTS	Lm/W
HYDRO-4-1000-SD-35K	4,000	36	110
HYDRO-8-1000-SD-35K	8,000	67	120



















Туре:	
Project:	
REP/Agent:	
Order #:	

HYDROE					
SERIES	LENGTH	LUMENS PER FOOT	DISTRIBUTION	сст	CRI
HYDROD	2 = 2FT	350 = 350 LPF	SD = SatinIce Diffuse	30K = 3000K	80 = 80
	3 = 3FT	500 = 500 LPF		35K = 3500K	90 = 90 (R9 50 min)
	4 = 4FT	750 = 750 LPF		40K = 4000K	
	6 = 6FT	1000 = 1000 LPF		50K = 5000K	
	8 = 8FT	XXX= Custom LPF			
	xx= Run Length				
	Sxx= Symmetric Run Length				

FINISH	MOUNTING	VOLTAGE	ELECTRICAL
STANDARD	SURFACE MOUNTS*	U = 120-277	1C= Single Circuit
PW= Powder Coat White	SM(T) = Surface Mount (Top-fed power)		MC= Multiple Circuits
PB= Powder Coat Black	SM(E)= Surface Mount (End-fed power)		(multiple switch legs across run length)
PS = Powder Coat Silver	SM(S) = Surface Mount (Side-fed power)		EC= Emergency Circuit
PBR= Powder Coat Bronze			(separate power drops for EC fixtures)
	WALL MOUNTS		
PREMIUM	WM = Wall Mount		
RALxxxx= Powder Coat RAL xxxx	ARM= Arm Wall Mount		
PSFx = Prem Stock Finish	MM= Mullion Mount		
	RM= Rotational Mount (Not Available in Continuous Run)		
CUSTOM			
PO= Powder Other	STEMS WITH CANOPY KITS		
	STEMWxx= Stem White, xx"		
See pg. 10 for standard and premium options.	STEMBxx= Stem Black, xx"		

* 4G Vibration Certified

OPTIONS

BATTERIES

#EMB10= 10W EM Battery (# indicates quantity)

SURGE PROTECTOR

SRG= Surge Protector

SENSORS

MLR= Motion Sensor Large Range**

**Motion sensor option removes dimming ability



CONTINUOUS RUN

Continuous runs are configured with 2', 3', 4', 6' and 8' sections up to 50' in total length.

																			Т	ota	l Le	ngt	th																	
		2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40
#	2	1			1								1								1								1								1			
of	3		1		1		1		1		1		1		1		1		1		1		1		1		1		1		1		1		1		1		1	
Sect	4			1			1			1					1					1			1			1		1			1			1		1			1	
tion	6					1			1	1		2		1			1	3				1			1	1				1			1	1				1		
S	8							1			1		1	1	1	2	1		2	2	2	2	2	3	2	2	3	3	3	3	3	4	3	3	4	4	4	4	4	5


Sxx (Symmetric Run)

The construction of Sxx (y') is to build with equal length fixtures. The xx indicates the run length. The y' indicates the fixture length used to create the run. Please indicate this on your P.O. when placing your order.

\$12 (2')	2'	2'	2'	2'	2'	2'
\$12 (3')	3'		3'	3'		3'
S12 (4')	4	,	4	ľ		4'
\$12 (6')		6'			6'	

LINKING

Typical continuous run installation shown below.

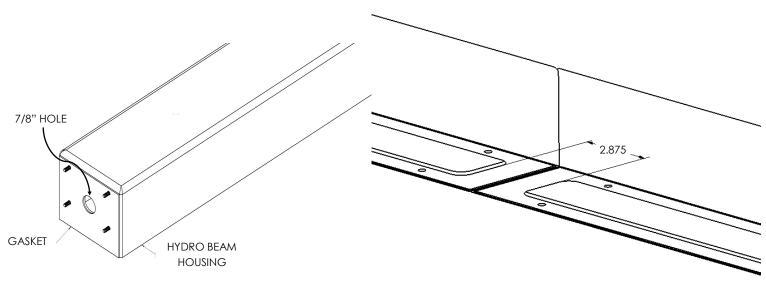




MOUNTING OPTIONS


SM(X) - Surface Mount (Top, End, or Side - fed power)


Power to be fed through one (1) 7/8" hole created in the top—SM(T), side—SM(S), or end—SM(E) of the lighting fixture. Hole can accommodate 1/2" conduit. Lighting fixture is to be wired with UL listed wet location fittings per NEC requirements, supplied by others.

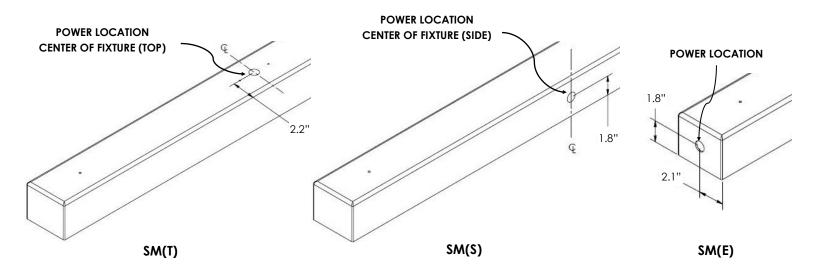

MOUNTING LOCATIONS—SM(T)

Mounting locations (•) vary between SM(T) option and others due to length and power location. Views below show top of fixtures.

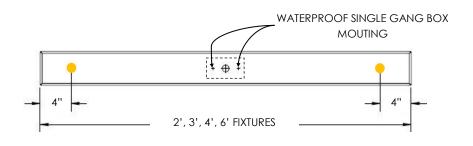

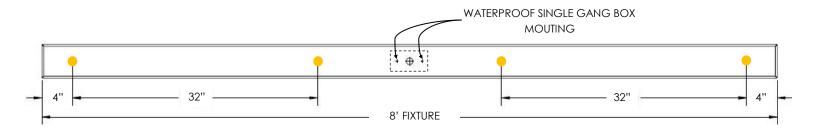


NOTE: Hole size at mounting locations is Ø.266".



MOUNTING LOCATIONS—SM(S) & SM(E)


The number of mounting locations (a) increase as fixtures get longer. Views below show top of fixtures.

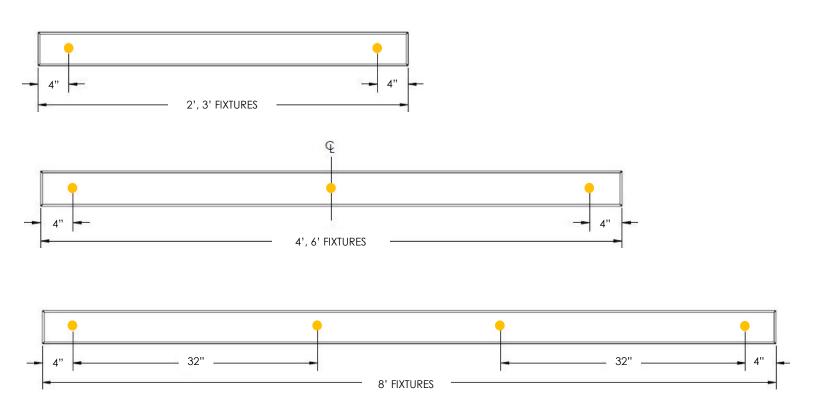


NOTE: Hole size at mounting locations is Ø.266".



MOUNTING OPTIONS CONTINUED

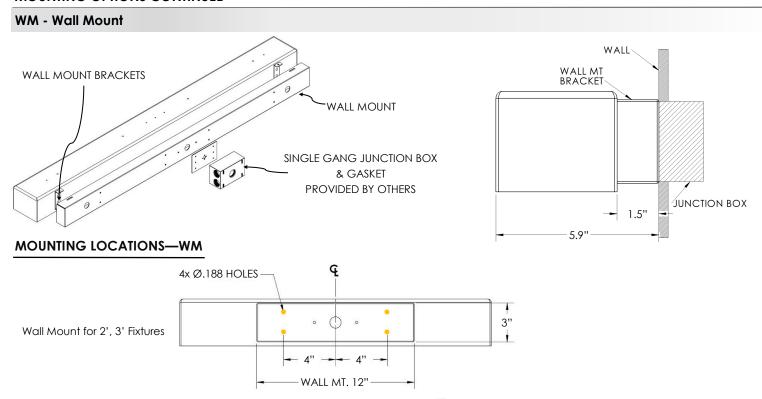


Wall Mount for 4', 6', 8' Fixtures

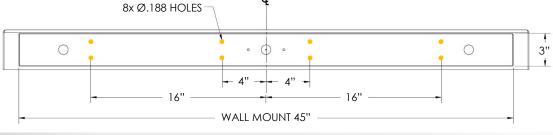

STEMXxx - Stem Mount with Canopy


When ordering, please specify stem mount length ("xx" indicates stem length). See table below for stem lengths available. Please also specify the color of the stem ("X" indicates stem color). Stem mounts can be ordered in white (STEMW) or black (STEMB).

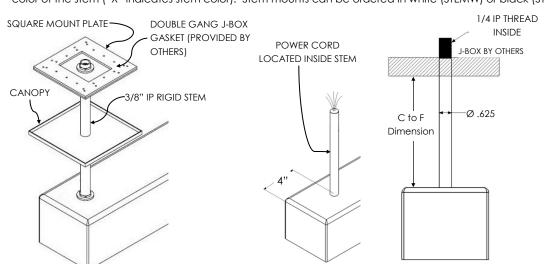


Stem Lengths										
STEMX(xx) (C to F)	STEMX(xx) (C to F)	STEMX(xx) (C to F)								
6"	24"	60"								
8"	27"	66"								
9"	30"	72"								
12"	36"	78"								
15"	42"	84"								
18"	48"	90"								
21"	54"	96"								



MOUNTING OPTIONS

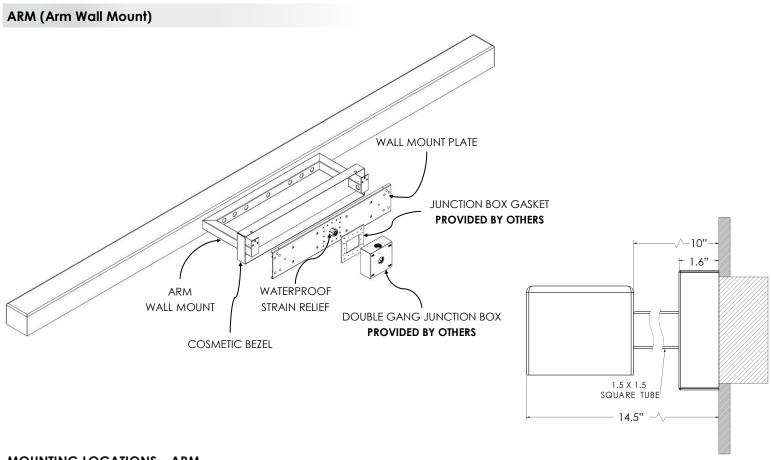


MOUNTING LOCATIONS—ARM

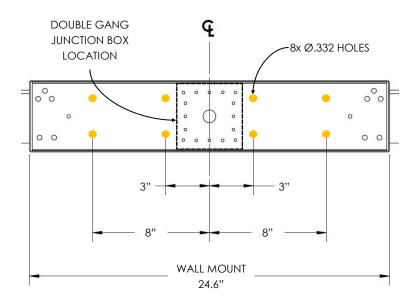




MOUNTING OPTIONS


MM (Mullion Mount)

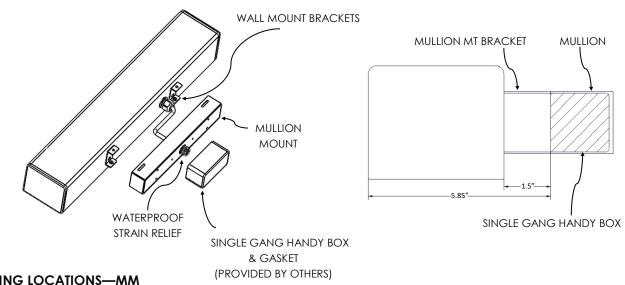

MOUNTING LOCATIONS—MM

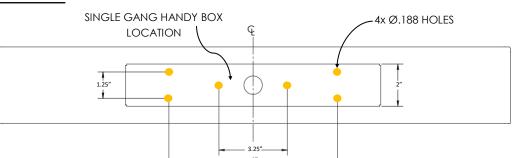


RM - Rotational Mount

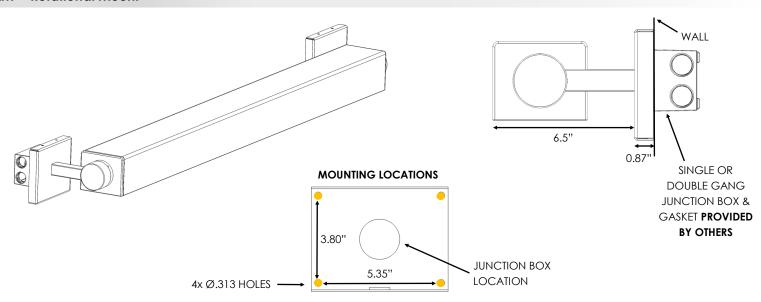



PERFORMANCE

HYDROD-X-1000-SD (80+ CRI)




Model	Lumens	Watts	LPW
HYDROD-4-1000-SD-30K	4000	37	107
HYDROD-4-1000-SD-35K	4000	36	110
HYDROD-4-1000-SD-40K	4000	36	112
HYDROD-4-1000-SD-50K	4000	35	115

Model	Lumens	Watts	LPW
HYDROD-8-1000-SD-30K	8000	68	117
HYDROD-8-1000-SD-35K	8000	67	120
HYDROD-8-1000-SD-40K	8000	66	122
HYDROD-8-1000-SD-50K	8000	64	125



FINISHES

STANDARD FINISHES










WHITE MINI TEXTURE

BLACK MINI TEXTURE

SILVER BRONZE

Custom finishes (PO) will incur a set up fee and will add an extended lead time to your project.

PREMIUM STOCK FINISHES

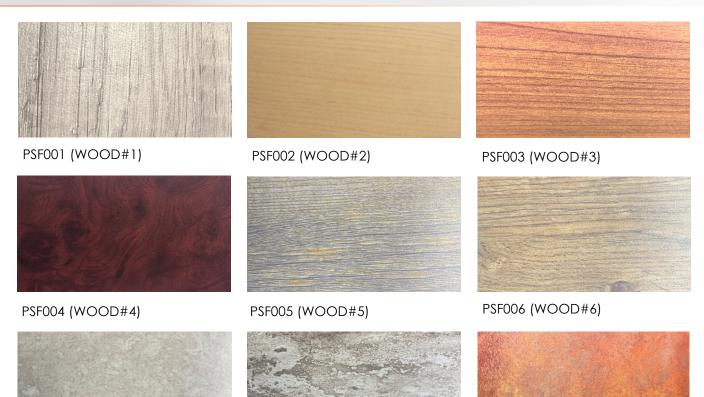

PSF007 (STONE #1)

PSF008 (STONE #2)

PSF009 (METAL #1)

NOTE: A minimal impact to lead times will apply to products specified with Premium Stock Finishes (PSF). It is not to be assumed that these finishes are stocked in our warehouse, but rather, are readily available to us for your project.

All other custom finishes (PO) will incur a set up fee and will add an extended lead time to your project.



SPECIFICATIONS

Housing

Nominal 3.6" x 4.4" x 0.090 thick aluminum housing

Color

Colors for the housing are available in a powder coated white, black silver and bronze. Consult factory for custom colors.

Luminaire Length

2', 3', 4', 6' or 8' lengths are available for a single stand-alone section. Using contractor provided conduit, sections can be joined to form longer rows up to 50'.

Lensing

0.125" Thick Impact resistant outdoor (F1) rated polycarbonate lensing.

Source

Variable lumen packages are available in four color temperature options (3000K, 3500K, 4000K and 5000K) — all within 3 MacAdam ellipses.

Certification

Intertek cETLus Wet Location Listed. RoHS (Restriction of Hazardous Substances) and Buy American Act Compliant.

Battery

Bodine battery providing up to 1200lm(10W) for 90 minutes. UL924 listed. Class 2 compliant. Meets Title 20 CEC (California Energy Commission) efficiency standards.

Environment

Suitable for dry, damp, and wet locations.

Operating temp.: -40°C to +50°C
-40°F to +122°F

Dimming Driver

Osram Optotronic Outdoor LED Driver allows tunable output currents to achieve infinite configurations of output. UL Class P recognized. 0-10v interface can be wired as Class 1 or Class 2 circuit

Packaging

Sustainably manufactured outside cardboard box and biodegradable, protective poly-foam luminaire inserts.

WARRANTY

5-year limited warranty. Complete warranty terms can be located at:

https://starteklightingamerica.com/wp-content/uploads/2019/11/Hydro_Beam_Warranty.pdf

Note: Actual performance may differ as a result of installation environment and final application. All values are design or typical values, measured under laboratory conditions, at 25° C (77° F).

CONTROL

Sensor


VERTEX Fixture Integrated Occupancy Sensor with Dimming Photocell. Ideal for standalone or network lighting control applications. Its ultra-small footprint enables seamless integration into an indoor or outdoor luminaires without disrupting aesthetics or requiring additional mounting space. Its versatility allows for mounting at various heights up to 15ft detecting major and minor motion movement.




COVERAGE PATTERNS

Motion Sensor Large Range

- Optimized full coverage from 8 ft 15 ft (2.4 m - 4.5 m) mounting heights
- Reliable detection of large motion (e.g. pedestrian walking traffic)
- 1.3 x's mounting height equals approximate detection range





Specification

Input Rating: 3.3V-5V(Voltage), 5mW (Mega Power)

Environmental Specification: -10°C - 70°C (Std. Operating Temp.), -40°C - 70°C (LT Operating Temp)

Output Rating: Not Applicable



ARCHITECTURAL HIGH PERFORMANCE FULL CUTOFF WALL PACK



	LED WATTAGE CHART						
	16L	32L					
400 milliamps	21w	-					
530 milliamps	29w	-					
700 milliamps	37w	71w					
1000 milliamps	-	100w					
1050 milliamps	56w						

KEY FEATURES

- Ideal for Exterior Walls, Entryways, Pathways, New Construction and Renovation, Warehouse and Receiving Docks, Court Yards, and School Playgrounds
- Sleek Minimalistic Design of the the NV-W (up to 11,000 Lumens, 12"W x 9"D x 5.5"H) Compliments the Design of the NV-W2 (up to 24,000 Lumens, 18"W x 9.38"D x 5"H)
- Amber, 2700K, 3000K, 3500K, 4000K, 5000K CCT Multichip High Power 70 & 80 CRI LEDs
- IP65 Rated Against Dust & Water Ingress, IK10 Rated for Tamper/ Vandalism/Impact Protection
- 20kA Surge Protection (120V 480V) Cold Weather Integrated Battery Back-Up Safety Options
- \bullet Silicone Optics providing 96% Clarity and Heat Resistant up to 150°C
- 9 Standard Finishes, Custom Finish and Marine Grade Finish Available

- Controls Agnostic, Compatible with Most Control Systems and Sensors
- Environmentally Friendly Product Which Reduces Energy Consumption, L70 > 100,000 hours
- IDA qualified for 3000K CCT and Lower for Down-light Application, Reducing Light Pollution and Trespass
- Buy America(n) Option Available, Quick Mount for Easy Installation
- Cost Competitive and Short Shipping Lead Times in Days & Weeks

BUY AMERICAN

To ensure the latest BAA/TAA/BABA Standards are being met, please select BAA, TAA, or BABA in the options section. Please contact the factory before placing an order for any NLS products requesting BAA (Buy American Act), TAA (Trade American Act), or BABA (Build America, Buy America).



Type:

NV-W ORDERING GUIDE	NV-W	ORD	ERII	NG	GU	IDE
----------------------------	-------------	-----	------	----	-----------	-----

Cat#	Light Dist.	# of LEDs	Miliamps	Kelvin	Volts
NV-W (NV-W)	Type 2 (T2)	16 (16L)	400 (40)	Amber 585-600nM (AMBER) 1, 11, 14	120-277 (UNV)
	Type 3 (T3)	32 (32L)	530 (53)	2700K, 70 CRI (27K7) 7	347-480 (HV)
	Type 4 (T4)		700 (7)	2700K, 80 CRI (27K8) 1, 7, 13	
			1000 (1A) ⁵	3000K, 70 CRI (30K7) ⁷	
			1050 (1) 6	3000K, 80 CRI (30K8) 1, 7, 13	
				3500K, 80 CRI (35K8)	
				4000K, 70 CRI (40K7)	
				4000K, 80 CRI (40K8) 1, 13	
				5000K, 70 CRI (50K7)	
				5000K, 80 CRI (50K8) 1, 13	
Mounting	Color	Controls Options	Options	Lens Options	
Wall Mount (WM)	Bronze Textured (BRZ)	Nema 7-Pin Receptacle (PE7) ²	Marine Grade Finish (MGF)	Glass Lens (GL) ^{8, 15}	
	White Textured (WHT)	Button Photocell (PC) ³	Vanity Plate 22"x16" (VP)	HAL Lens (HAL) 9, 15	
	Smooth White Gloss (SWT)	FSP-211 with Motion Sensor / Photocell	Housing Extension (HE)		
	Silver Metallic (SVR)	(UNV Voltage) *8' and Below (FSP-8) ³	Surge Protector (20KA)		
	Black Textured (BLK)	*9'-20" Heights (FSP-20) ³	Emergency Battery 4W (EM4) ² , ³ , ⁴		
	Smooth Black Gloss (SBK)		Emergency Battery 8W (EM8) ^{2, 3, 4}		
	Graphite Textured (GPH)		Emergency Cold Pk Battery 14W		
	Grey Textured (GRY)		(EMCP) 2, 3, 4 Black Hardware		
	Green Textured (GRN)		(BH) 1 Black Optic Frame		
	Hunter Green Textured (HGN)		(BOF) 1 Buy American Act		
	Custom (CS)		(BAA) 12 Trade Agreement Act (TAA) 12		
NOTES: 1. Consult Factory for Lea 2. Requires Housing Exter			Build America Buy American (BABA) 12		
3. Universal Voltage 120-2			Custom Controls		

- 4. All Emergency Battery Options Certified CA Title 20
- 5. 32L only
- 6. 16L only
- 7. 3000K or lower must be selected to meet International Dark Sky Association certification
- 8. Glass Lens: Low iron glass, fully tempered per ANSI C1047 $\,$
- 9. HAL Lens: Yellow Polycarbonate Lens less than 2% Blue Light Content
- Please contact Factory for Custom Control Integration requests (nLight, NX, WaveLinx, Crestron, DMX/RDM, Synapse, Casambi, Dali II, Avi-On, or other control systems)
- 11. Turtle Safe
- 12. Consult factory for all BAA/TAA/BABA requests
- 13. Consult Factory for 90 CRI Requests
- 14. Not Available above 700mA
- 15. Contact Factory

Custom Controls Integration (CCI) 10

Dual Circuit (2CT) 5, 15



ELECTRICAL

- · 120-277 Volts (UNV) or 347-480 Volts (HV)
- · 0-10V dimming driver
- Driver power factor at maximum load is ≥ .95, THD maximum load is 15%
- LED Drivers Ambient Temp. Min is -40°C and Ambient Temp. Max ranges from 50°C to 55°C and, in some cases, even higher. Consult the factory for revalidation by providing the fixture catalog string before quoting and specifying it.
- · All internal wiring UL certified for 600 VAC and 105°C
- · All drivers, controls, and sensors housed in enclosed IP66 compartment
- · CRI 70, 80, 90
- · Color temperatures: 2700K, 3000K, 3500K, 4000K, 5000K

CONSTRUCTION

- · Die Cast Aluminum
- · Internal cooling fins
- · Corrosion resistant external hardware
- · One-piece silicone gasket ensures IP65 seal for electronics compartment
- Two-piece silicone Micro Optic system ensures IP67 level seal around each PCB
- · Silicone Micro Optics: Recessed, full cutoff, vandal resistant and non-yellowing
- · Dark Sky Approved

OPTIONS

- MARINE GRADE FINISH (MGF) A multi-step process creating protective finishing coat against harsh environments. Chemically washed in a 5 stage cleaning system. Prebaked, Powder coated 3-5 mils of Zinc Rich Super Durable Polyester Primer. Oven Baked. Finished Powder Coating of Super Durable Polyester Powder Coat 3-5 mil thickness.
- VANITY PLATE (VP) Optional Vanity Plate was designed to cover the unsightly remains on a wall where a larger HID wallpack was removed. The aluminum Vanity Plate will be painted to match the finish of the NV-W2, custom finishes are available, please consult factory. The standard Vanity Plate is 22"W x 16"H.
- 20KA Surge Protector (20KA) protects the complete system against nominal surges of up to 20KA. Protection against power surges, storms and lightning strikes
- EMERGENCY COLD PACK BATTERY (EMPC) Emergency cold pack (-20oC minimum) battery system available in 14W output.
- · Black Hardware (BH) Black stainless steel hardware.
- · Black Optic Frame (BOF) Black optic frame. Standard is white.
- · GLASS LENS (GL) Low Iron Glass, fully tempered.
- High performance amber lens (HAL)

CONTROL OPTIONS

- FSP-211 (FSP-X)—Passive infrared (PIR) sensor providing multi-level control based on motion/daylight contribution.
- All control parameters adjustable via wireless configuration remote storing and transmitting sensor profiles.
- · FSP-8 Mounting heights 8 feet and below
- · FSP-20 mounting heights 9-20 feet
- Includes 5 dimming event cycles, 0-10V dimming with motion sensing, re-programmable in the field. Programmable remote must be purchased separately.

- FSIR-100 commissioning remote is required to change sensor settings. Please contact factory for ordering.
- · Controls Agnostic: Please contact factory for your preferred controls option.
- NEMA 7-PIN RECEPTACLE (PE7)—An ANSI C136.41-2013 receptacle provides electrical and mechanical interconnection between photo control cell and luminaire. Dimming receptacle available two or four dimming contacts supports 0-10 VDC dimming methods or Digital Addressable Lighting Interface (DALI), providing reliable power interconnect.
- BUTTON PHOTOCELL—Dusk to dawn optional Button Photocell.

FINISH

- 3-5 mils electrostatic powder coat.
- NLS Lighting's standard high-quality finishes prevent corrosion, and protects against extreme environmental conditions.

WARRANTY

Five-year limited warranty for drivers and LEDs.

OPTICS

Silicone optics high thermal stability and light output provide higher powered LEDs with minimized lumen depreciation. UV stability with scratch resistance increases exterior application durability. Silicone optics do not yellow, crack or brittle over time.

LISTINGS

- Certified to UL 1598
- UL 8750
- · CSA C22.2 No. 250.0
- · DesignLights Consortium® (DLC)
- · DesignLights Consortium Premium® (DLCP)
- · IP65 Rated Fixture / IP67 Rated Optics
- · IK10 Rated
- · IDA Dark Sky Approved

BUY AMERICAN OPTION

While all of the NLS Lighting products listed in this document qualify for the Buy America(n) Act of 1933, we reserve the right to change our listings without notice.

The information provided above is for general informational purposes only. We encourage you to consult legal professionals for advice particular to your projects concerning BAA, TAA, BABA or Buy America.

Additional NLS Products that meet BAA, TAA standards can be found at the following link:

https://nlslighting.com/buy-american/































The information and specifications on this document are subject to change without any notification. All values are design, nominal, typical or prorated values when measured under internal and external laboratory conditions.



	LUMENS						
PART NUMBER	T2	LM/W	ТЗ	LM/W	T4	LM/W	WATTS
NV-W-16L-40-27K7	2561	122	2591	123	2561	122	21
NV-W-16L-40-27K8	2398	114	2426	116	2398	114	21
NV-W-16L-40-30K8	2571	122	2601	124	2571	122	21
NV-W-16L-40-30K7	2769	132	2801	133	2769	132	21
NV-W-16L-40-35K8	2571	122	2601	124	2571	122	21
NV-W-16L-40-40K8	2769	132	2801	133	2769	132	21
NV-W-16L-40-40K7	2992	142	3027	144	2992	142	21
NV-W-16L-40-50K8	2769	132	2801	133	2769	132	21
NV-W-16L-40-50K7	2992	142	3027	144	2992	142	21
NV-W-16L-53-30K7	3544	122	3579	123	3544	122	29
NV-W-16L-53-40K7	3756	130	3794	131	3756	130	29
NV-W-16L-53-50K7	3756	130	3794	131	3756	130	29
NV-W-16L-7-30K7	4388	119	4432	120	4388	119	37
NV-W-16L-7-40K7	4651	126	4698	127	4651	126	37
NV-W-16L-7-50K7	4651	126	4698	127	4651	126	37
NV-W-16L-1-30K7	5970	107	6029	108	5970	107	56
NV-W-16L-1-40K7	6328	113	6391	114	6328	113	56
NV-W-16L-1-50K7	6328	113	6391	114	6328	113	56
NV-W-32L-53-30K7	X	X	X	Х	6,821	126	54
NV-W-32L-7-30K7	9010	127	9100	128	9010	127	71
NV-W-32L-7-40K7	9550	135	9646	136	9550	135	71
NV-W-32L-7-50K7	9550	135	9646	136	9550	135	71
NV-W-32L-1A-30K7	10871	109	10983	110	10871	109	100
NV-W-32L-1A-40K7	11426	114	11544	115	11426	114	100
NV-W-32L-1A-50K7	11426	114	11544	115	11426	114	100
	3000K or lower	r, with fixed mounting op	tions only, must be selec	cted to meet Internation	nal Dark-Sky Association	certification.	

	EMERGENCY BATTERY BACK-UP LUMENS						
PART NUMBER	T2	LM/W	Т3	LM/W	T4	LM/W	WATTS
EM4-30K7	520	130	524	131	516	129	4
EM4-40K7	544	136	548	137	540	135	4
EM4-50K7	560	140	564	141	556	139	4
EM8-30K7	1040	130	1048	131	1032	129	8
EM8-40K7	1088	136	1096	137	1080	135	8
EM8-50K7	1120	140	1128	141	1112	139	8
EM14-30K7	2080	130	2096	131	2064	129	16
EM14-40K7	2176	136	2192	137	2160	135	16
EM14-50K7	2240	140	2256	141	2224	139	16
EMCP-30K7	1820	130	1834	131	1806	129	14
EMCP-40K7	1904	136	1918	137	1890	135	14
EMCP-50K7	1960	140	1974	141	1946	139	14


JG RATINGS BUG RATINGS						
PART NUMBER	T2	Т3	T4	WATTS		
NV-W-16L-35-30K7	B1-U0-G1	B1-U0-G1	B1-U0-G1	21		
NV-W-16L-35-40K7	B1-U0-G1	B1-U0-G1	B1-U0-G1	21		
NV-W-16L-35-50K7	B1-U0-G1	B1-U0-G1	B1-U0-G1	21		
NV-W-16L-53-30K7	B1-U0-G1	B1-U0-G1	B1-U0-G1	29		
NV-W-16L-53-40K7	B1-U0-G1	B1-U0-G1	B1-U0-G1	29		
NV-W-16L-53-50K7	B1-U0-G1	B1-U0-G1	B1-U0-G1	29		
NV-W-16L-7-30K7	B1-U0-G1	B1-U0-G1	B1-U0-G1	37		
NV-W-16L-7-40K7	B1-U0-G1	B1-U0-G1	B1-U0-G1	37		
NV-W-16L-7-50K7	B1-U0-G1	B1-U0-G1	B1-U0-G1	37		
NV-W-16L-1-30K7	B1-U0-G1	B1-U0-G2	B1-U0-G2	56		
NV-W-16L-1-40K7	B1-U0-G1	B1-U0-G2	B1-U0-G2	56		
NV-W-16L-1-50K7	B1-U0-G1	B1-U0-G2	B1-U0-G2	56		
NV-W-32L-7-30K7	B1-U0-G2	B2-U0-G2	B2-U0-G2	71		
NV-W-32L-7-40K7	B1-U0-G2	B2-U0-G2	B2-U0-G2	71		
NV-W-32L-7-50K7	B1-U0-G2	B2-U0-G2	B2-U0-G2	71		
NV-W-32L-1A-30K7	B2-U0-G2	B2-U0-G2	B2-U0-G2	100		
NV-W-32L-1A-40K7	B2-U0-G2	B2-U0-G2	B2-U0-G2	100		
NV-W-32L-1A-50K7	B2-U0-G2	B2-U0-G2	B2-U0-G2	100		

Lumen Maintenance Data							
Ambient Temperature	Drive Current	L90 Hours*	L70 Hours**	30,000 Hours*	50,000 Hours*	60,00 Hours*	100,000 Hours**
25°C	Up to 700mA	58,000	173,000	95.7%	91.6%	89.6%	82.1%
1050mA 48,000 143,000 94.3% 89.5% 87.2%					78.5%		
*Reported extrapolations per IESNA TM-21				**Projecte	d extrapolations	per IESNA TM-2	21


LED KELVIN RANGE



Color	Dominant or Peak Wavelength Range (nm)			
	Minimum	Maximum		
Amber	585	600		

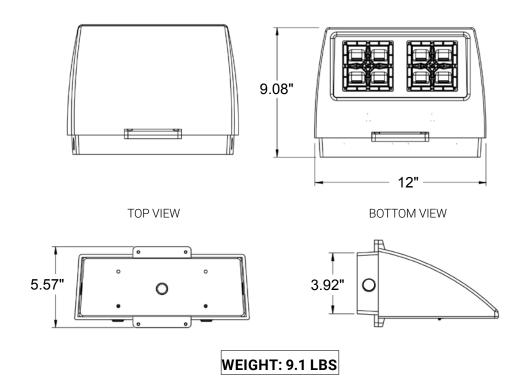


EMERGENCY BATTERY AND 7-PIN EXTENSION BOX DIMENSIONS

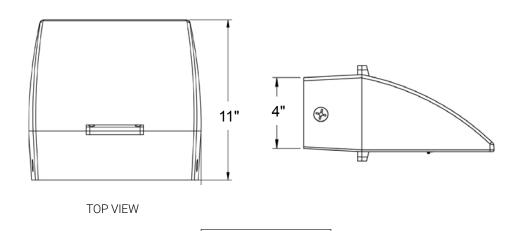


WEIGHT: 13.3 LBS

VANITY PLATE (VP)

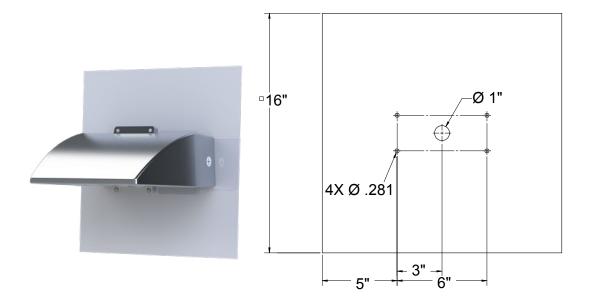

MOUNTING HOLE

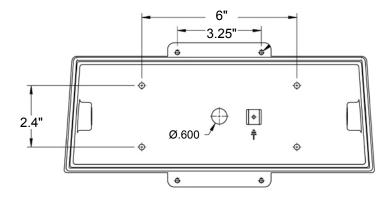



* 3 Conduit access points on either side or center back.

MOTION SENSOR PLACEMENT





FSP-8





FSP-20





Via UPS



January 30, 2025

Natalie Thomsen, Planning Coordinator City of Auburn, Maine 60 Court Street Auburn, Maine 04210

Re: Engine 2 Fire Station

Development Review Application – Response to City Comments

Dear Ms. Thomsen:

Thank you for facilitating the City staff review of the Development Review Application for the Engine 2 Fire Station project. We have received the comments you provided via email on January 13, 2025, from the City staff review of the application. We have addressed the City's comments and revised the application materials accordingly.

Enclosed with this letter the following Site Plan drawing sheets, which were revised to address City comments: G-0-001, C-0-103, C-0-104, C-0-105, C-0-106, C-0-202, C-99-904, C-99-905, C-99-906, C-99-907, and Site Lighting Plan. We have included three (3) full size copies (24"x36"), and ten (10) reduced size copies (11"x17") of the revised drawing sheets. Please note that the only revisions made to the detail sheets were the removal of the StormTech system details, which resulted in the remaining details being reorganized.

Below please find our responses to the City comments received. We have repeated the City comments as shown in **bold** text below, with our responses following in plain text.

1. A landscaping plan is missing from the submission.

A Planting Plan has been provided with the revised submission, drawing C-0-106.

2. Chapter 500 Stormwater requirements are not applicable for this project.

Comment is noted and has been taken into consideration for the stormwater management design.

 We recommend a review of groundwater infiltration, particularly focusing on the easterly uphill side of the site. Consider the addition of a curtain drain for groundwater management. Note that proprietary stormwater devices are not necessary.

In accordance with the Goetechnical Engineer's recommendations, underdrains will be installed beneath the paved areas in the rear of the site where cuts are proposed, and silty clay subgrades are anticipated. Underdrains will be designed and installed as MaineDOT Type C Underdrains. A foundation drain will also be provided around the



perimeter of the building. The StormTech detention system that was on the original application drawings has been removed, as mitigation of quantity or quality of stormwater is not required by the City or MaineDEP stormwater standards for the project.

4. The plans should explicitly include an oil and water separator for the interior drain, which is mentioned in the narrative but not shown on the plans.

An oil water separator has been added to the Utility Plan (noted as OWS-1 on drawing C-0-105).

5. There are currently two sewer manholes depicted on the plans. Would it be feasible to consolidate the inverts into a single manhole?

There are two sanitary discharges from the building. One is for the floor drains within the apparatus bay. The other is from the kitchen and bathroom plumbing. Due to the plumbing design interior to the building, and need for an external oil-water separator for the apparatus bay floor drain, and the oil-water separators prefabricated pipe connection flange locations, it is not possible to consolidate the inverts into a single manhole.

We trust that the information enclosed is complete and to your satisfaction. We look forward to presenting the Project at the upcoming Planning Board meeting. If you have any questions regarding these requests, please do not hesitate to contact me at (207) 558-3707 or via email at csuhr@woodardcurran.com.

Sincerely,

Woodard & Curran, Inc.

Caille Sul

Caitlin Suhr, PE Project Manager

cc: Dan Goyette, City of Auburn
John Blais, City of Auburn
Chief Robert Chase, Auburn Fire Department

PN: 0233981.13

Via UPS



January 30, 2025

Natalie Thomsen, Planning Coordinator City of Auburn, Maine 60 Court Street Auburn, Maine 04210

Re: Engine 2 Fire Station Development Review Application

Waiver Requests

Dear Ms. Thomsen:

On behalf of the City of Auburn (the Applicant), Woodard & Curran (W&C) is requesting the following waivers be granted for the Engine 2 project (the Project) as part of the Development Review by the City of Auburn. The project is located at 180 South Main Street, within the T4.2B Traditional Neighborhood zoning district and is subject to the Form Based Code of the City of Auburn Zoning Ordinance.

Below is a summary of the waivers being requested, including references to the specific section from the City of Auburn Zoning Ordinance, and reasons for the request. The waivers are requested in accordance with the waiver provision of Section 60-558(c). The Zoning Ordinance requirements are presented in **bold** text, and the Applicants' reasoning for the waiver request is provided in plain text.

1. Waiver from Section 60-548B.1. Building placement and configuration. Front setback for principal structure shall be 25 feet maximum.

The design of the new Engine 2 facility includes a building setback greater than 25 feet. This adjustment is necessary for several key operational reasons, all of which are integral to the safety and efficiency of the station and, by extension, to the community it serves.

The additional setback will allow for a dedicated visitor parking area, adequate space for emergency apparatus drive aisles and turning movements, and room for routine testing and maintenance of firefighting equipment. More critically, the additional setback is required to maintain the operation of the existing Engine 2 Fire Station throughout the construction of the new facility. This continuity of operations is essential to ensure that emergency response times are not disrupted during construction, which is a crucial factor in preserving public safety.

Enclosed, please find a letter from Fire Chief Robert Chase that further details how these operational requirements prevent the project from complying with the 25-foot setback maximum.



In accordance with Section 60-548B.2 of the City's zoning code, the new station will have a ground story finished floor elevation approximately four feet above the front yard elevation. Furthermore, the design of the building complies with architectural guidelines, with no blank walls exceeding 10 linear feet along the ground floor façade, and features that respect the neighborhood's character. The placement of the building on the site has been carefully considered to enhance safety for both vehicular and pedestrian movements, both within the site and in relation to the surrounding areas.

2. Waiver from Sec. 60-548B.2. Building frontages. Windows and doors shall comprise a minimum of 40% and maximum of 90% coverage of the total ground story frontage façade for commercial developments.

The building design includes 34% window and door coverage, which is below the required 40% for commercial developments, but greater than the minimum requirement of 25% for residential uses. The building's design eliminates windows from storage and other support spaces, to maximize usable space while reducing energy loss. Fewer windows in these areas help to conserve energy and lower long-term operational costs. While the 40% window and door coverage requirement is standard for commercial developments, the proposed design takes into account the primary function of the facility, which is a fire station with dormitories. The operational efficiency and energy conservation needs of the building are paramount, and the proposed coverage of 34% strikes an appropriate balance between these needs and the building's overall functionality.

3. Waiver from Section 60-548B.3. External elements. Parking for commercial developments shall be located to rear of the property to the greatest extent possible. Parking on a side yard is limited to no more than 60 feet wide or 40% of the lot width. Screening and/or street wall is required for parking areas along a street.

The design of the new facility includes two dedicated parking areas, which have been strategically placed to balance the operational needs of the Fire Department with the preservation of natural features and neighborhood aesthetics.

The first parking area, located to the west of the building, includes seven spaces for Fire Department staff. This area is accessed via the emergency vehicle apparatus drive aisle, which is essential for ensuring that fire response vehicles and personnel can move efficiently within the site.

The second parking area, located at the front of the building, provides three spaces for public use, including one accessible space. These spaces are accessed via a separate, dedicated drive aisle to ensure safety and efficient flow of both public and emergency vehicle traffic. The public parking spaces have been located at the front of the building, consistent with existing conditions, to provide close proximity to the public entrance to the station, and to comply with Americans with Disabilities Act (ADA) requirements.



Additionally, the layout of the parking areas has been designed to minimize environmental impacts. Locating the parking areas on the front and side of the building helps to avoid further encroachment upon wetlands located elsewhere on the site. To further mitigate the visual impact of the parking areas, landscaping and screening, as shown on the attached Planting Plan, will be provided.

4. Waiver from Section 60-801. Access Management and Number of driveways per lot. Minimum spacing of 150 feet for curb cut and driveway spacing; and one two-way access onto a single roadway.

The design of the new facility includes two separate curb cuts and drive aisles to ensure safe and efficient movement of emergency vehicles, as well as to effectively separate public access from staff and emergency vehicle traffic. This separation is critical to maintaining both operational efficiency and safety on the site.

The proposed curb cuts are less than 150 feet apart, in line with existing conditions for the property. Due to the limited frontage of the site, it is not feasible to achieve the required separation between curb cuts while also meeting the operational needs of the Fire Department. Given the nature of the site and the need to maintain clear traffic flow for both emergency and public vehicles, this configuration ensures the safety of all users. To further enhance safety and control traffic flow, stop signs have been incorporated at each of the drive aisle curb cuts.

5. Waiver from Section 60-548B.3 and Section 60-607. External elements and general provisions and design standards. Driveways shall be a maximum 20-foot width.

The design includes two curb cuts along South Main Street: one for emergency vehicle access and the other for public access. The proposed curb cuts are approximately 34 feet and 24 feet wide, respectively. These widths are necessary to ensure safe and efficient operations for both emergency vehicles and public access.

The wider curb cuts are specifically designed to accommodate the movement of emergency apparatus in and out of the apparatus drive aisle, as well as to facilitate passenger vehicle access to the visitor parking area. Given the nature of the station's operations, these dimensions are critical to maintain the necessary clearance for fire trucks and other emergency vehicles, which require larger turning radii and more space to maneuver safely.

According to Section 60-607, curb cut widths may be increased up to a maximum of 44 feet on arterial roads, as determined by the city engineering department or the state department of transportation. South Main Street is classified by MaineDOT as a Major Collector, and the portion of South Main Street where the curb cuts are proposed may be considered a minor arterial highway under Section 60-2 of the Zoning Ordinance. This designation reflects that the roadway serves moderate-length trips and provides

3



continuity between geographic areas, but does not penetrate neighborhoods, making it suitable for the proposed curb cut widths.

Given these conditions, the requested waiver for the wider curb cuts is essential to ensure both operational efficiency and safety, particularly for the movement of emergency vehicles, while also accommodating public access without compromising the flow of traffic.

We trust that the information enclosed is complete and to your satisfaction. We look forward to presenting the Project at the upcoming Planning Board meeting. If you have any questions regarding these requests, please do not hesitate to contact me at (207) 558-3707 or via email at csuhr@woodardcurran.com.

4

Sincerely,

Woodard & Curran, Inc.

Caille Sul

Caitlin Suhr, PE Project Manager

cc: Dan Goyette, City of Auburn John Blais, City of Auburn

Chief Robert Chase, Auburn Fire Department

PN: 0233981.13



Auburn Fire Department

Robert Chase | Fire Chief 550 Minot Avenue | Auburn, Maine 04210 www.auburnmaine.gov | 207.333.6633

January 30, 2025

Auburn Planning Board 60 Court Street Auburn, Me 04210

RE: Request for Waiver

Members of the Auburn Planning Board,

I am writing to formally request a waiver of the 25' setback requirement for the Engine 2 Station project. After a thorough evaluation of potential alternative sites, we have concluded that none of the options would meet our needs without significantly compromising response times and, ultimately, public safety.

The current site remains the most suitable location to maintain service and response capabilities. We've explored alternative building sites but were unable to find another viable option. We also considered temporarily relocating our fire department operations, but failed to identify an appropriate location to do so. Given this, the best course of action is to proceed with building on the existing site while keeping the current station operational. But by building behind the existing station, it will result in a setback that exceeds the standard 25'.

It's important to note that as a fire department, we are unique in that we require sufficient space in front of our stations for daily truck checks, maintenance, and staging of mutual aid trucks during larger incidents. Fire Engines typically measure 35-40 feet in length, and having adequate space for apparatus to park is critical to ensuring efficient response times.

Without the waiver, we would be forced to restart the project from the design phase, which would not only delay the project, but would also potentially disrupt operations if relocation is necessary - relocation that we have determined is not feasible. I believe that a delay would significantly hinder our ability to provide consistent and timely service to the residents of our city.

I support granting this waiver because it's in the best interest of public safety and will allow the Auburn Fire Department to continue to provide the high level of service our community deserves. Thank you for your consideration in this matter.

Sincerety

Robert Chase Fire Chief

beth Chase

CITY OF AUBURN 180 SOUTH MAIN STREET AUBURN, MAINE 04210


AUBURN ENGINE 2

SITE PLAN REVIEW NOT FOR CONSTRUCTION

JANUARY 2025



PROJECT LOCATION MAP

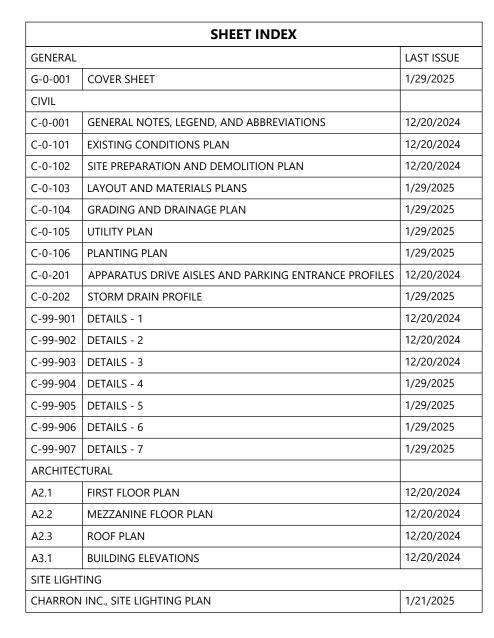

Main-Land Development Consultants, Inc. 69 Main St.
Livermore Falls, ME 04254

Geotechnical EngineeringS.W. Cole Engineering, Inc.
286 Portland Road
Gray, ME 04039


Civil
Woodard & Curran, Inc.
12 Mountfort Street
Portland, ME 04101

Architect
Simons Architects
75 York Street
Portland, ME 04101

Architect
Context Architecture
65 Franklin Street
Boston, MA 02110

StructuralThornton Tomasetti
14 York Street, Suite 201
Portland, ME 04101

MEPAllied Engineering
A Salas O'Brien Company
160 Veranda Street
Portland, ME 04103

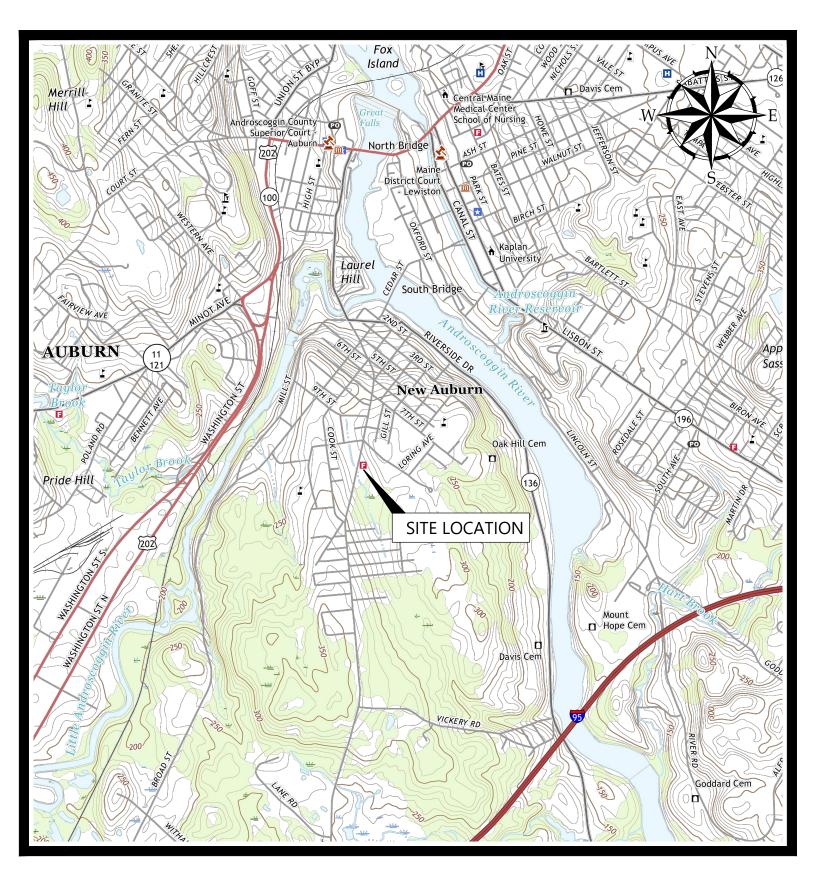

SITE LOCATION MAP

SOURCE: USGS TOPO QUADRANGLE

Woodard
& Curran

12 Mountfort Street
Portland, Maine 04101
800.426.4262 | www.woodardcurran.com

THIS DOCUMENT IS THE PROPERTY OF
WOODARD & CURRAN AND ITS CLIENT.
REPRODUCTION OR MODIFICATION WITHOUT
WRITTEN PERMISSION IS PROHIBITED.

Allied Engineering
A Salas O'Brien Company

160 Veranda Street
Portland, Maine 04103
P: 207.221.2260
F: 207.221.2266

CONTECTOR

Tomasetti

PE SEAL:

SITE PLAN REVIEW
NOT FOR CONSTRUCTION

CITY OF AUBURN 180 SOUTH MAIN STREET AUBURN, MAINE 04210

AUBURN ENGINE 2

1 1/29/2025 RESPONSE TO CITY COMMENTS
REV MM/DD/YY DESCRIPTION

JOB NO: 233981.13

JOB NO: 233981.13

DATE: JANUARY 2025

SCALE: AS NOTED

DESIGNED BY: RA

DRAWN BY: JBC

CHECKED BY: CGS


FILENAME: 233981.13 G-0-001.dwg

GENERAL

COVER SHEET

WING NO:

G-0-001

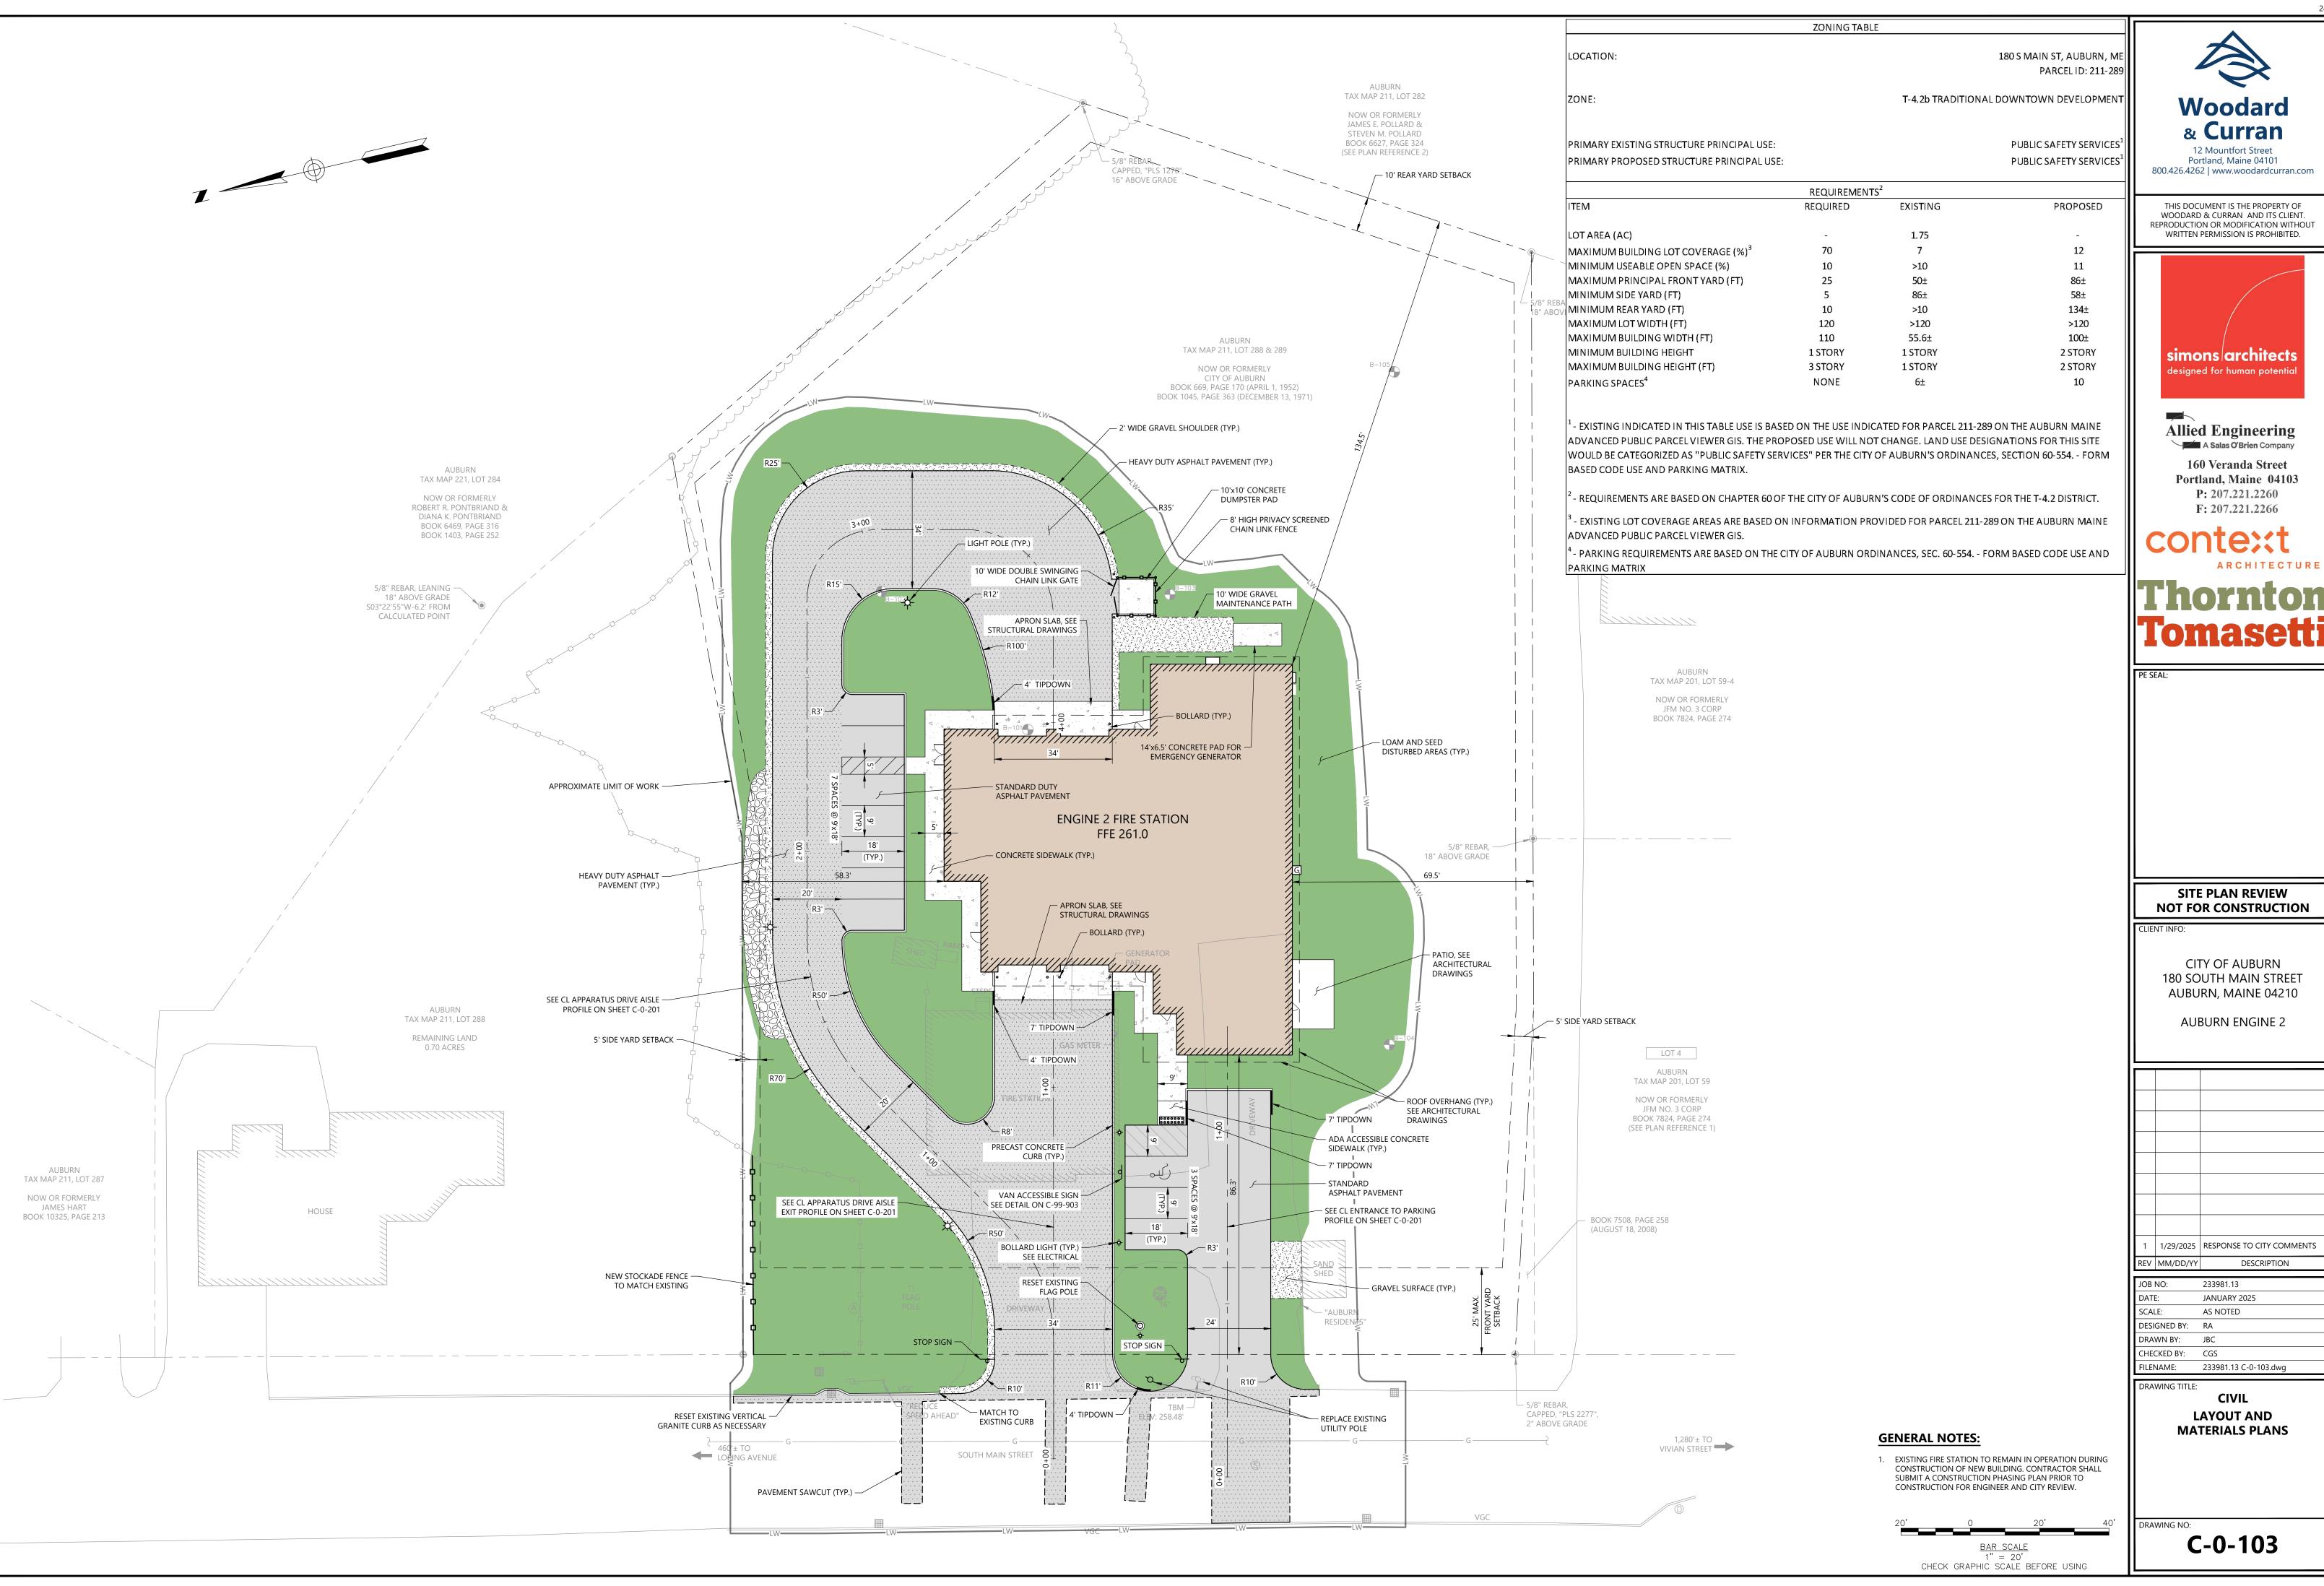

12 Mountfort Street

THIS DOCUMENT IS THE PROPERTY OF WOODARD & CURRAN AND ITS CLIENT. REPRODUCTION OR MODIFICATION WITHOUT



Allied Engineering

160 Veranda Street Portland, Maine 04103 P: 207.221.2260

Tomasetti

SITE PLAN REVIEW

CITY OF AUBURN 180 SOUTH MAIN STREET AUBURN, MAINE 04210


AUBURN ENGINE 2

	1/29/2025	RESPONSE TO CITY COMMENTS
V	MM/DD/YY	DESCRIPTION
D	NO:	222021 12

FILENAME: 233981.13 C-0-103.dwg

LAYOUT AND MATERIALS PLANS

C-0-103

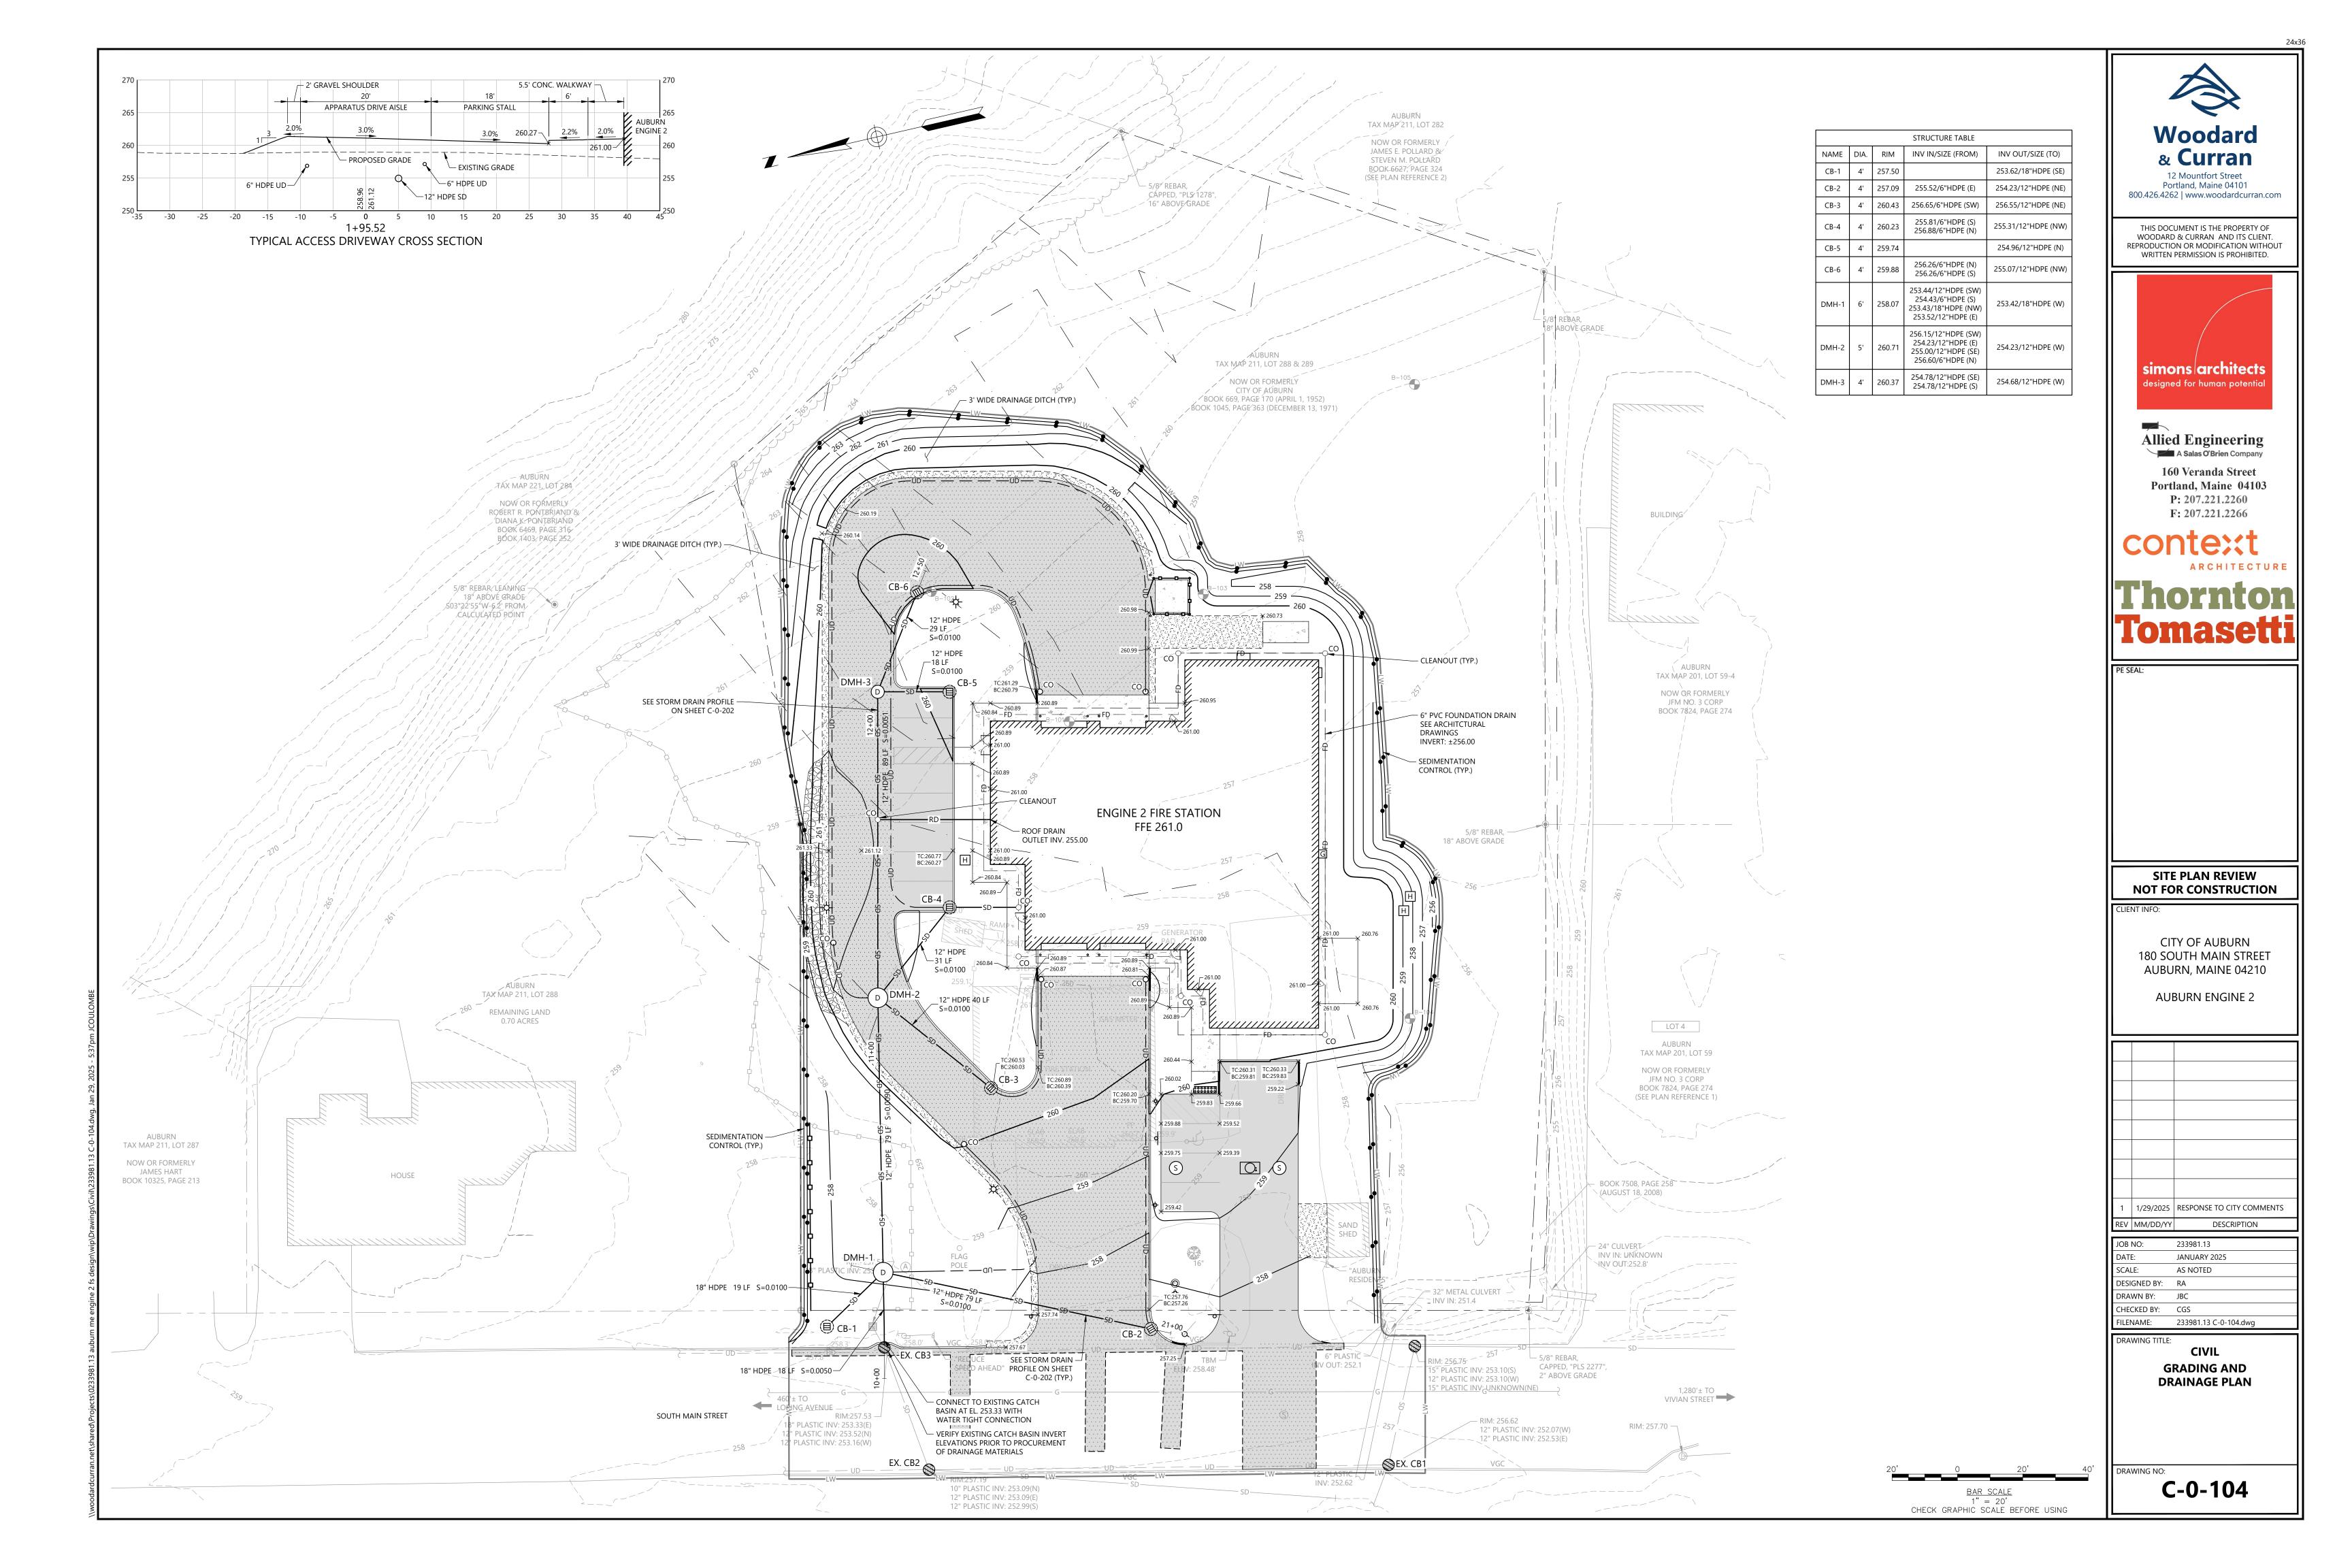

PLAN GENERAL NOTES

AUBURN

TAX MAP 211, LOT 282

NOW OR FORMERLY

JAMES E. POLLARD &

STEVEN M. POLLARD BOOK 6627, PAGE 324

(SEE PLAN REFERENCE 2)

– 5/8" REBAR, 18" ABOVE GRADE

- 5/8" REBAR,

CAPPED, "PLS 1278",

AUBURN TAX MAP 211, LOT 288 & 289

UTILITY POLE

16" ABOVE GRADE

- SIZE AND LOCATION OF PROPOSED UTILITIES SUBJECT TO CHANGE BASED ON FURTHER DESIGN AND COORDINATION WITH MEP ENGINEER.
- 2. REFER TO DRAWING C-0-104 FOR INFORMATION ON PROPOSED STORMWATER SYSTEM.
- 3. SIZE AND LOCATION OF TRANSFORMER AND GENERATOR PAD ARE SCHEMATIC AND SUBJECT TO CHANGE BASED ON FURTHER COORDINATION WITH MEP ENGINEER AND CMP.
- 4. ALLOWANCE SHALL BE CARRIED FOR SITE LIGHTING.
- 5. INSTALL NEW POLE MOUNTED TRANSFORMER AND SECONDARY RISER ON CMP POLE #28 AS DESCRIBED IN ELECTRICAL ENGINEERING SCHEMATIC DESIGN NARRATIVE.
- 6. EMERGENCY GENERATOR SHALL BE DIESEL WITH A SELF-CONTAINED BELLY-TANK, NO GAS. REFER TO MECHANICAL DRAWINGS.
- 7. THE EXISTING FIRE STATION SANITARY SEWER SERVICE AND TIE-IN LOCATION ARE UNKNOWN. THE CONTRACTOR SHALL CARRY AN ALLOWANCE FOR CONSTRUCTING A TEMPORARY 6" PVC SANITARY SEWER SERVICE AND CONNECTION AT THE EXISTING SEWER MAIN IN S MAIN STREET. THE CONTRACTOR SHALL VERIFY THE LOCATION OF THE EXISTING SEWER AND CONFIRM THERE ARE NO CONFLICTS WITH PROPOSED WORK PRIOR TO CONSTRUCTION OR THE PROCUREMENT OF CONSTRUCTION MATERIALS.



12 Mountfort Street Portland, Maine 04101 800.426.4262 | www.woodardcurran.com



Allied Engineering A Salas O'Brien Company

160 Veranda Street Portland, Maine 04103 P: 207.221.2260 F: 207.221.2266

Tomasetti

SITE PLAN REVIEW

CITY OF AUBURN 180 SOUTH MAIN STREET AUBURN, MAINE 04210

AUBURN ENGINE 2


1	1/29/2025	RESPONSE TO CITY COMMENTS
REV	MM/DD/YY	DESCRIPTION
		<u> </u>
JOB	NO:	233981.13

JANUARY 2025 AS NOTED CHECKED BY: CGS

CIVIL **UTILITY PLAN**


CHECK GRAPHIC SCALE BEFORE USING

C-0-105

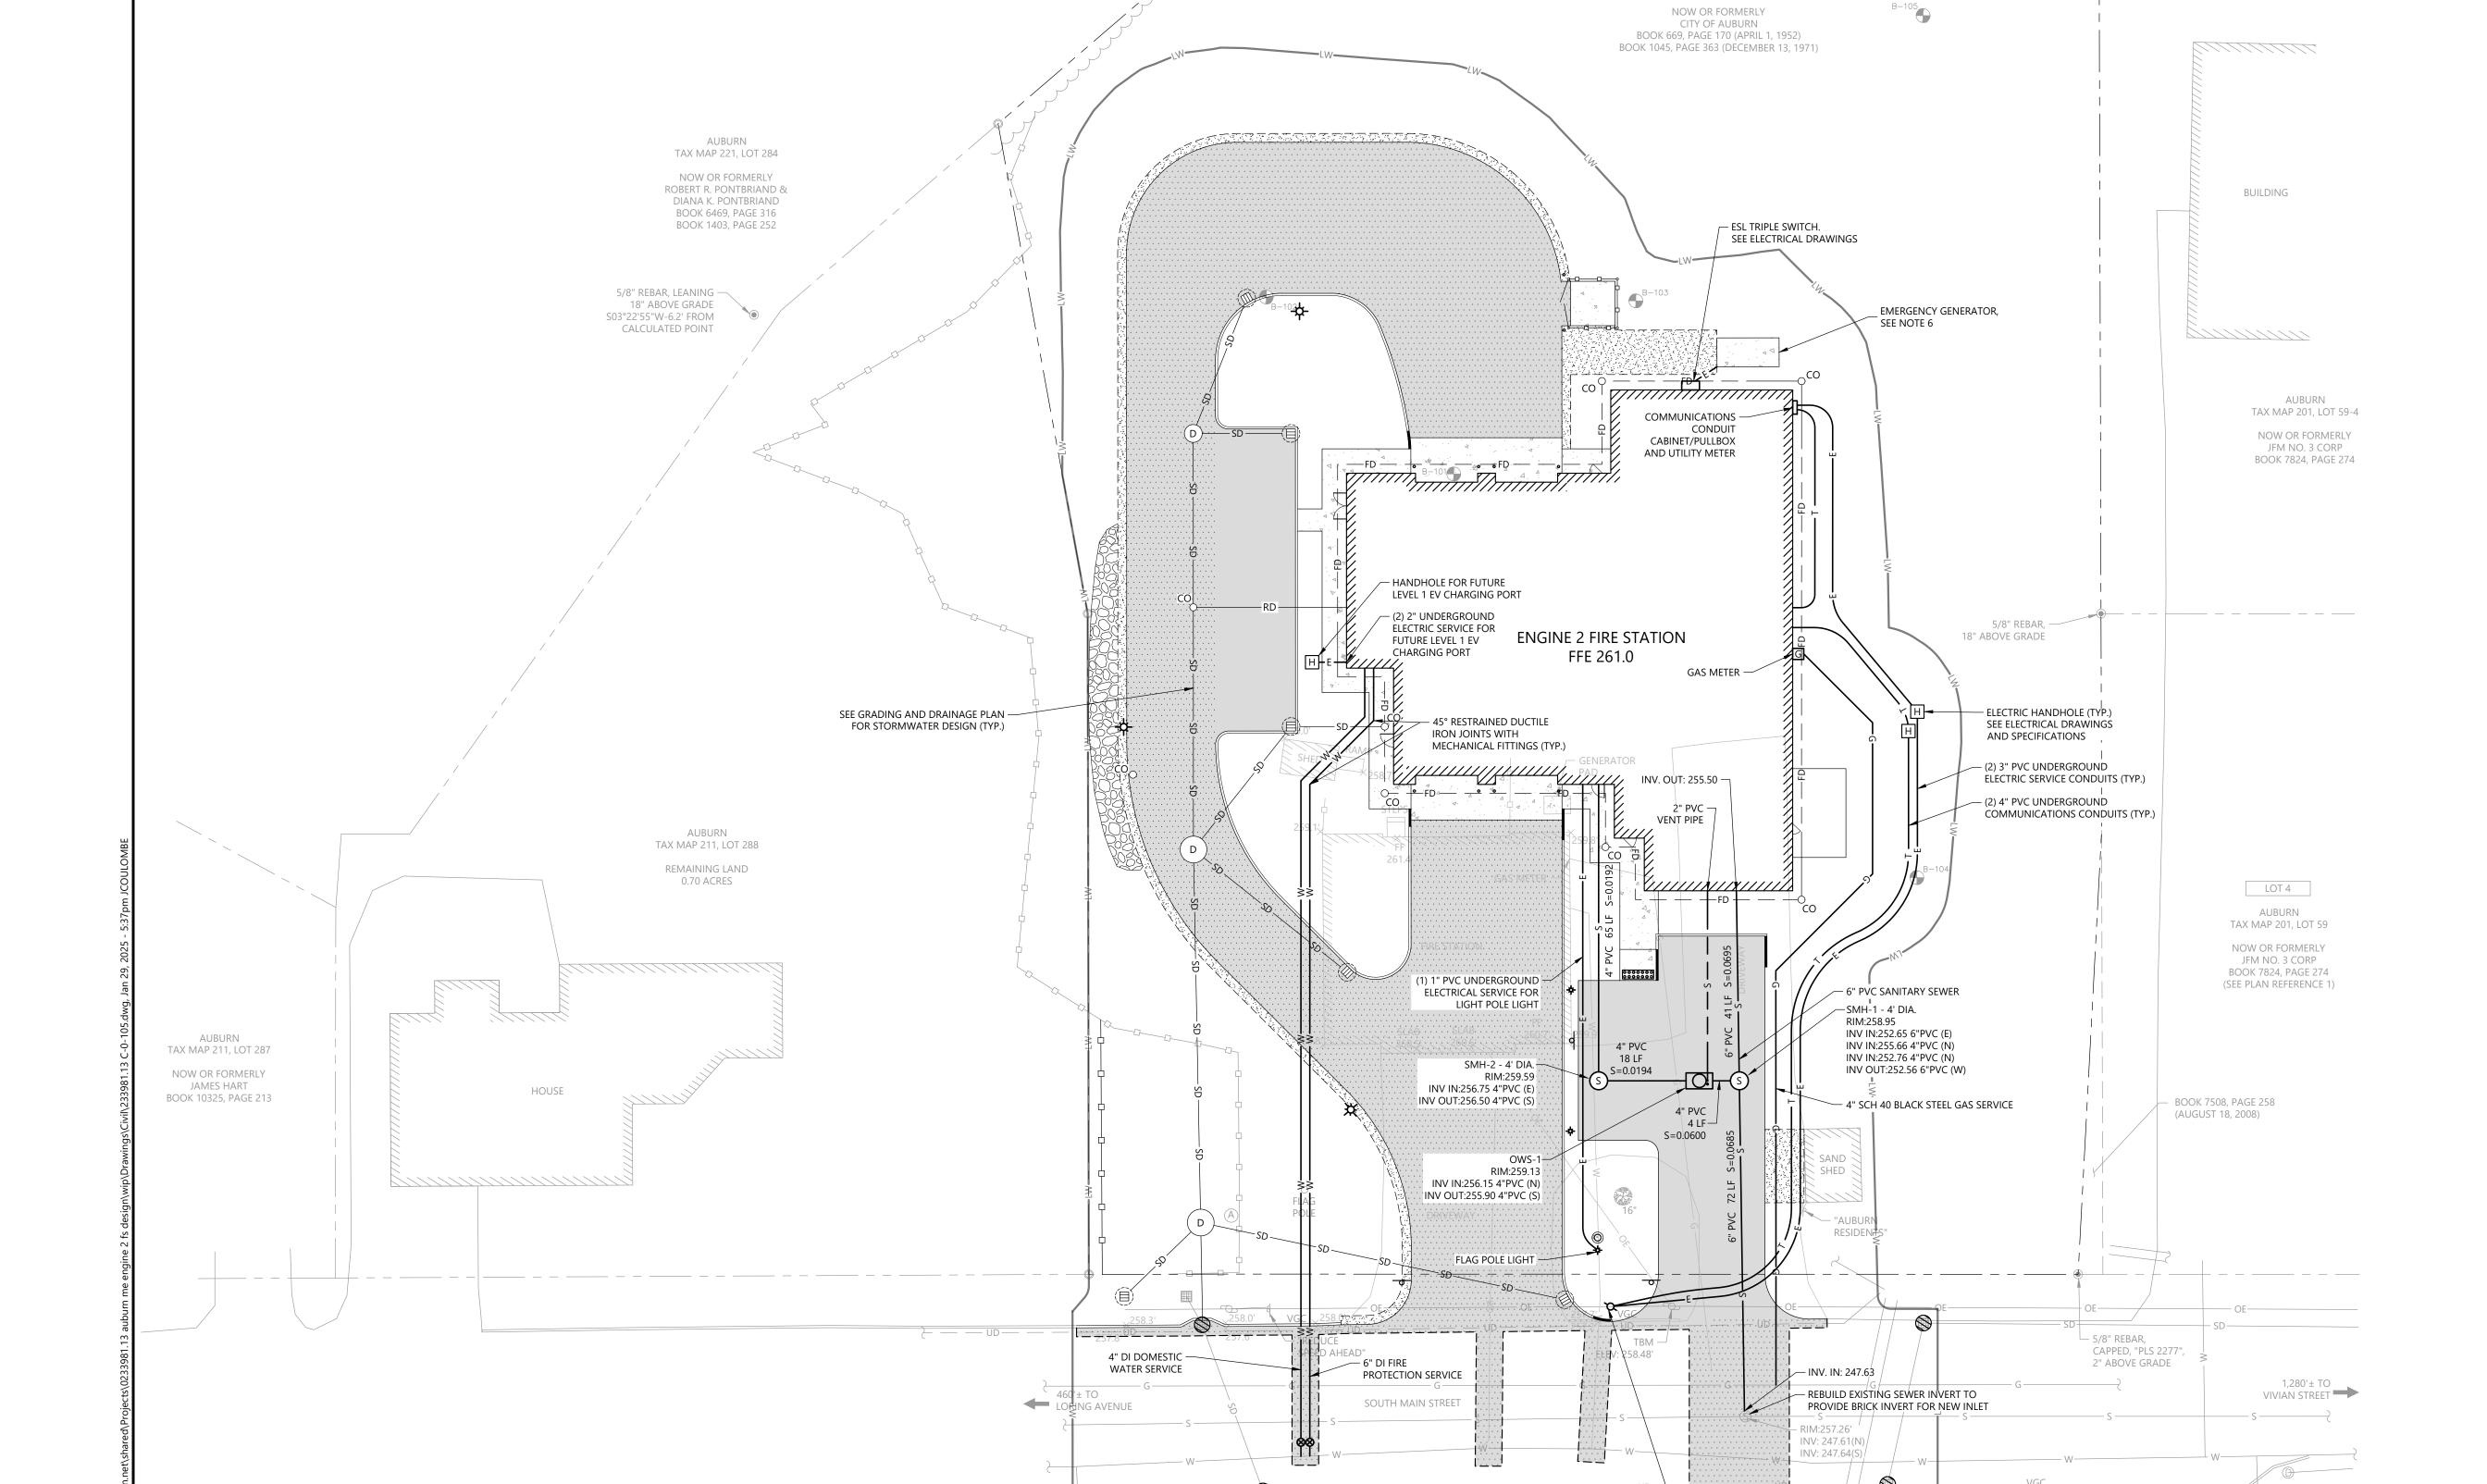

Woodard 12 Mountfort Street Portland, Maine 04101 800.426.4262 | www.woodardcurran.com

THIS DOCUMENT IS THE PROPERTY OF WOODARD & CURRAN AND ITS CLIENT. REPRODUCTION OR MODIFICATION WITHOUT WRITTEN PERMISSION IS PROHIBITED.



Allied Engineering A Salas O'Brien Company

160 Veranda Street Portland, Maine 04103 P: 207.221.2260 F: 207.221.2266

Tomasett

NOT FOR CONSTRUCTION

CITY OF AUBURN 180 SOUTH MAIN STREET AUBURN, MAINE 04210

SITE PLAN REVIEW

AUBURN ENGINE 2

1	1/29/2025	RESPONSE TO CITY COMMENTS
REV	MM/DD/YY	DESCRIPTION

233981.13 JANUARY 2025 SCALE: AS NOTED DESIGNED BY: MB DRAWN BY: CHECKED BY: CGS


233981.13 C-0-106.dwg

DRAWING TITLE:

PLANTING PLAN

ILENAME:

C-0-106

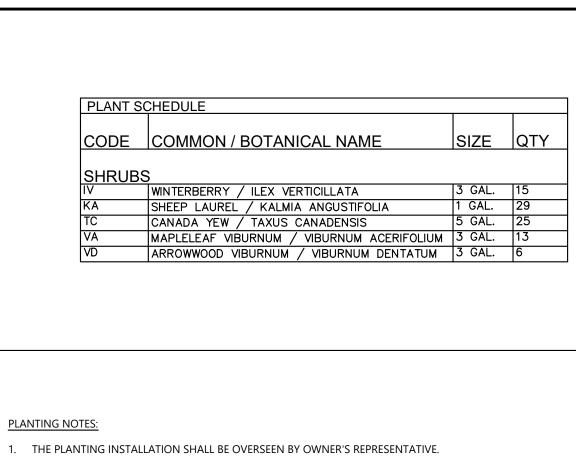


PLANTING NOTES:

- 2. ALL PLANT MATERIAL SHALL CONFORM TO "THE AMERICAN STANDARD FOR NURSERY STOCK", PUBLISHED BY AMERICANHORT (WWW.AMERICANHORT.ORG).
- 3. SUBSTITUTIONS OF PLANT SPECIES SHALL BE A PLANT OF EQUIVALENT OVERALL FORM, HEIGHT AND BRANCHING HABIT, FLOWER, LEAF AND FRUIT, COLOR AND TIME OF BLOOM, AS APPROVED OF BY OWNER'S REPRESENTATIVE.
- 4. PLANTING DEMOLITION DEBRIS, GARBAGE, LUMPS OF CONCRETE, STEEL AND OTHER MATERIALS DELETERIOUS TO PLANT'S HEALTH AS DETERMINED BY PROJECT ENGINEER SHALL BE REMOVED FROM ALL PLANTING AREAS.
- 5. NO PLANTING TO BE INSTALLED BEFORE ACCEPTANCE OF ROUGH GRADING.
- 6. TOTAL QUANTITY OF PLANTS FOR EACH AREA TO BE AVAILABLE ON SITE AT THE TIME OF PLANTING FOR FIELD LAYOUT BY OWNER'S REPRESENTATIVE. NO PARTIAL LAYOUT AND PLANTING OF AREAS WILL BE ACCEPTABLE.
- 7. LOOSE OR CRACKED ROOT BALLS SHALL BE REJECTED AND REPLACED.
- 8. FOR CONTAINER PLANTS, REMOVE CONTAINER AND SCARIFY EDGES OF ROOT BALL 1/2" DEEP IN A MINIMUM OF FOUR LOCATIONS.
- 9. WATER PLANTS THOROUGHLY AFTER INSTALLATION, A MINIMUM OF TWICE WITHIN THE FIRST 24 HOURS.

PLANTING INSTALLATION:

- 1. PLANT SPACING SHALL BE FOLLOWED AS NOTED IN THE PROJECT PLANT SCEDULE.
- 2. PLANTING DEPTH SHALL BE DONE IN ACCORDANCE WITH DETAIL HEREON.
- 3. QUICK RELEASE FERTILIZER SHOULD BE MIXED WITH BACKFILL SOIL AND PLACED IN HOLE PRIOR TO PLANTING.
- 4. PLANTING SOILS FOR NATIVE PLANTS TO CONSIST OF SITE SOILS MIXED WITH NEW TOP SOIL.
- 5. 2" LAYER OF BARK MULCH SHOULD BE PLACED AROUND BASE OF PLANTS FOLLOWING PLANTING AND BACKFILLING. MULCH SHOULD NOT BE PLACED DIRECTLY UP AGAINST THE TRUNK, STEMS OR FOLIAGE, TO AVOID DAMAGING AND/OR SUFFOCATING THE PLANTINGS.


- 1. SHRUB ESTABLISHMENT IN ZONE 5 WILL REQUIRE REGULAR IRRIGATION THROUGH THE FIRST GROWING SEASON FOR UP TO 6
- 2. SHRUBS NEED TO BE REGULARLY IRRIGATED UNDER A LANDSCAPE MAINTENANCE PROGRAM THROUGH THE ENTIRE ESTABLISHMENT PERIOD, ESPECIALLY IN PERIODS OF DROUGHT FOR PROPER ROOT ESTABLISHMENT.
- 3. 6 MONTH ESTABLISHMENT IRRIGATION: SHRUB SHALL BE IRRIGATED DAILY FOR THE FIRST 2 WEEKS FOLLOWING INSTALLATION, EVERY OTHER DAY FOR 2 MONTHS; WEEKLY FOR A PERIOD OF 6 MONTHS UNDER LANDSCAPE WARRANTY.
- 4. ESTABLISHMENT IRRIGATION AMOUNT: 2-3 GALLONS PER PLANT PER 1" OF STEM OR TRUNK DIAMETER. IRRIGATE BY HAND OR WITH TEMPORARY DRIP IRRIGATION DURING ESTABLISHMENT PERIOD.
- 5. REGULAR MAINTENANCE & IRRIGATION FOLLOWING ESTABLISHMENT PERIOD: NATIVE SHRUBS DO NOT REQUIRE ADDITIONAL FERTILIZATION, MECHANICAL IRRIGATION OR OTHER SPECIALIZED CARE IF REGULAR IRRIGATION AND MAINTENANCE WAS FOLLOWED
- 6. SHRUBS TO BE IMMEDIATELY IRRIGATED. APPLY A VOLUME OF WATER THAT IS 1/3 THE VOLUME OF THE CONTAINER SIZE AT

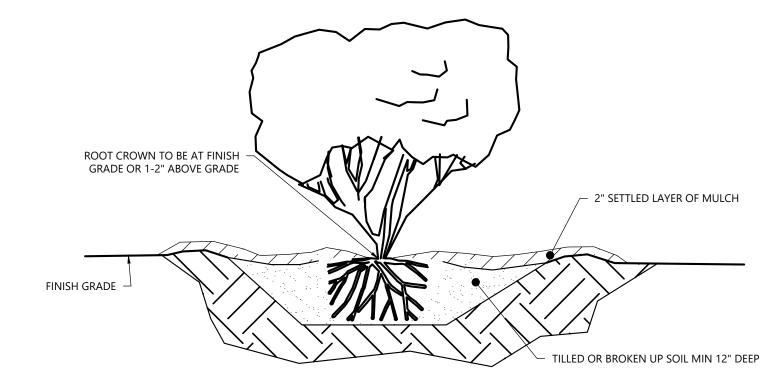



NOTES:

- 1. DIG PLANTING HOLE 2X THE WIDTH OF THE ROOT BALL OR CONTAINER.
- 2. SET THE TOP OF THE ROOT BALL LEVEL WITH THE SOIL SURFACE, OR 1-2" ABOVE IF THE SOIL IS PRONE TO SETTLING.
- 3. IF CONTAINER GROWN PLANT, GENTLY SLIDE PLANT OUT OF CONTAINER. DISTURB THE ROOTS.
- 4. IF B&B PLANT, REMOVE BURLAP FROM THE TOP 12 INCHES OF THE ROOTBALL, WITHOUT DISTURBING THE ROOTBALL. REMOVE ALL CORD FROM THE TRUNK. REMOVE BURLAP AND WIRE BASKET (IF PRESENT) FROM THE ROOT BALL.
- 5. BACK FILL THE PLANTING HOLE WITH EXCAVATED NATIVE SOIL, BROKEN UP OR TILLED. WATER TO REMOVE AIR POCKETS. DO NOT ADD AMENDMENTS.
- 6. PLACE BARK MULCH ON THE SURFACE TO A (SETTLED) DEPTH OF 2 INCHES.

SHRUB PLANTING:

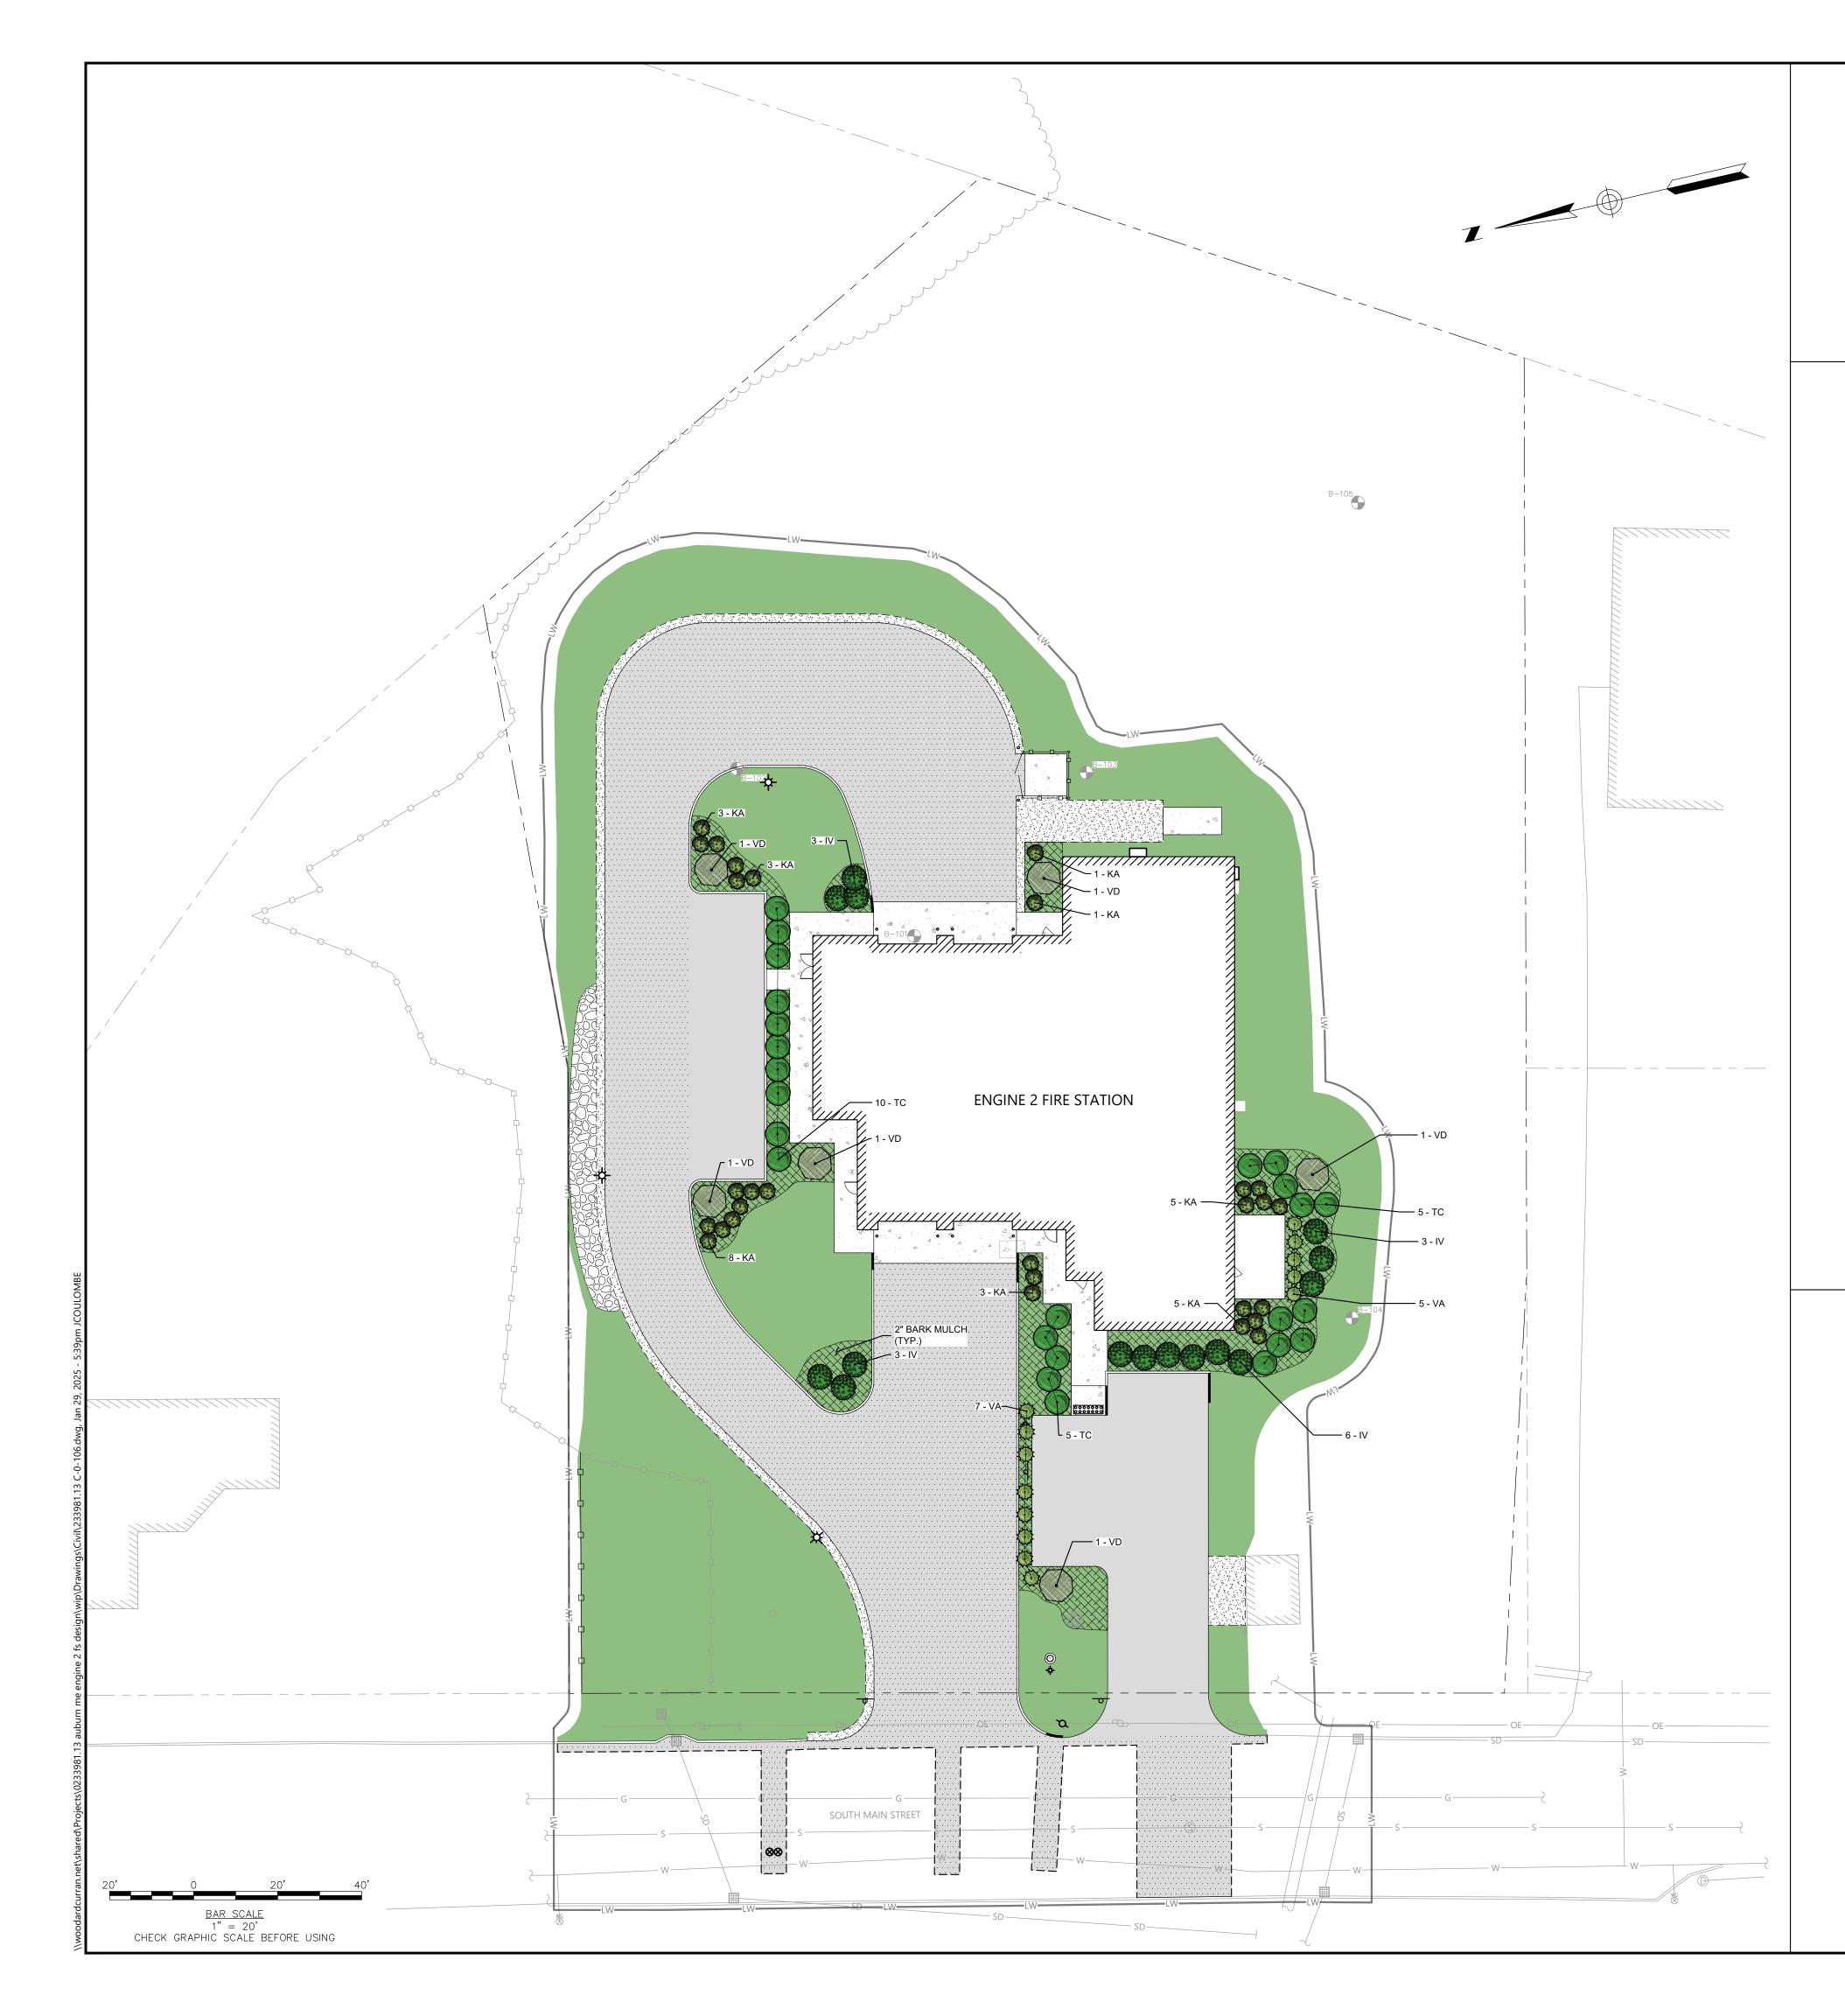

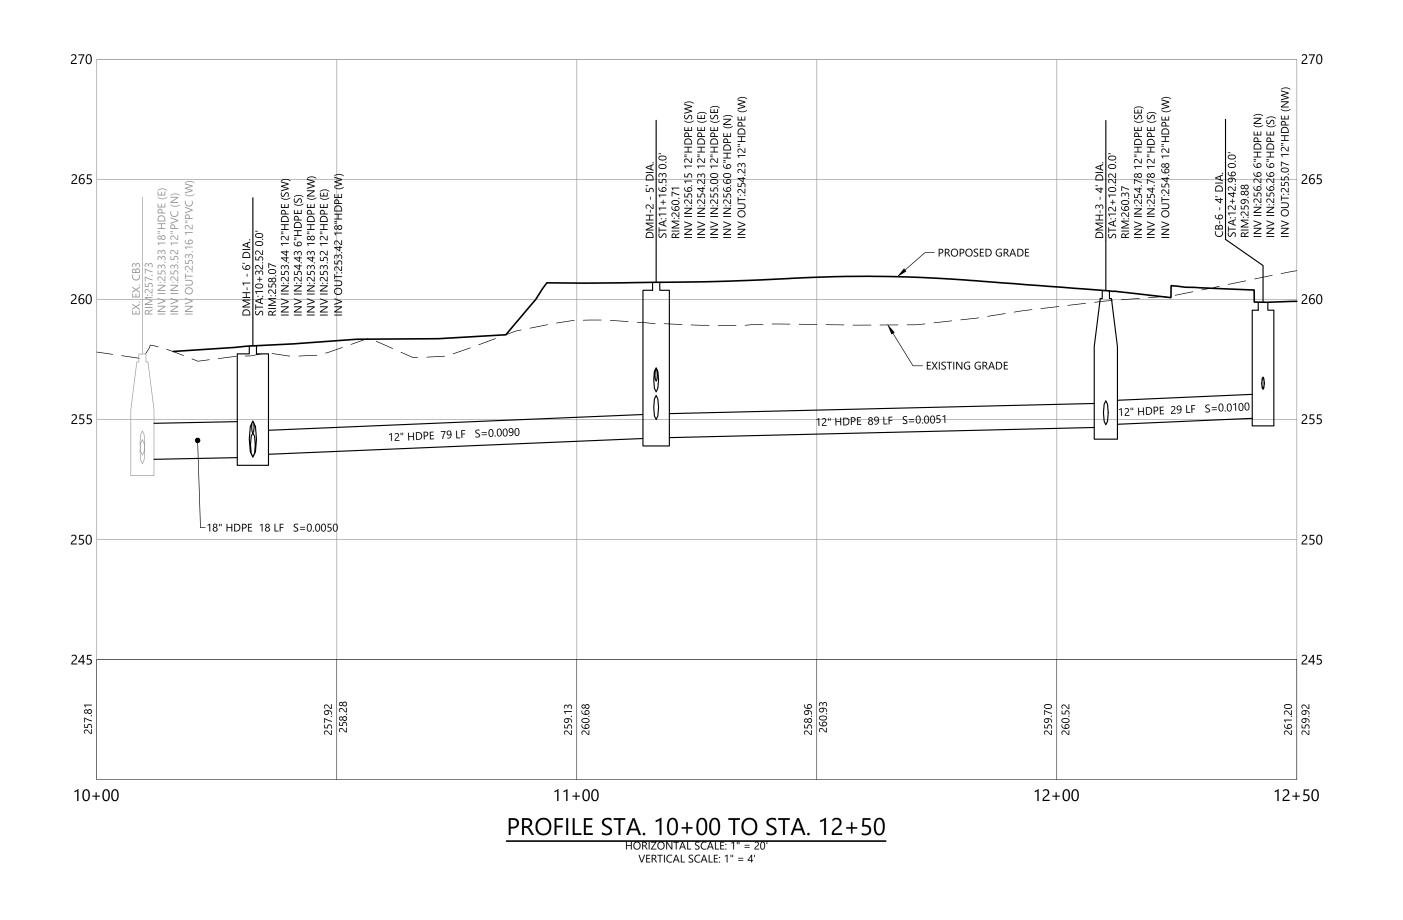


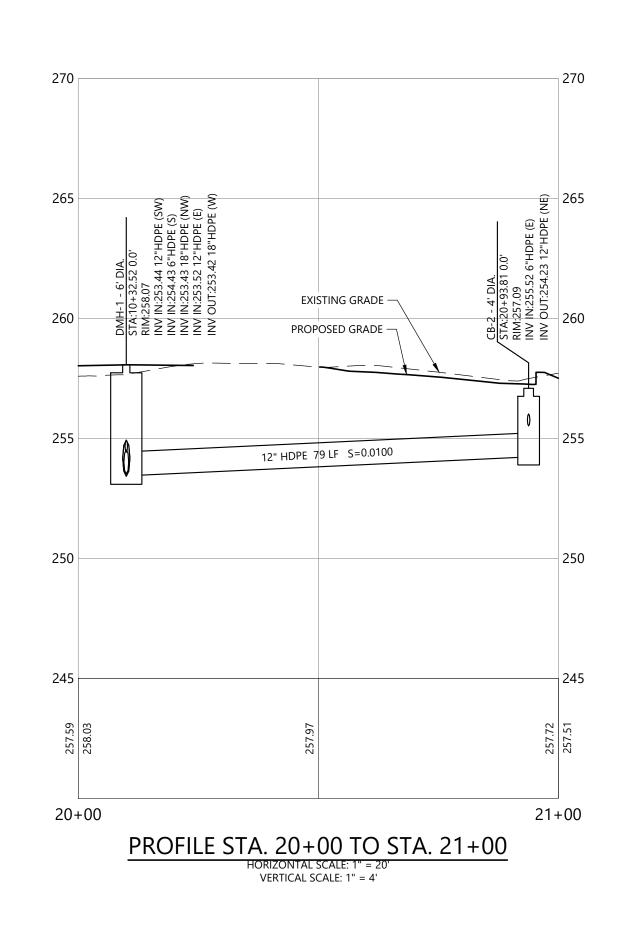

Woodard
& Curran

12 Mountfort Street
Portland, Maine 04101
800.426.4262 | www.woodardcurran.com

THIS DOCUMENT IS THE PROPERTY OF WOODARD & CURRAN AND ITS CLIENT.
REPRODUCTION OR MODIFICATION WITHOUT WRITTEN PERMISSION IS PROHIBITED.



Allied Engineering

A Salas O'Brien Company

160 Veranda Street Portland, Maine 04103 P: 207.221.2260 F: 207.221.2266

CONTEXT

Thornton Tomasetti

PE SEAL:

SITE PLAN REVIEW
NOT FOR CONSTRUCTION

CLIENT INFO:

CITY OF AUBURN 180 SOUTH MAIN STREET AUBURN, MAINE 04210

AUBURN ENGINE 2

1	1/29/2025	RESPONSE TO CITY COMMENTS
REV	MM/DD/YY	DESCRIPTION

JOB NO: 233981.13

DATE: JANUARY 2025

SCALE: AS NOTED

DESIGNED BY: RA

DRAWN BY: JBC

CHECKED BY: CGS

FILENAME: 233981.13 C-0-104.dwg

DRAWING TITLE:

STORM DRAIN PROFILE

DRAWING NO:


C-0-202

0' 0 20'

BAR SCALE

1" = 20'

CHECK GRAPHIC SCALE BEFORE USING

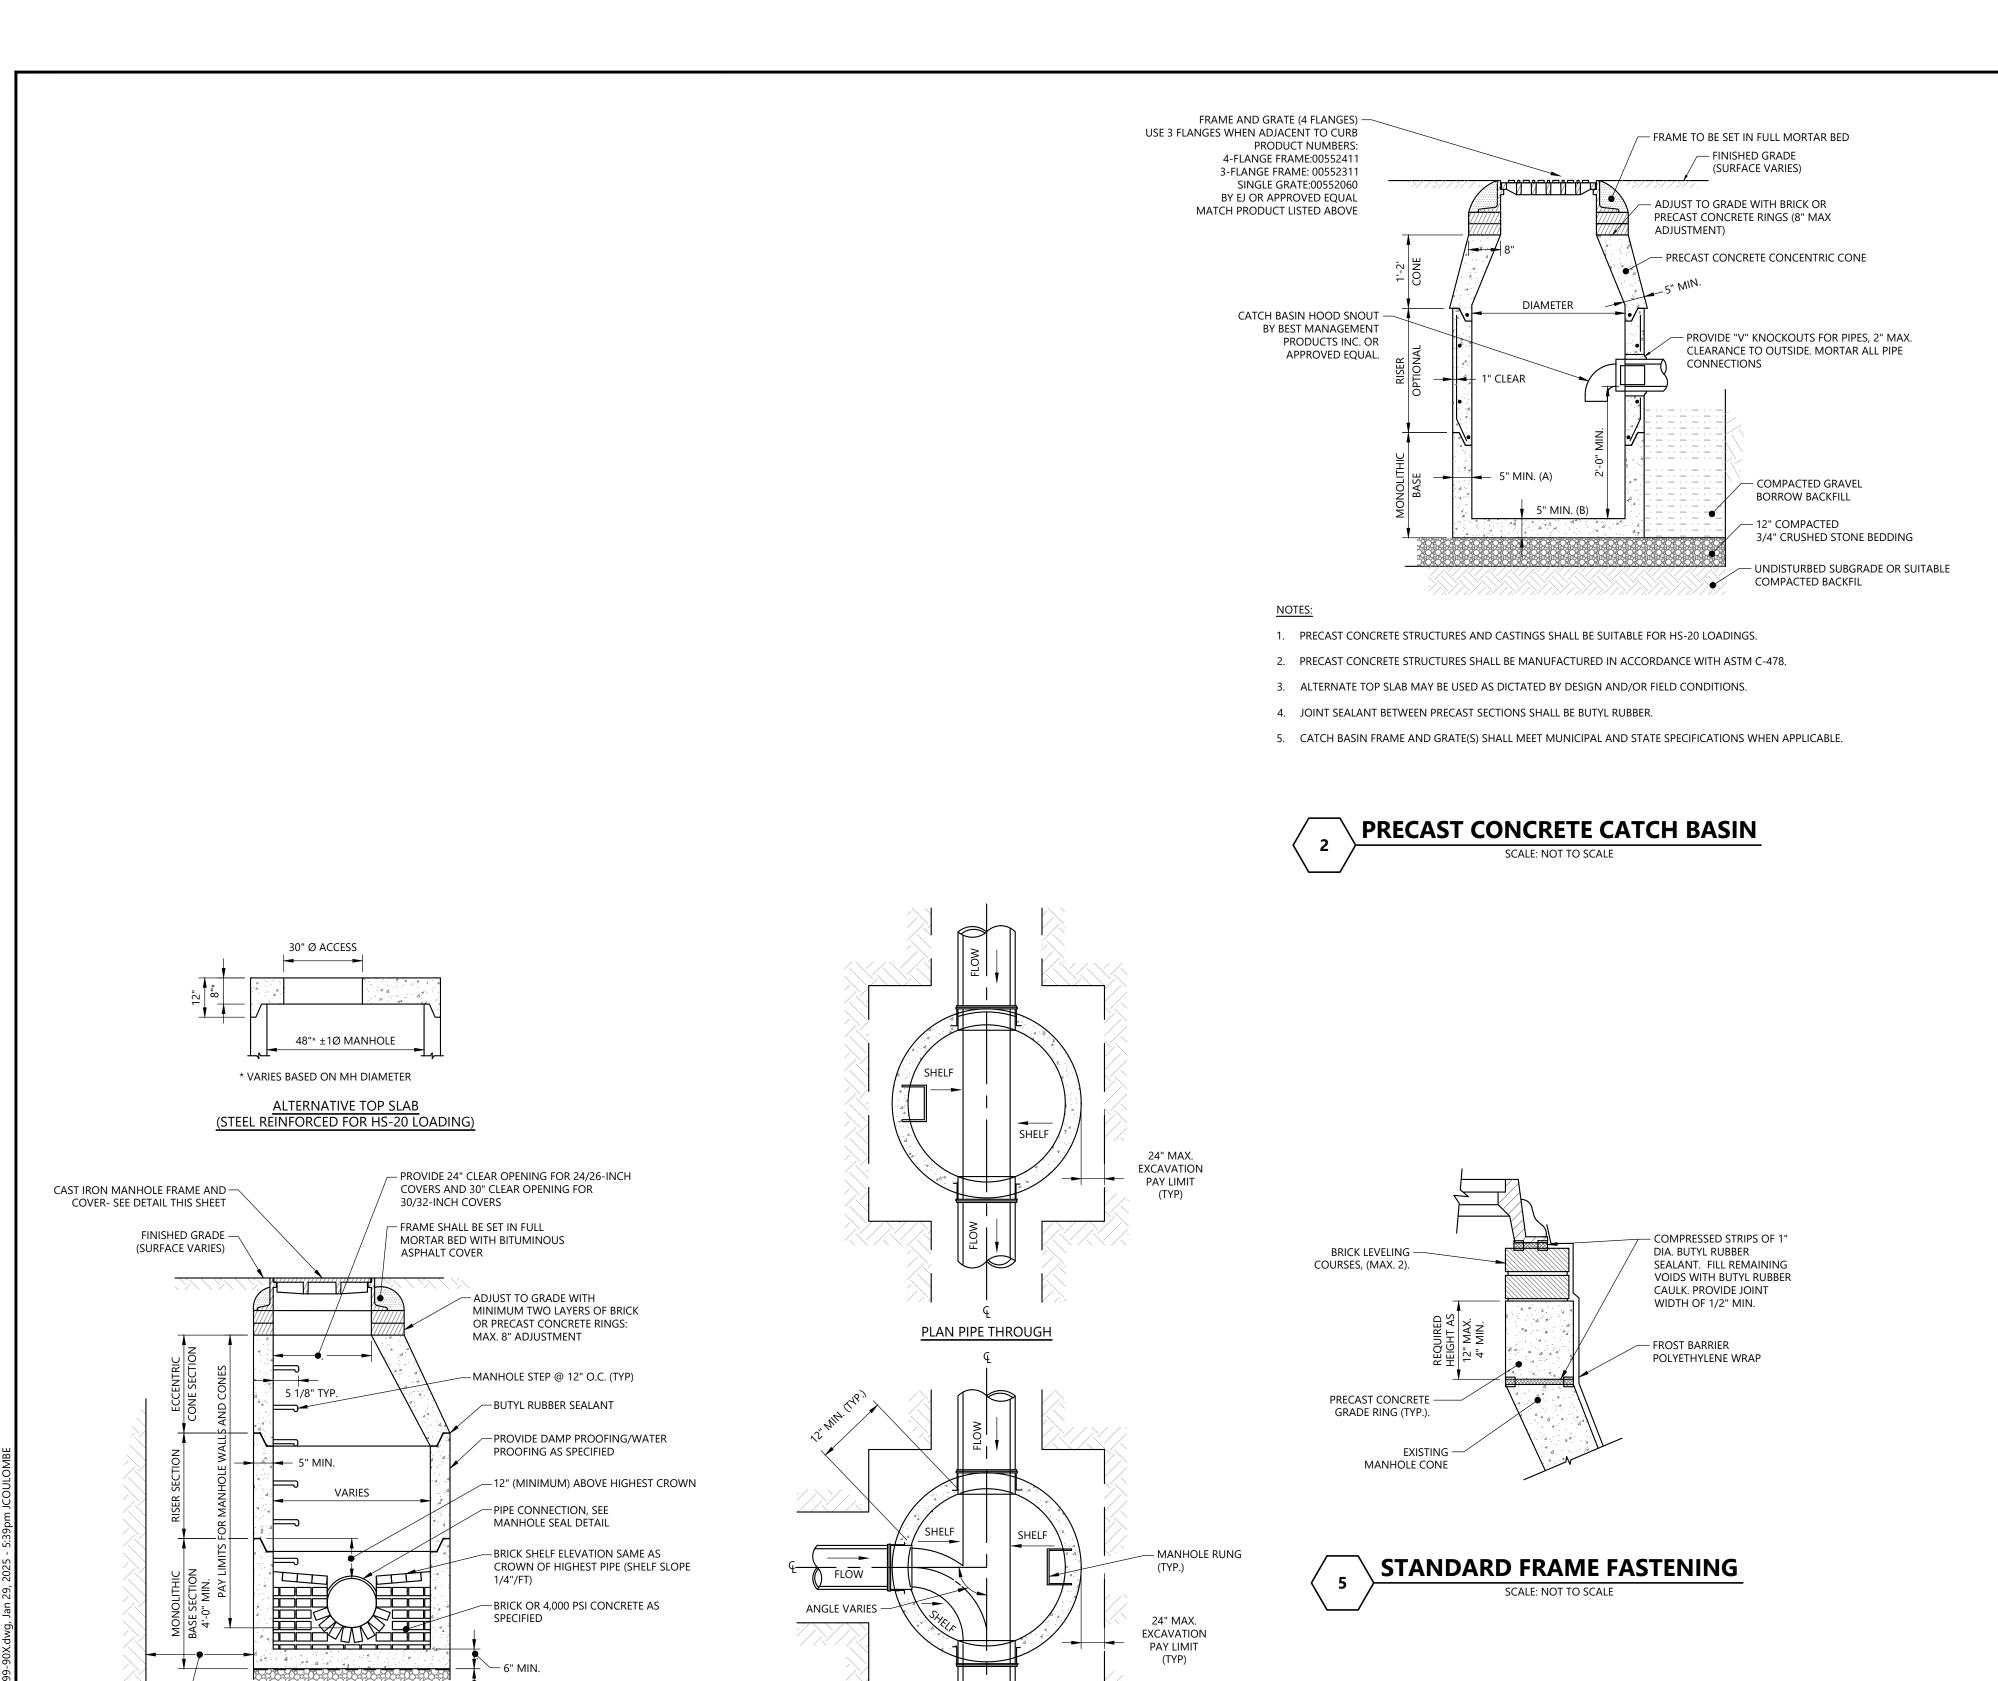

PLAN AT JUNCTION

─ 12" - 3/4" CRUSHED STONE BEDDING

- UNDISTURBED SUBGRADE OR

SECTION

COMPACTED SUITABLE BACKFILL

NOTES

24" MAX EXCAVATION —


PAY LIMIT (TYP)


WRAPPED IN NON-WOVEN GEOTEXTILE

1. SEE SPECIFICATIONS FOR REQUIREMENTS.

SEWER MANHOLE

SCALE: NOT TO SCALE

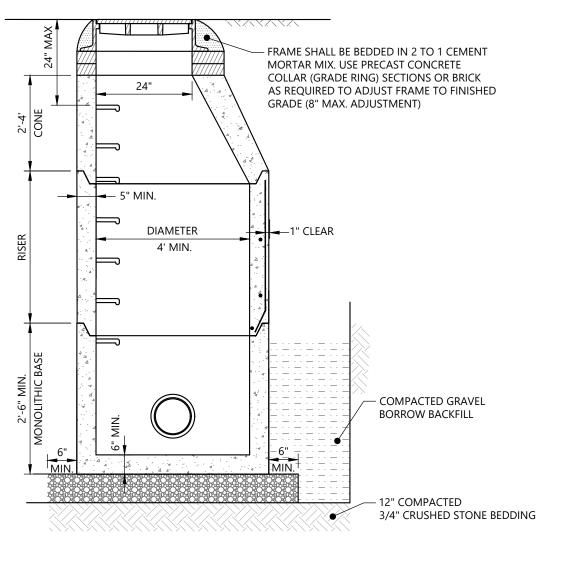


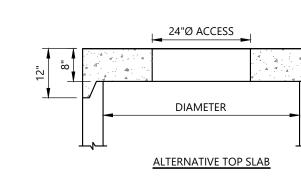


- 1. PRECAST CONCRETE STRUCTURES AND CASTINGS SHALL BE SUITABLE FOR HS-20 LOADINGS.
- 2. PRECAST CONCRETE STRUCTURES SHALL BE MANUFACTURED IN ACCORDANCE WITH ASTM C-478.
- 3. ALTERNATE TOP SLAB MAY BE USED AS DICTATED BY DESIGN AND/OR FIELD CONDITIONS.
- 4. UNLESS OTHERWISE NOTED, MANHOLES SHALL BE 48-INCH IN DIA.
- 5. MANHOLE FRAME AND GRATE(S) SHALL MEET MUNICIPAL AND STATE SPECIFICATIONS WHEN
- APPLICABLE. 6. 16" ALUM OR REINFORCED PLASTIC MANHOLE STEPS


12" ON CENTER.

PRECAST DRAINAGE MANHOLE

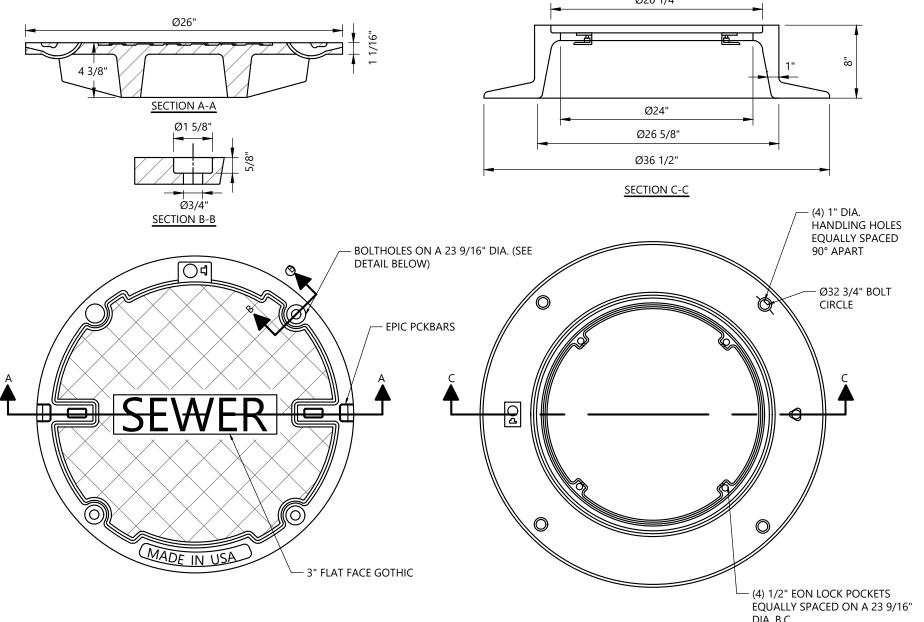

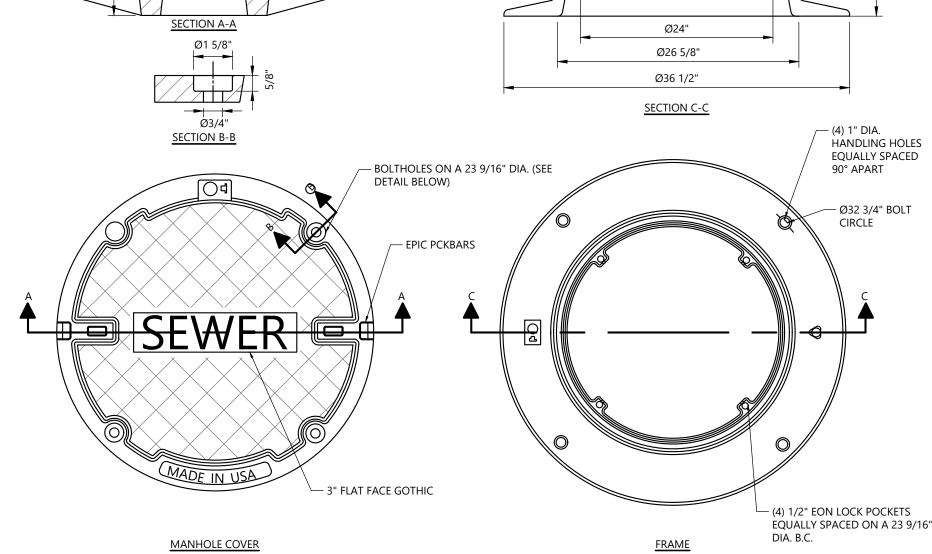




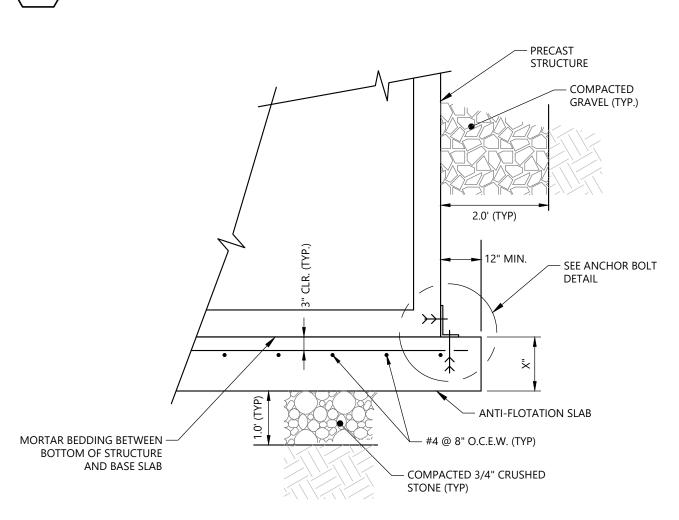





THIS DOCUMENT IS THE PROPERTY OF WOODARD & CURRAN AND ITS CLIENT. REPRODUCTION OR MODIFICATION WITHOUT WRITTEN PERMISSION IS PROHIBITED.



Allied Engineering A Salas O'Brien Company

160 Veranda Street Portland, Maine 04103 P: 207.221.2260 F: 207.221.2266

Tomasetti

SITE PLAN REVIEW **NOT FOR CONSTRUCTION**

CITY OF AUBURN 180 SOUTH MAIN STREET AUBURN, MAINE 04210

AUBURN ENGINE 2

			1
			1
			1
			1
			1
			1
			1
			1
1	1/29/2025	RESPONSE TO CITY COMMENTS	1
.EV	MM/DD/YY	DESCRIPTION	1
ОВ	NO:	233981.13	1
ΔΤF·		IANIJARY 2025	1

REV	MM/DD/YY	DESCRIPTION		
JOB NO:		233981.13		
DATE:		JANUARY 2025		
SCALE:		AS NOTED		
DESIGNED BY:		RA		
DRAWN BY:		MB		
CHE	CKED BY:	CGS		
FILEN	NAME:	233981.13 C-99-90X.dwg		

DRAWING TITLE: CIVIL

DETAILS - 4

C-99-904

THIS DOCUMENT IS THE PROPERTY OF WOODARD & CURRAN AND ITS CLIENT. REPRODUCTION OR MODIFICATION WITHOUT WRITTEN PERMISSION IS PROHIBITED.



Allied Engineering A Salas O'Brien Company

> 160 Veranda Street Portland, Maine 04103 P: 207.221.2260 F: 207.221.2266

Tomasett

SITE PLAN REVIEW **NOT FOR CONSTRUCTION**

CITY OF AUBURN **180 SOUTH MAIN STREET** AUBURN, MAINE 04210

AUBURN ENGINE 2

1/29/2025 RESPONSE TO CITY COMMENTS

REV MM/DD/YY 233981.13 JOB NO: JANUARY 2025 SCALE: AS NOTED DESIGNED BY: RA DRAWN BY: MB CHECKED BY: CGS

233981.13 C-99-90X.dwg

DRAWING TITLE: CIVIL **DETAILS - 5**

FILENAME:

C-99-905

METALIC MARKING TAPE (6" MIN. WIDTH) WITH LABEL MAXIMUM TRENCH PAY LIMIT SEE TABLE BELOW REFER TO PAVING DETAILS FINISHED GRADE SAWCUT EXISTING PAVEMENT (BOTH SIDES OF TRENCH) - COMPACTED SUITABLE BACKFILL — 2" RIGID INSULATION WHERE SPECIFIED, SEE NOTE 3. STONE WRAPPED IN NON-WOVEN GEOTEXTILE

NORMAL GRADE

MAXIMUM PAYMENT WIDTHS - TRENCH (SEWER/DRAIN) DEPTH OF PIPE (GROUND SURFACE TO PIPE INVERTS) PAYMENT ITEM 0' TO 12' 12' TO 20' OVER 20' TEMPORARY TRENCH PAVEMENT D + 4'-0" D + 7'-0" D + 8'-0" PERMANENT TRENCH PAVEMENT D + 6'-0" D + 9'-0" D + 10'-0" D + 3'-0" D + 5'-0" D + 5'-0"

1. MAINTAIN UNIFORM TRENCH WIDTH TO 12"

2. SEE PAVEMENT DETAILS FOR PAVING AND

4. IF EXCAVATION BELOW NORMAL GRADE IS

GRAVEL (6" COMPACTED LIFTS)

BOTTOM. BACKFILL TRENCH FROM TRENCH BOTTOM TO NORMAL GRADE WITH COMPACTED

5. NO PAYMENT WILL BE MADE FOR SHEETING LEFT

IN PLACE UNLESS DIRECTED BY ENGINEER.

6. PROVIDE 12" OF COMPACTED CRUSHED STONE BEDDING IF EXCAVATING IN ROCK.

3. MAINTAIN MINIMUM OF 5'-0" FT. OF COVER OVER PIPE. A 2" RIGID INSULATION WILL BE REQUIRED

FOR WATER AND SEWER PIPES IN AREAS WITH INSUFFICIENT COVER WHEN DIRECTED BY

REQUIRED, PROVIDE SHORING 2' BELOW TRENCH


PATCHING REQUIREMENTS.

OVER PIPE.





- SEWER/WATER/DRAIN

PIPE (SIZE VARIES)

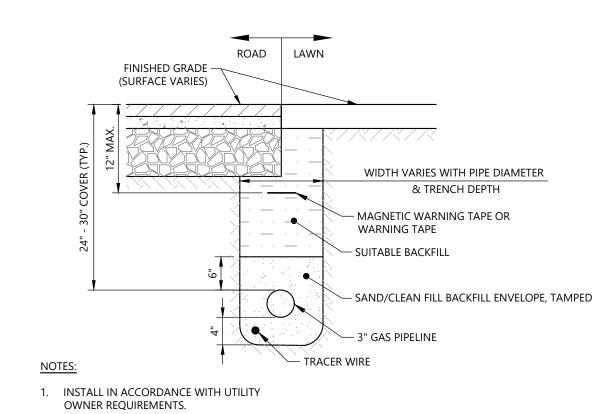

GAS PIPE TRENCH SCALE: NOT TO SCALE

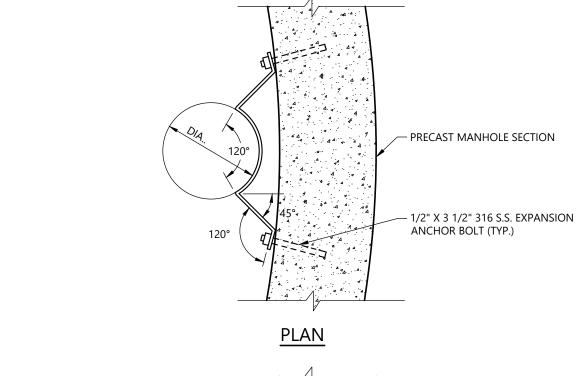

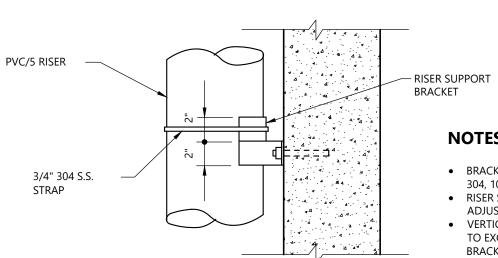


NOTES BRACKET SHALL BE FABRICATED FROM TYPE 304, 10 GAUGE STAINLESS STEEL SHEET.

 RISER SHALL BE FASTENED TO BRACKET WITH ADJUSTABLE S.S. STRAPS. VERTICAL SPACING OF RISER SUPPORTS NOT TO EXCEED 36" WITH A MINIMUM OF TWO BRACKETS & STRAPS PER DROP.

ELEVATION


TYPICAL RISER SUPPORT BRACKET DETAIL SCALE: NOT TO SCALE

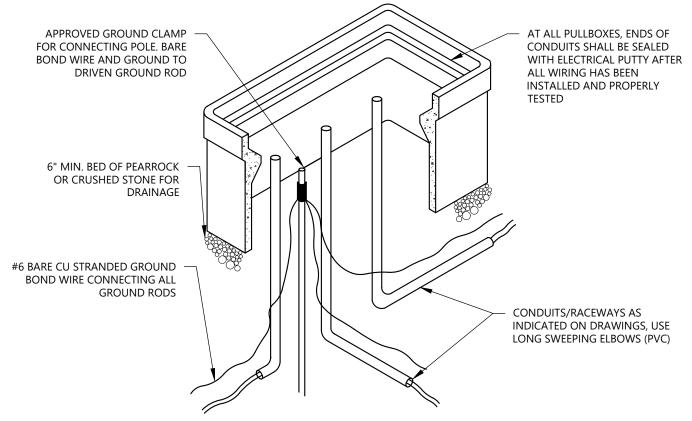


1. REFER TO ELECTRICAL DRAWINGS AND SPECIFICATIONS FOR CONDUIT SIZES, NUMBER OF CONDUITS, AND ADDITIONAL INFORMATION.

- 2. ELECTRIC PULL BOXES/HANDHOLES AND THEIR COVER SHALL BE SUITABLE FOR HS-20 LOADINGS.
- 3. FINAL DIMENSIONS OF PULL BOXES SHALL BE AS VERIFIED IN THE FIELD AND SHALL BE IN ACCORDANCE WITH NEC.
- 4. PULLBOX COVERS SHALL BE CAST IRON. PROVIDE EXTENSION AS REQUIRED.
- 5. PULLBOXES SHALL BE PRECAST EQUAL TO: GEORGE ROBERTS, BROOKS, OR A.C. MILLER.
- 6. REFER TO SPECIFICATIONS FOR FURTHER REQUIREMENTS.




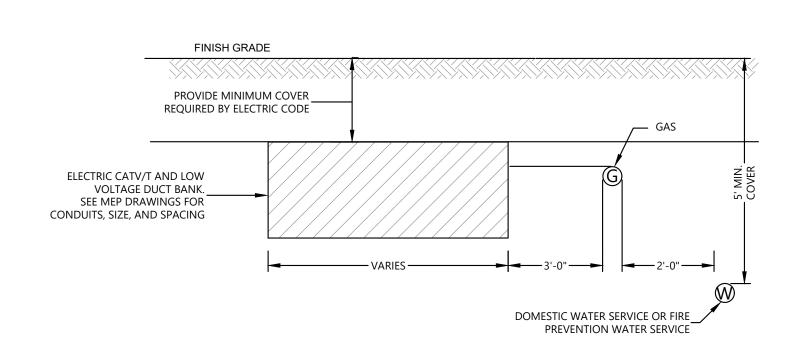

TYPICAL MINIMUM REQUIRED UTILITY SEPARATION SCALE: NOT TO SCALE

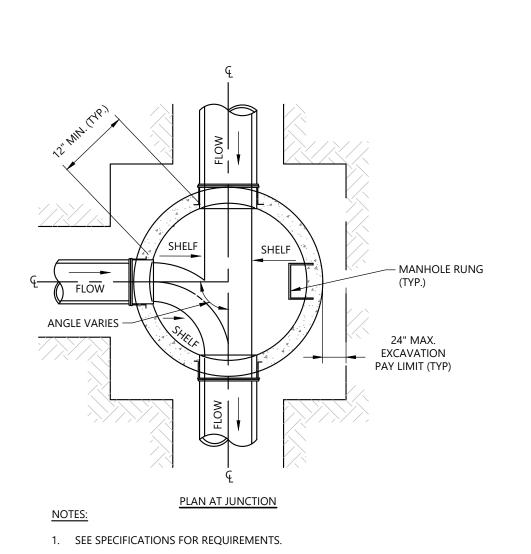

SEWER MANHOLE INVERT DETAIL

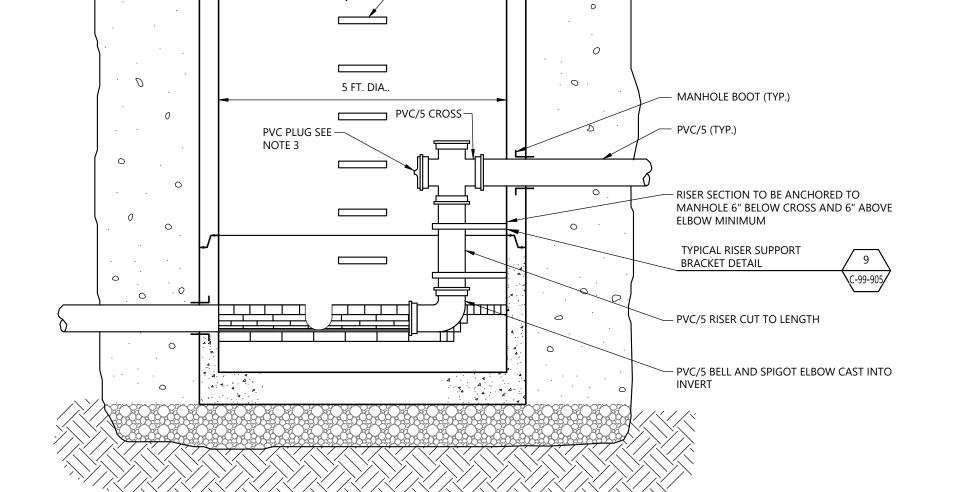

NOTES

1. SEE PRECAST MANHOLE SECTION FOR TYPICAL MANHOLE INFORMATION,

OVERLAP

UNDERDRAIN

6" DIA. HDPE UNDERDRAIN PIPE

PERFORATIONS DOWN

3/4" CRUSHED STONE

PAVEMENT, BASE, AND SUBBASE, REFER TO PAVEMENT SECTION DTLS.

47 V X X

1. ELECTRICAL SERVICE TRENCH SHOWN FOR TRENCH WORK SCOPE

ONLY. REFER TO THE ELECTRICAL DRAWINGS FOR SERVICE CONDUIT

ELECTRICAL SERVICE TRENCH

SCALE: NOT TO SCALE

– RUNG (TYP.)

GEOTEXTILE FABRIC

— MIN. 4" BEDDING

┌─ 4" LOAM & SEED OR LANDSCAPED SURFACE

- WARNING TAPE

- SUITABLE BACKFILL

SAND/CLEAN FILL BACKFILL

4" MIN. ENVELOPE, TAMPED

- INCLUDING NOTES. 2. PROVIDE DROP PIPE FOR ALL INVERT DIFFERENTIALS OF 2' OR GREATER OR AS APPROVED BY THE ENGINEER.
- 3. SECURE PLUG WITH STAINLESS STEEL SCREWS. CUT OFF TOP 1/3 OF PIPE PLUG.

TYPICAL PRECAST MANHOLE WITH INSIDE DROP DETAIL

FINISH GRADE

OPERATING NUT

TOP SECTION —

EXTENSION PIECE


BASE SECTION

VALVE ----

VALVE WITH VALVE BOX

SCALE: NOT TO SCALE

THIS DOCUMENT IS THE PROPERTY OF WOODARD & CURRAN AND ITS CLIENT. REPRODUCTION OR MODIFICATION WITHOUT WRITTEN PERMISSION IS PROHIBITED.



Allied Engineering A Salas O'Brien Company


160 Veranda Street Portland, Maine 04103 P: 207.221.2260 F: 207.221.2266

SITE PLAN REVIEW

CITY OF AUBURN 180 SOUTH MAIN STREET AUBURN, MAINE 04210

NOT FOR CONSTRUCTION

AUBURN ENGINE 2



233981.13 JOB NO: DATE: JANUARY 2025 SCALE: AS NOTED DESIGNED BY: RA DRAWN BY: MB CHECKED BY: CGS

DRAWING TITLE:


FILENAME: 233981.13 C-99-90X.dwg

DETAILS - 6

C-99-906

(TYP.) ADJUST TO GRADE RIGID INSULATION IF REQUIRED BY —— — NEW CURB BOX CORPORATION STOP TAPPED TO MAIN AT A 15° ANGLE SEE SERVICE ——— SADDLE DETAIL NEW CURB STOP — CONCRETE PAVING BLOCK — CONNECT AND TRANSITION TO NEW OR EXISTING WATER SERVICE COMPACTED SUITABLE GOOSENECK TUBING TO ALLOW FOR — SETTLING. TOP OF GOOSENECK NOT TO MATERIAL EXCEED PIPE CROWN. PROVIDE 1" COPPER TUBING FOR NEW SERVICES, UNLESS NOTED OTHERWISE. PROVIDE 6" OF SAND AROUND TUBING.




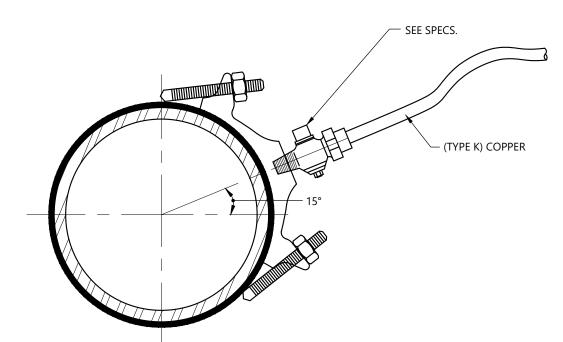

1. SERVICE CONNECTIONS (DIRECT TAPS AND SERVICE SADDLES) WILL BE INSTALLED SO THAT THE OUTLET IS AT AN ANGLE OF NOT MORE THAN 15° ABOVE THE HORIZONTAL. ALWAYS PUT A BEND OR "GOOSENECK" IN THE SERVICE LINE PRIOR TO CONNECTING TO PROVIDE FLEXIBILITY AND "GIVE" TO COUNTER THE EFFECTS OF A LOAD DUE TO SETTLEMENT OR EXPANSION AND/OR CONTRACTION (SEE DETAILS).





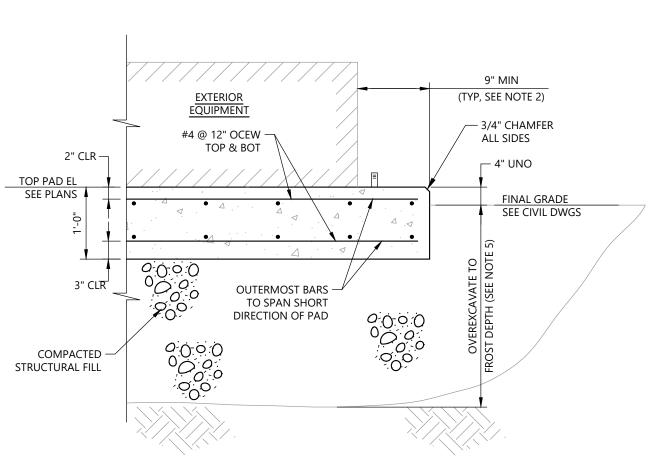

SEE MECHANICAL, PLUMBING, ELECTRICAL, CIVIL, AND STRUCTURAL DRAWINGS FOR EQUIPMENT LOCATIONS, QUANTITIES, AND LAYOUT.

 PAD SHALL PROJECT A MINIMUM OF 9-INCH BEYOND MECHANICAL EQUIPMENT FOOTPRINT, UNLESS NOTED OTHERWISE. FOR ANCHOR RODS 5/8" DIA OR LESS, PAD PROJECTIONS MAY BE REDUCED FROM 9-INCH TO 6-INCH.

3. TOP OF PAD SHALL BE LEVEL WITHIN 1/8-INCH.

4. PROVIDE SACK-RUBBED FINISH TO ALL EXPOSED SIDES OF EQUIPMENT PAD AND A TROWEL FINISH TO THE TOP SURFACE.

PROVIDE COMPACTED STRUCTURAL FILL UNDER PAD FOOTPRINT TO FROST DEPTH TO PREVENT FROST HEAVE. IF OVER-EXCAVATION IS NOT FEASIBLE, EXCAVATE 15.5", PROVIDE 3.5-INCH MINIMUM RIGID INSULATION UNDER ENTIRE PAD AND EXTENDING A MINIMUM OF 4.5-FT BEYOND ALL SIDES OF THE EQUIPMENT PAD, AND PROVIDE 12" COMPACTED STRUCTURAL FILL.

6. PROVIDE SAWED JOINT (SJ) IN EQUIPMENT PADS, IF SHOWN AND NOTED ON PLANS.

8. ANCHOR RODS SHALL BE 316 AISI STAINLESS STEEL, UNLESS NOTED OTHERWISE.


9. PRIOR TO EQUIPMENT INSTALLATION, APPLY CURE AND SEAL COMPOUND OR WATERPROOFING TO EQUIPMENT PAD SURFACES.




NOTES:

1. BOLLARD SPECIFICATIONS PER MANUFACTURER TO BE SUBMITTED TO EOR FOR REVIEW AND APPROVAL PRIOR TO CONSTRUCTION.

2. PROVIDE A MINIMUM 2-FT SPACING FROM UNDERGROUND UTILITIES.

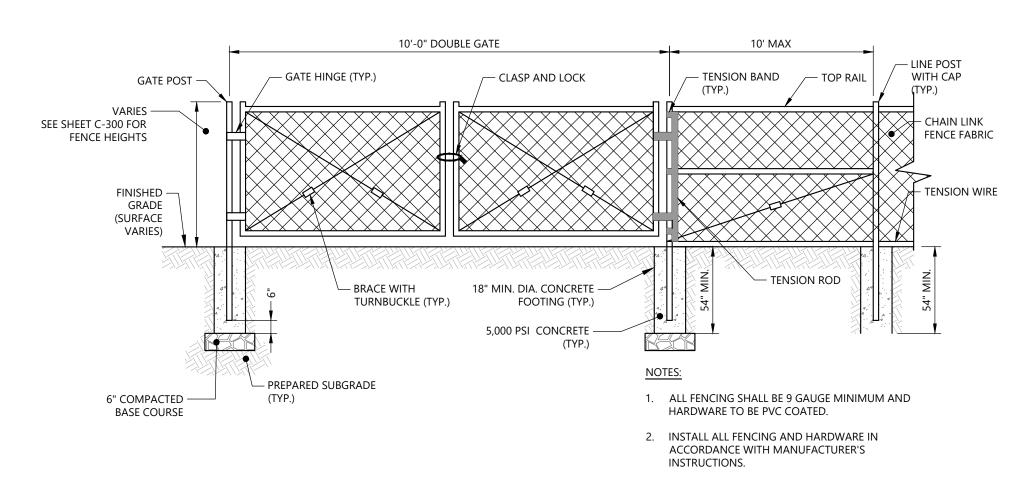



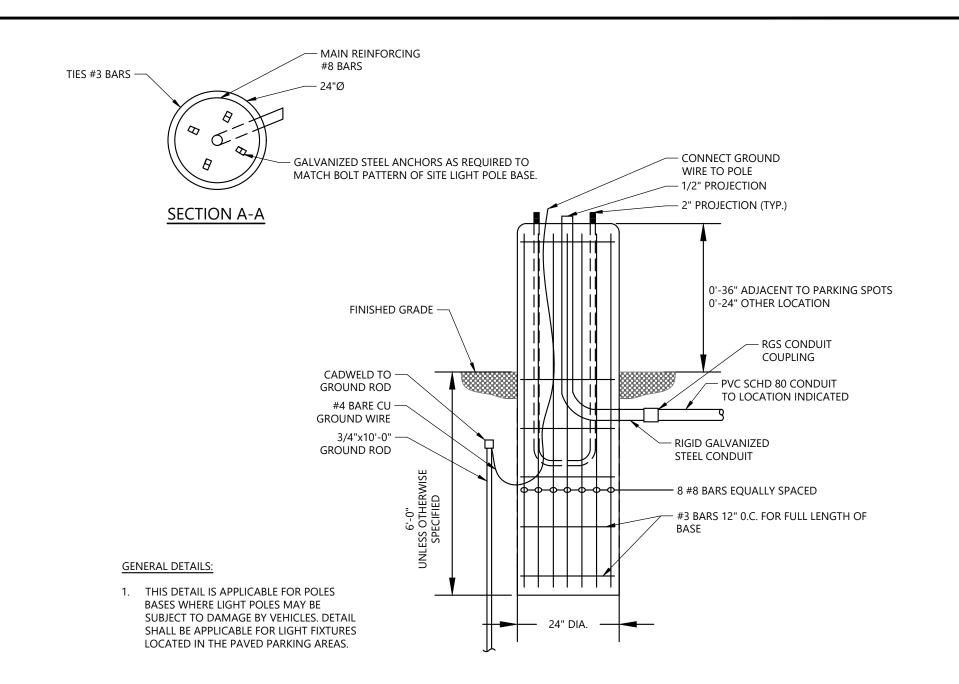



12 Mountfort Street Portland, Maine 04101 800.426.4262 | www.woodardcurran.com

THIS DOCUMENT IS THE PROPERTY OF WOODARD & CURRAN AND ITS CLIENT. REPRODUCTION OR MODIFICATION WITHOUT WRITTEN PERMISSION IS PROHIBITED.



Allied Engineering A Salas O'Brien Company

160 Veranda Street Portland, Maine 04103 P: 207.221.2260 F: 207.221.2266

SITE PLAN REVIEW NOT FOR CONSTRUCTION

CITY OF AUBURN 180 SOUTH MAIN STREET AUBURN, MAINE 04210

AUBURN ENGINE 2


1	1/29/2025	RESPONSE TO CITY COMMENTS	
REV	MM/DD/YY	DESCRIPTION	
JOB	NO:	233981.13	
DAT	- .	LANULARY 2025	

JANUARY 2025 SCALE: AS NOTED DESIGNED BY: RA DRAWN BY: MB CHECKED BY: CGS FILENAME: 233981.13 C-99-90X.dwg

DRAWING TITLE: **DETAILS - 7**

C-99-907

	Luminaire Scheo	dule Qty Label	Arrangement	Description	Tag LLF Luminaire Lumens
	<u>→</u> 2	2 B1 1 F1	Single Single	NLS: TBL-42-T4-16L-40-40K7-UNV-AB-CXX MAGNIFLOOD: BAYVILLE L4-LED-49 // POLE TOP ADAPTER MF-2764-DIAMXX-CXX	0.750 2206 ADVISE 3 INCH OR 4 INCH DIAM FLAGPOLE TOP 0.900 4460
	/ 1 	1 M1-18 1 M2-7 1 P3	GROUP Single Single	SPI: SIW12139-6FT-L24W-120-277V-4000K-DF_80-DF_DIM1-DF_MCS-RUN OAL 18'-DF_FT-OAP18IN NULITE: RXT-F-DASYM-07L40-UNV-D-11-CXX-7 NLS: TRC-T3-32L-7-40K7-UNV-SGL-CXX-HSS-16	CONFIRM LENGTH REQUIRED TO SPAN SIGN 0.900 N.A. 1.570 2869 MTD 18' AFG ON 16' POLE AND 2' CONCRETE BASE // POLE INCLUDED IN FIXTURE CAT# 0.900 6552
	+ 1 + 1	1 P4 1 P5 12 R5	Single Single Single	NLS: TRC-T4-32L-1-40K7-UNV-SGL-CXX-16 NLS: TRC-T5-32L-1-40K7-UNV-SGL-CXX-16 ALPHABET: NU4-RD-SW-25LM-30K-80-50D-DL-CXX-CXX-NC-UNV-DIM10	MTD 18' AFG ON 16' POLE AND 2' CONCRETE BASE // POLE INCLUDED IN FIXTURE CAT# 0.900 12453 MTD 18' AFG ON 16' POLE AND 2' CONCRETE BASE // POLE INCLUDED IN FIXTURE CAT# 0.900 12699 0.900 2329
		3 W1A 1 W1B	Single Single	STARTEK: HYDROD-2-750-SD-35K-80-PB-WM-U-EC-MOD STARTEK: HYDROD-2-750-SD-35K-80-PB-MM-U-EC-MOD	WALL MTD 8' AFG, OVER DOORS MULLION MOUNT // WALL MTD 8' AFG, OVER DOORS 0.375 4002
		1 W3 6 W4	Single Single	NLS: NV-W-T3-16L-1-40K7-UNV-WM-CXX PERFORMANCE IN LIGHTING: M20-M-26-T4-CXX-70-4K-UNV-0-10V	WALL MTD 14' AFG WALL MTD 8' AFG 0.900 6390 0.900 2183
•0.0 •0.0 •0.					Calculation Summary Label Units Avg Max Min Avg/Min Max/Min ENTIRE AREA Fc 0.63 21.4 0.0 N.A. N.A. FRONT PARKING Fc 1.20 2.9 0.3 4.00 9.67
•0.0 •0.0	0 •0.0 •0.0	0.1 0.1	0.0 0.0 0.0		FRONT PARKING FC 1.20 2.9 0.3 4.00 9.67 SIDE PARKING FC 1.60 3.3 0.9 1.78 3.67
•0.0 •0.0 •0.0	0 0.1 0 1	0.1	0.1 0.0 0.0	•0.0 •0.0 •0.0 •0.0 •0.0 •0.0 •0.0 •0.0	
•0.0 0.0 •0.0 •0.0	0 0.1 0.1	0.1 0.1	0.1 0.1	0.1 0.1 0.1 0.0 0.0 0.1 0.1 0.1 0.0 0.0 0.0 0.0	
•0.0	0 0.1 0.1	0.1 0.2	0.2 0.2 0.1	0.2 0.3 0.5 0.5 0.5 0.2 0.3 0.2 0.1 0.0 0.0 0.0 0.0	
•0.0 •0.0 •0.0	0 0.1 0 1	0.2 0.3	0.4 0.4	0.5 0.6 1.0 1.1 1.5 2.8 4.9 P 3.2 1.3 0.4 0.2 0.2 0.2	0.2 0.1 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
		0.2 0.5	1.0 0.8 1.2	1.7 1.0 0.8 1.1 1.5 2.1 2.8 4.1 4.1 2.3 1.3 0.9 0.7 0.5 0	0.5 0.5 0.4 0.3 0.2 0.2 0.1 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0
	0 /0.1 / 0.1	\\ \bigsigma_{0.3} \\ \bigsigma_{0.7} \\ \end{array}	1.5 2.2 3.4	3.2 1.9 0.5 0.5 0.8 1.6 2.2 2.1 2.2 1.9 1.4 1.1 0.9 0	0.9 1.0 0.8 0.7 0.6 0.5 0.3 0.1 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
					.4 1.5 1.4 1.3 1.1 0.8 0.5 0.2 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0
	// \			F1 / / / / / / / / / / / / / / / / / / /	8 2.2 2.0 1.5 1.1 0.7 0.3 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0
•0.0 •0.0 •0.0	0 0.0 0.2	0 9 2.2	2.8 2.2 2.4		2.2 2.9 3.0 2.5 4.8 1.2 0.7 0.3 0.1 0.0 0.0 0.0 0.0 0.0 0.0
	0 0.0 0.1	0 4 1.3	2.2 1.9 2.0	1.5 1.2 0.9 1.6 9.0 N 1 A W1 A 1.8 2	2.3 3.0 P3 56 2.5 1.8 1.1 0.6 0.2 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0
0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0	0 0,0 0.1	0.2	1.6 1.4 1.3	0.8 0.7 1.0 2.9 4.0 2.1 2	$\begin{array}{c ccccccccccccccccccccccccccccccccccc$
	0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0	0.1 10.B	12.9 0.7 4.1	1) 5 1.0 1.8 5.7 19 8 2 1	1.7 1.8 1.9 1.8 1.4 0.9 0.4 0.2 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
0.0		1			1.3 1.3 1.0 0.7 0.3 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
0.0 0.0 0.0 0.0 0.0	0.0 0.0	0.1 0.1	0.1 0.2 0	2.5 8.1 8.6 8.6 1.8 1	1 1.0 0.9 0.8 0.6 0.4 0.2 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
0.0 0.0 0.0 0.0 0.0	0.0 0.0	0.0 0.0	0.1 0.2 0.9	2.5 6.6 5 7 1.6 1	1 0/9 0.5 0.4 0.3 0.2 0.1 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
•0.0 •0.0 •0.0 •0.0 •0.0 •0.0	0 0.0 0.0	0.0 0.0	0.0 0.2 1.0	1.7	0.7 0.2 0.1 0.1 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0
•0.0 •0.0 •0.0 •0.0 •0.0					0.6 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
•0.0 •0.0 •0.0 •0.0 •0.0 •0.0	0 0.0 0.0	0.0 0.0	0.0 0.4 1.4	5.4 W 2 2 W 1 A 5.9 1	0.4 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
	0 0.0 0.0	•0.0 •0.0	0.0 0.2 0.5	106 2.9 4.4 4.9 4.8 0.5 0.1 E	
•0.0 •0.0 •0.0 •0.0 •0.0 •0.0	0 •0.0 •0.0	•0.0 •0.0	0.0 0.1 0.2	•0.4 •0.7 •1.4 •1.2 •1.3 •0.4 •0.1 •0.0 •0.0 •0.0 •0.0 •2.1 •1.8 •1	
0.0 0.0 0.0 0.0 0.0 0.0 0.0	0 •0.0 •0.0	•0.0 •0.0	0.0 0.0 0.0	• 0.1 • 0.2 • 0.3 • 0.2 • 0.0	.7 •0.1 •0.0 •0.0 •0.0 •0.0 •0.0 •0.0 •0.0
0.0 0.0 0.0 0.0 0.0	0 •0.0 •0.0	•0.0	•0.0 •0.0 •0.0 •••••••••••••••••••••••••	0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0	0.4 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
	0 •0.0 •0.0	•0.0 •0.0	0.0 0.0 0.0	•0.0 •0.0 •0.0 •0.0 •0.0 •0.0 •0.0 •0.0	0.4 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
	•0.0	•0.0 •0.0	•0.0 •0.0 •0.0	•0.0 •0.0 •0.0 •0.0 •0.0 •0.0 •0.0 •0.0	0.2 0.1 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
			•0.0 •0.0 •0.0	•0.0 •0.0 •0.0 •0.0 •0.0 •0.0 •0.0 •0.0	

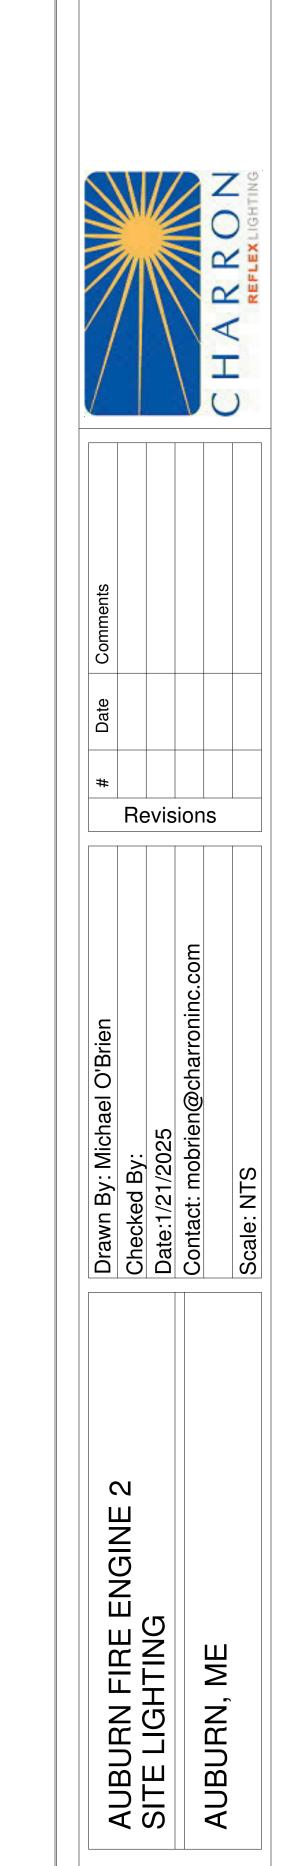

Page 1 of 1



City of Auburn, Maine

Office of the City Manager www.auburnmaine.gov | 207.333.6601 60 Court Street | Auburn, Maine 04210

FOR IMMEDIATE MEDIA DISTRIBUTION

Date: February 6, 2025

Contact: Liz Allen, Director of Communications & Community Engagement

Phone: 207.333.6601 X2070 E-mail: lallen@auburnmaine.gov

AUBURN APPOINTS NEW PLANNING DIRECTOR

Hediger brings experience, integrity & enthusiasm to Team Auburn

AUBURN, ME – The City of Auburn is delighted to announce that David Hediger has been hired as the city's new director of planning.

"David's depth of knowledge, planning experience, dedication to public service, and familiarity with our community made him an exceptional candidate for the position," said Public Services Executive Director, Eric Cousens. "I have worked with David for over 20 years, collaborating on planning issues facing the greater Auburn area and I am excited that he will be joining our Public Services team as planning director."

David Hediger is a dedicated municipal planning professional with more than 20 years of experience in comprehensive planning, code enforcement, and project management.

He previously served as director of planning and code enforcement for the City of Lewiston, leading municipal planning initiatives, managing zoning and land use regulations, and supporting various boards and committees. Most recently, he was a senior planner for the *Land for Maine's Future* program, overseeing land conservation projects, grant administration, and compliance with funding requirements.

David holds a master's degree in public policy and management from the Muskie School of Public Service and a Bachelor of Arts in Geography/Environmental Planning and Policy from the University of Maine at Farmington. An active member of the community, he serves on

the committee for the Lewiston/Auburn Triple Crown 5K Series, the Lewiston Municipal Federal Credit Union Supervisory Committee, and the Minot Moonshiners Snowmobile Club.

"David Hediger's strong work ethic, integrity, and passion for collaboration align well with Auburn's core values," said City Manager Phil Crowell. "David is committed to supporting the City of Auburn's vision for responsible growth and development and that makes him a great fit for our team"

"With a new community-driven comprehensive plan in progress and a talented new Planning Director, this is an exceptional time for Auburn," added Crowell. "Our team works to efficiently deliver quality services to meet the changing needs of *everyone* in our community, and effective, impactful planning is vitally important."

"Auburn is a unique city, with high-quality recreational amenities, endless potential, and a tapestry of neighborhoods that are appealing, active and affordable," added Cousens. "We are excited to bring David on board to help provide opportunities for smart growth that align with our comprehensive plan."

Hediger, who will begin on Monday, February 24, replaces Eric Cousens, who was recently promoted to the position of executive director of public services after 18 years in the planning department.

###



City of Auburn, Maine

Office of Planning & Permitting

www.auburnmaine.gov | 60 Court Street Auburn, Maine 04210 207.333.6601

TO: Auburn Planning Board

FROM: Natalie Thomsen, Planning Coordinator

DATE: February 11, 2025

RE: Election Process for Chair and Vice Chair – Procedural Correction

Background:

At the last Planning Board meeting on January 14, 2025, elections were held for Chair and Vice Chair. The process followed included a nomination, a second, and an immediate vote by voice. Upon review, it appears the procedure did not fully comply with **Robert's Rules of Order** due to missing steps in the nomination process.

Issues Identified:

- 1. **Failure to Call for Additional Nominations:** The Chair should ask three times if there are additional nominations before closing them.
- 2. **No Formal Motion to Close Nominations:** While not strictly required, best practice is to formally close nominations before voting.

Corrective Actions:

- 1. **Rescind and Reconsider the Elections:** A motion should be made to rescind the votes due to procedural errors and redo the election correctly.
- 2. Proper Election Process:
 - a. Open nominations and call for additional nominees three times.
 - b. Close nominations with a formal motion.
 - c. Conduct voting

Draft Motions:

- Motion to Rescind Elections: "I move to rescind the elections of the Chair and Vice Chair conducted at the last meeting due to procedural errors."
- **Motion to Open/Close Nominations:** "I move to open/close nominations for the position of Chair."
- Motion to Elect Chair: "I move to elect [Nominee's Name] as Chair of the Planning Board."

Repeat for Vice Chair.

Conclusion:

Implementing these steps will ensure compliance with **Robert's Rules of Order** and uphold the legitimacy of the board's leadership. Please review and be prepared to take corrective action at the next meeting.